

WTPO240

WORLD BANK TECHNICAL PAPER NUMBER 240
ENERGY SERIES


January 1994

Renewable Energy Technologies

A Review of the Status and Costs of Selected Technologies

Kulsum Ahmed

with an overview by Dennis Anderson and Kulsum Ahmed

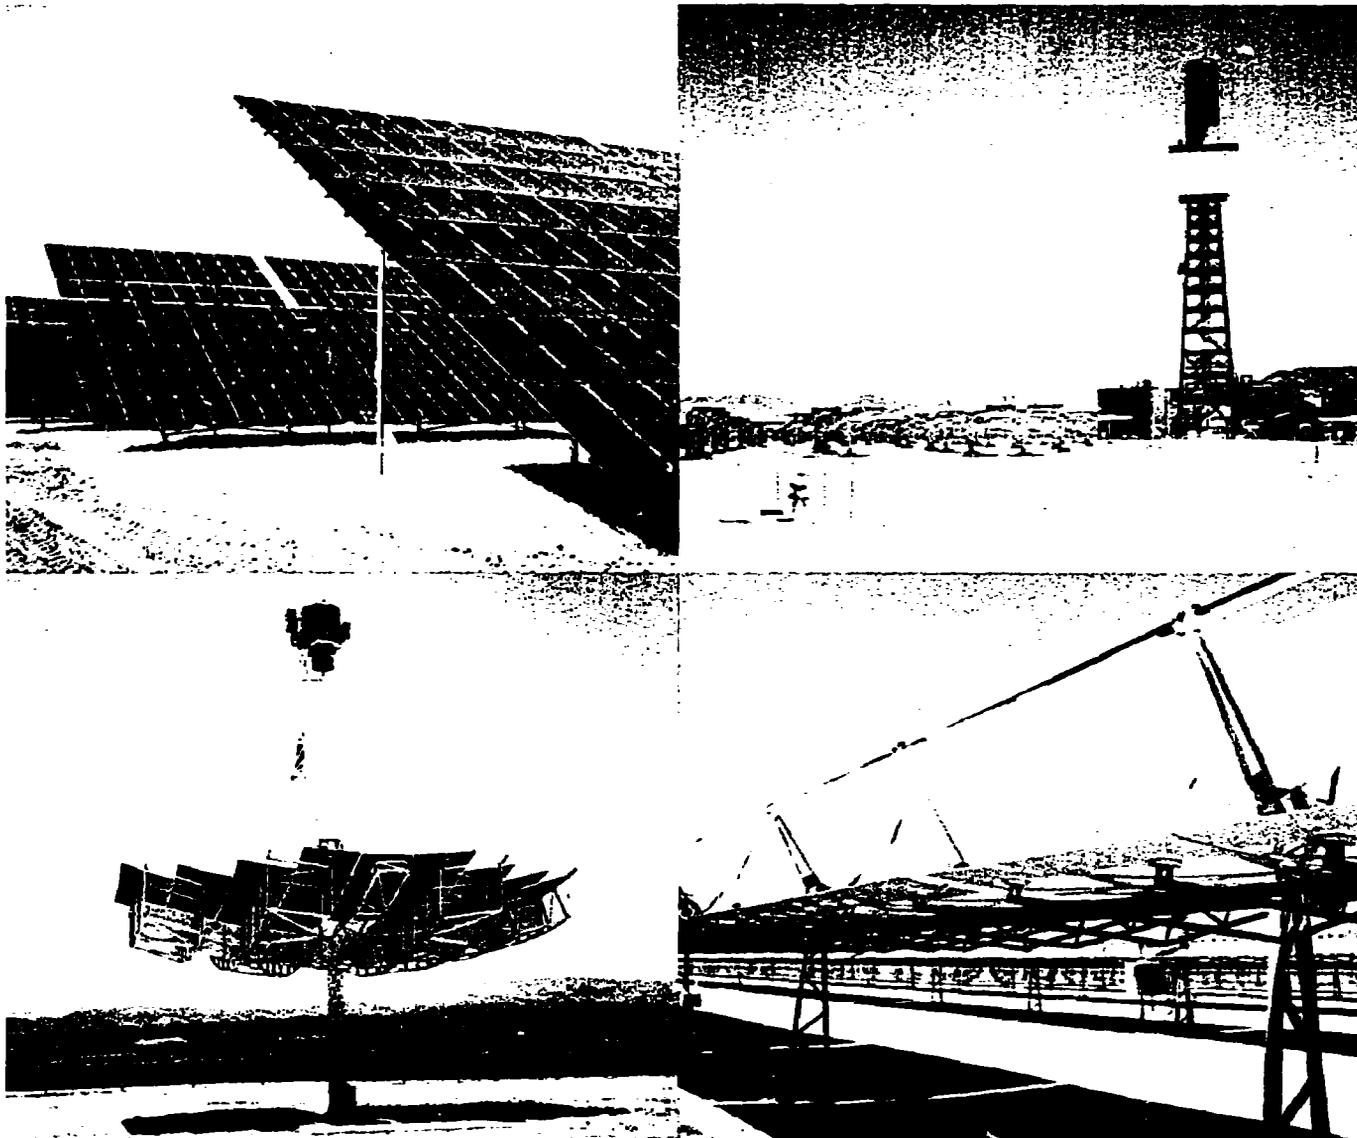

Public Disclosure Authorized

Public Disclosure Authorized

RECENT WORLD BANK TECHNICAL PAPERS

- No. 170 Sung and Troia, *Developments in Debt Conversion Programs and Conversion Activities*
- No. 171 Brown and Nooter, *Successful Small-Scale Irrigation in the Sahel*
- No. 172 Thomas and Shaw, *Issues in the Development of Multigrade Schools*
- No. 173 Byrnes, *Water Users Association in World Bank-Assisted Irrigation Projects in Pakistan*
- No. 174 Constant and Sheldrick, *World Nitrogen Survey*
- No. 175 Le Moigne and others, editors, *Country Experiences with Water Resources Management: Economic, Institutional, Technological and Environmental Issues*
- No. 176 The World Bank/FAO/UNIDO/Industry Fertilizer Working Group, *World and Regional Supply and Demand Balances for Nitrogen, Phosphate, and Potash, 1990/91–1996/97*
- No. 177 Adams, *The World Bank's Treatment of Employment and Labor Market Issues*
- No. 178 Le Moigne, Barghouti, and Garbus, editors, *Developing and Improving Irrigation and Drainage Systems: Selected Papers from World Bank Seminars*
- No. 179 Speirs and Olsen, *Indigenous Integrated Farming Systems in the Sahel*
- No. 180 Barghouti, Garbus, and Umali, editors, *Trends in Agricultural Diversification: Regional Perspectives*
- No. 181 Mining Unit, Industry and Energy Division, *Strategy for African Mining*
- No. 182 Land Resources Unit, Asia Technical Department, *Strategy for Forest Sector Development in Asia*
- No. 183 Nájera, Liese, and Hammer, *Malaria: New Patterns and Perspectives*
- No. 184 Crosson and Anderson, *Resources and Global Food Prospects: Supply and Demand for Cereals to 2030*
- No. 185 Frederiksen, *Drought Planning and Water Efficiency Implications in Water Resources Management*
- No. 186 Guislain, *Divestiture of State Enterprises: An Overview of the Legal Framework*
- No. 187 De Geyndt, Zhao, and Liu, *From Barefoot Doctor to Village Doctor in Rural China*
- No. 188 Silverman, *Public Sector Decentralization: Economic Policy and Sector Investment Programs*
- No. 189 Frederick, *Balancing Water Demands with Supplies: The Role of Management in a World of Increasing Scarcity*
- No. 190 Macklin, *Agricultural Extension in India*
- No. 191 Frederiksen, *Water Resources Institutions: Some Principles and Practices*
- No. 192 McMillan, Painter, and Scudder, *Settlement and Development in the River Blindness Control Zone*
- No. 193 Braatz, *Conserving Biological Diversity: A Strategy for Protected Areas in the Asia-Pacific Region*
- No. 194 Saint, *Universities in Africa: Strategies for Stabilization and Revitalization*
- No. 195 Ochs and Bishay, *Drainage Guidelines*
- No. 196 Mabogunje, *Perspective on Urban Land and Land Management Policies in Sub-Saharan Africa*
- No. 197 Zymelman, editor, *Assessing Engineering Education in Sub-Saharan Africa*
- No. 198 Teerink and Nakashima, *Water Allocation, Rights, and Pricing: Examples from Japan and the United States*
- No. 199 Hussi, Murphy, Lindberg, and Brenneman, *The Development of Cooperatives and Other Rural Organizations: The Role of the World Bank*
- No. 200 McMillan, Nana, and Savadogo, *Settlement and Development in the River Blindness Control Zone: Case Study Burkina Faso*
- No. 201 Van Tuijl, *Improving Water Use in Agriculture: Experiences in the Middle East and North Africa*
- No. 202 Vergara, *The Materials Revolution: What Does It Mean for Developing Asia?*
- No. 203 Cleaver, *A Strategy to Develop Agriculture in Sub-Saharan Africa and a Focus for the World Bank*
- No. 204 Barghouti, Cromwell, and Pritchard, editors, *Agricultural Technologies for Market-Led Development Opportunities in the 1990s*

(List continues on the inside back cover)

Renewable Energy Technologies

A Review of the Status and Costs of Selected Technologies

Kulsum Ahmed

with an overview by Dennis Anderson and Kulsum Ahmed

**The World Bank
Washington, D.C.**

Copyright © 1994
The International Bank for Reconstruction
and Development / THE WORLD BANK
1818 H Street, N.W.
Washington, D.C. 20433, U.S.A.

All rights reserved
Manufactured in the United States of America
First printing January 1994

Technical Papers are published to communicate the results of the Bank's work to the development community with the least possible delay. The typescript of this paper therefore has not been prepared in accordance with the procedures appropriate to formal printed texts, and the World Bank accepts no responsibility for errors. Some sources cited in this paper may be informal documents that are not readily available.

The findings, interpretations, and conclusions expressed in this paper are entirely those of the author(s) and should not be attributed in any manner to the World Bank, to its affiliated organizations, or to members of its Board of Executive Directors or the countries they represent. The World Bank does not guarantee the accuracy of the data included in this publication and accepts no responsibility whatsoever for any consequence of their use. The boundaries, colors, denominations, and other information shown on any map in this volume do not imply on the part of the World Bank Group any judgment on the legal status of any territory or the endorsement or acceptance of such boundaries.

The material in this publication is copyrighted. Requests for permission to reproduce portions of it should be sent to the Office of the Publisher at the address shown in the copyright notice above. The World Bank encourages dissemination of its work and will normally give permission promptly and, when the reproduction is for noncommercial purposes, without asking a fee. Permission to copy portions for classroom use is granted through the Copyright Clearance Center, Inc., Suite 910, 222 Rosewood Drive, Danvers, Massachusetts 01923, U.S.A.

The complete backlist of publications from the World Bank is shown in the annual *Index of Publications*, which contains an alphabetical title list (with full ordering information) and indexes of subjects, authors, and countries and regions. The latest edition is available free of charge from the Distribution Unit, Office of the Publisher, The World Bank, 1818 H Street, N.W., Washington, D.C. 20433, U.S.A., or from Publications, The World Bank, 66, avenue d'Iéna, 75116 Paris, France.

Cover photos (clockwise from top right-hand corner): (1) Central receiver tower and heliostat field at Solar One, a 10-MW solar-thermal plant in the Mojave Desert, California, now under conversion to Solar Two, a central receiver plant with storage capabilities. (2) Solar-thermal parabolic trough collectors at a Solar Electric Generating Systems (SEGS) plant in Kramer Junction, California. Nine SEGS plants, with a total capacity of 354 MW, are operating in Southern California. (3) A prototype 7.5 kW solar-thermal parabolic dish-Stirling engine near Barstow, California. (4) Photovoltaic arrays at the PVUSA site in Davis, California.

Credits: Kulsum Ahmed (1,3, and 4); Said R. Mikhail (2).

ISSN: 0253-7494

Kulsum Ahmed is a consultant with the Global Environmental Facility.

Library of Congress Cataloging-in-Publication Data

Ahmed, Kulsum, 1964-

Renewable energy technologies : a review of the status and costs of selected technologies / Kulsum Ahmed ; with an overview by Dennis Anderson and Kulsum Ahmed.

p. cm. — (World Bank technical paper, ISSN 0253-7494 ; no. 240. Energy series)

Includes bibliographical references.

ISBN 0-8213-2744-5

1. Renewable energy sources—Costs. I. Anderson, Dennis, 1942-

II. Title. III. Series: World Bank technical paper ; no. 240.

IV. Series: World Bank technical paper. Energy series.

TJ808.A44 1994

333.79'4—dc20

93-46726
CIP

Contents

Foreword	vii
Abstract	ix
Acknowledgements	x
Abbreviations and Acronyms	xi
1. Overview	1
Introduction	1
Findings	2
The Costs of Ethanol from Biomass	2
The Costs of Electricity from Biomass	3
Solar-Thermal Technologies for Power Generation	4
Photovoltaics	5
Wind	6
Conclusions and Implications	6
2. Biomass Energy	9
Introduction	9
Formation of Biomass	10
Energy from Biomass	12
Liquid Fuels from Biomass	12
Electricity from Biomass	13
Environmental Effects	14
The Cost of Biomass Energy	15
Cost of Liquid Fuel Production from Biomass	15
Cost of Electricity from Biomass	22
The Future of Biomass Energy	29
3. Solar-Thermal	31
Introduction	31
Solar-Thermal Electric Technologies	34
Parabolic Trough	34
Parabolic Dish	35

Central Receiver	36
Cost of Electricity Generation from Solar-Thermal Electric Technologies	37
Cost of Electricity Generation from Parabolic Trough Solar-Thermal Technology	38
Cost of Electricity from Parabolic Dish Solar-Thermal Technology	41
Cost of Electricity Generation from Central Receiver Solar-Thermal Technology	42
The Future of Solar-Thermal Electric Energy	46
4. Photovoltaics	47
Introduction	47
Photovoltaic Manufacturing and Technology	49
Efficiency	49
Crystalline Silicon Solar Cells ("Thick" Film)	59
Thin-Film Solar Cells	60
Concentrator Solar Cells	62
Environmental Effects	63
The Cost of Photovoltaic Power	64
Costs in Detail	68
Module Costs	68
Balance-of-System Costs	73
Cost of Photovoltaic Electricity	76
The Future of Photovoltaics	80
Bibliography	81
Annexes	89
Annex 1. Cost Calculations and Currency Adjustments	91
Annex 2. Costs of Ethanol Production	93
Annex 3. Costs of Electricity from Biomass	101
Annex 4. Land Requirements for Power Stations	111
Annex 5. The Luz Experience	113

Annex 6.	Calculated Cost of Electricity from Solar-Thermal Technologies	115
Annex 7.	The Photovoltaic Effect	121
Annex 8.	Cost of Electricity from Photovoltaic Systems	123
Annex 9.	PV Efficiencies	153
Annex 10.	Photovoltaic Module Costs	159

Tables

Table 2.1.	Power Generation in the United States by Type of Biomass	24
Table 2.2.	Capital Costs for Large-Scale (>20 MW) Biomass Energy Plants	28
Table 3.1.	Capital Costs of Central Receiver Plants	43
Table 3.2.	Comparison of Two Estimates for a Large-Scale Central Receiver Plant	45
Table 4.1.	The Operating Experience of Large PV Systems	67
Table 4.2.	Balance-of-System Costs for Photovoltaic Systems	75

Figures

Figure 1.1.	Cost of Ethanol Production Compared with Gasoline Prices, 1977–2020	2
Figure 1.2.	Cost of Electricity from Biomass, 1985–2000	3
Figure 1.3.	Calculated Cost of Electricity from Large-Scale Solar-Thermal Technologies. 1986–2010	4
Figure 1.4.	Costs of Photovoltaic Modules, 1972–2010	5
Figure 1.5.	Cost of Electricity from Wind Turbines in California, 1985–1995	7
Figure 2.1.	Energy from Biomass	9
Figure 2.2.	Sources of Energy in Developing Countries, 1987	10
Figure 2.3.	Cost of Ethanol Production from Different Raw Materials	17
Figure 2.4.	Cost of Ethanol Production from Cellulosic Material Using Different Hydrolytic Processes	18
Figure 2.5.	Cost of Ethanol Production Compared with Gasoline Prices	19
Figure 2.6.	Formation of Ethanol (Simplified Scheme)	21
Figure 2.7.	Cost of Electricity from Biomass	25
Figure 2.8.	Cost of Electricity from Biomass (Operating Facilities versus Engineering Studies and Projections)	26

Figure 2.9.	Cost of Electricity from Biomass (Large- versus Small-Scale Plants)	27
Figure 3.1.	Land Requirements for a Biomass Plantation, Solar-Thermal Plants, the PV Array Areas of Existing Solar Plants Compared with the Inundated Area of Hydroplants	33
Figure 3.2.	Concentrator and Receiver Systems for Solar-Thermal Electric Technologies	34
Figure 3.3.	Calculated Cost of Electricity from Large-Scale Solar-Thermal Technology	39
Figure 3.4.	Calculated Cost of Electricity from Parabolic Trough Solar-Thermal Technology	40
Figure 3.5.	Calculated Cost of Electricity from Parabolic Dish Solar-Thermal Technology	41
Figure 3.6.	Calculated Cost of Electricity from Central Receiver Solar-Thermal Technology	42
Figure 3.7.	Capital Costs of Central Receiver Solar-Thermal Plants	44
Figure 3.8.	Load Dispatching Capability of Central Receiver Plants	45
Figure 4.1.	Global Photovoltaic Market, 1976-1992	48
Figure 4.2.	Efficiencies of Crystalline Silicon Cells and Modules	51
Figure 4.3.	Efficiencies of Amorphous Silicon Cells and Modules	52
Figure 4.4.	Efficiencies of Cadmium Telluride (CdTe) Cells and Modules	53
Figure 4.5.	Efficiencies of Copper Indium Diselenide (CIS) Cells and Modules	54
Figure 4.6.	Efficiencies of Gallium Arsenide (GaAs) Cells and Modules	55
Figure 4.7.	Efficiencies of Photovoltaic Cells and Modules	56
Figure 4.8.	Variety in Photovoltaic Cells and Manufacturing Processes	58
Figure 4.9.	System Efficiencies	66
Figure 4.10.	Photovoltaic Module Costs by Size of Order	69
Figure 4.11.	Photovoltaic Module Costs for Small Orders	70
Figure 4.12.	Photovoltaic Module Costs for Large Orders	71
Figure 4.13.	Photovoltaic Module Costs for Unspecified Order Sizes	72
Figure 4.14.	Cost of Electricity from Photovoltaics	77
Figure 4.15.	Cost of Electricity from Photovoltaics (Remote and Grid-Attached Generation)	78


Foreword

Major technical advances in recent years have led to improvements in efficiency of renewable energy technologies and reductions in costs. These developments, the establishment of the Global Environment Facility in 1991, and the World Bank's operational initiatives on environmentally sustainable development are providing new opportunities for the finance of renewable energy investments.

This is the first in a series of reports on renewables. It reviews the cost and status of renewable energy technologies, concentrating on the use of biomass for fuel and electricity, solar-thermal technologies, and photovoltaics. Parallel studies currently under way in the Bank include one on costs and markets and others reporting on operating experience with renewable energy technologies in various countries and regions.

These studies reflect the growing interest of the World Bank Group in renewable energy technologies. There are three reasons for this interest. First, from an economic point of view, renewables have good prospects of giving good returns to investment, and indeed they are already economically attractive for an increasing number of small-scale applications. With further development, large-scale applications should follow. That renewables generally have short lead times is another economically attractive feature. Second, as many have noted, solar schemes in particular are environmentally attractive. Third, renewable energy technologies are well-suited to the circumstances of developing countries. For example, because most developing countries are in tropical or subtropical regions, their levels of incident solar energy per square kilometer are twice the levels found in many industrial countries; moreover, the day-to-day quality of the insolation is superior, and seasonal variations are less.

This report is also among the first in a new Energy Series within the ongoing World Bank technical papers volumes. The new Energy Series technical papers will replace the Industry and Energy Department's "pink" series energy working papers. We are making this shift to take advantage of the World Bank's global distribution network for what we believe will be publications of significance and widespread interest.



Richard Stern
Director
Industry and Energy Department

Abstract

This paper examines the evidence on the historic and projected costs of selected renewable energy technologies and assesses developments. It reviews estimates of more than 50 studies and expresses the costs on a common basis for photovoltaics, solar-thermal, and biomass for liquid fuels and electricity production.

Findings show that there has been a decline in the cost of ethanol production since the 1970s, attributable to technology improvements and a shift toward cheaper crops. The technology developments to convert low-cost cellulosic materials to ethanol promise further reductions in cost.

The costs of electricity from biomass show great variability. Costs are site-specific and vary with raw material costs but still compare well with the costs of fossil-fired generation and even hydro generation in favorable situations.

Costs of electricity from solar-thermal technologies show much variability because—with the notable exception of the parabolic trough technology—all are in the experimental stage. However, experience to date and engineering analysis both point consistently to costs in the 5 to 10 cents per kilowatt hour range in the next generation of schemes. Furthermore, the possibilities for low-cost storage, high conversion efficiencies, and short lead times make this an attractive option.

Costs of photovoltaic modules have decreased by a factor of 10 over the past fifteen years and by more than 50 since the early 1970s. The possibilities for further cost reduction are far from being exhausted. Key developments with concentrator cells and multijunction devices, commercialization of new thin-film devices, and introduction of batch production processes in manufacturing promise further reductions.

Acknowledgments

I would like to thank a number of people for their assistance. Several people provided a great deal of helpful information: Robin Bates, Willem Floor, Edwin Moore, Malcolm Bale, Robert van der Plas, and Loretta Schaeffer and the Asia Technical Alternative Energy Unit (to whom special thanks are also due for their assistance in reviewing this report). Paul Wolman edited the report and refined its design, and Carole-Sue Castronuovo devoted much hard work to putting the draft into a presentable format. Finally, I wish to thank the Global Environment Facility for commissioning this study, and Ian Johnson and Dennis Anderson for their support and encouragement.

Abbreviations and Acronyms

AC	alternating current
BAU	business as usual
BOS	balance of system
CdTe	cadmium telluride
CENAL	Executive Secretariat of the National Alcohol Commission
CIS	copper indium diselenide
CO₂	carbon dioxide
DC	direct current
DM	deutsche mark
DOE	Department of Energy
EC	European Community
ECU	European Currency Unit
EPRI TAG	Electric Power Research Institute Technical Assessment Guide
ESMAP	Energy Sector Management Assistance Programme
eV	electron volts
GaAs	gallium arsenide
GEF	Global Environment Facility
GJ	gigajoules or 1,000,000,000 joules
GWh	gigawatt-hour (1,000,000 kilowatt-hours)
ha	hectare (= 0.01 square kilometers)
kW/m²	kilowatts per square meter
kWh	kilowatt-hours
kWp	peak kilowatt
MilBtu	million British Thermal Units
MW	megawatt
MWp	peak megawatt
NO_x	oxides of nitrogen
O&M	operating and maintenance

ORNL	Oak Ridge National Laboratory
PEICCE	Proyecto Energético Istmo Centroamericano
PURPA	Public Utility Regulatory Policies Act
PV	photovoltaic
R&D	research and development
R, D & D	research, development and demonstration
Rs.	rupees
SERI	Solar Electric Research Institute
SRWC	short rotation woody crop
sun	unit used to describe the intensity of illumination on a PV cell, defined as the solar radiation incident on the cell divided by the solar radiation that would be incident on the cell under "one standard sun" (i.e., under sunlight with a total intensity of 1 kW/m² and a standard spectrum).
TCD	tons cane per day
TOE	ton of oil equivalent
ton	1,000 kilograms
U.S.	United States
W_p	peak watts

1

Overview

Introduction

Several studies have reported significant declines in the unit costs of renewable energy technologies over the past two decades—in photovoltaics, solar-thermal, wind, and the use of biomass for producing electricity and liquid fuels—and it is now clear that further reductions in costs can be expected with technical progress and market growth.¹ Changes in relative costs are beginning to alter the comparative economics of the production of energy from fossil, nuclear, and renewable resources in important ways.

This paper examines the evidence on the historic and projected costs of selected renewable energy technologies and assesses developments. It reviews estimates from more than 50 studies and expresses the costs on a common basis. There are many excellent studies available, and those familiar with them will also be familiar with the results presented here. On reviewing the material, we found that it frequently estimated costs in different ways, used different discount rates, and included or excluded particular components of cost. Moreover, some of the works were tabletop studies, whereas others used actual costs and commercial data. Hence, to assess how costs are actually changing and to assess prospects for further developments, we tried to iron out these inconsistencies. It was not possible to do this completely in every case, and some inconsistencies and ambiguities in the costs remain, but the uncertainties, we think, have been reduced, and the trends are fairly clear. Yet even when this is done, unit costs differ appreciably because they relate to different technologies in different stages of development, as would be expected for newly emerging technologies and when the competition among approaches is both intense and economically healthy.

This paper was prepared for the Global Environment Facility (GEF), as an input to its inquiries on cost-effective options for abating emissions of carbon dioxide. It concentrates on three types of renewable energy: photovoltaics, solar-thermal, and the use

1. This overview was written by Dennis Anderson, adviser, Industry and Energy Department, and Kulsum Ahmed.

of biomass for producing electricity and liquid fuels. Developments of other renewables, such as wind and ocean systems, also have been notable but are left for a separate study. Brief descriptions and analyses of the various technologies are provided, but these, it should be noted, are no substitute for the excellent and encyclopedic edition of studies, *Renewable Energy: Sources for Fuel and Electricity* (Johansson and others 1993).


Costs have been calculated in 1990 prices. All relevant data, assumptions, and sources are tabulated in the annexes. The estimates presented below are actual figures up to 1992 and projections thereafter.

Findings

The Costs of Ethanol from Biomass

Figure 1.1 summarizes the main findings. The data, mostly from Brazil and the United States, show the costs of ethanol production from different raw materials—corn, sugarcane, and cellulosic materials—compared with the ex-refinery costs of gasoline. The large variance in costs is mainly caused by the differing costs of the raw materials, which account for 60 to 80 percent of total costs.

Figure 1.1. Cost of Ethanol Production Compared with Gasoline Prices, 1977–2020

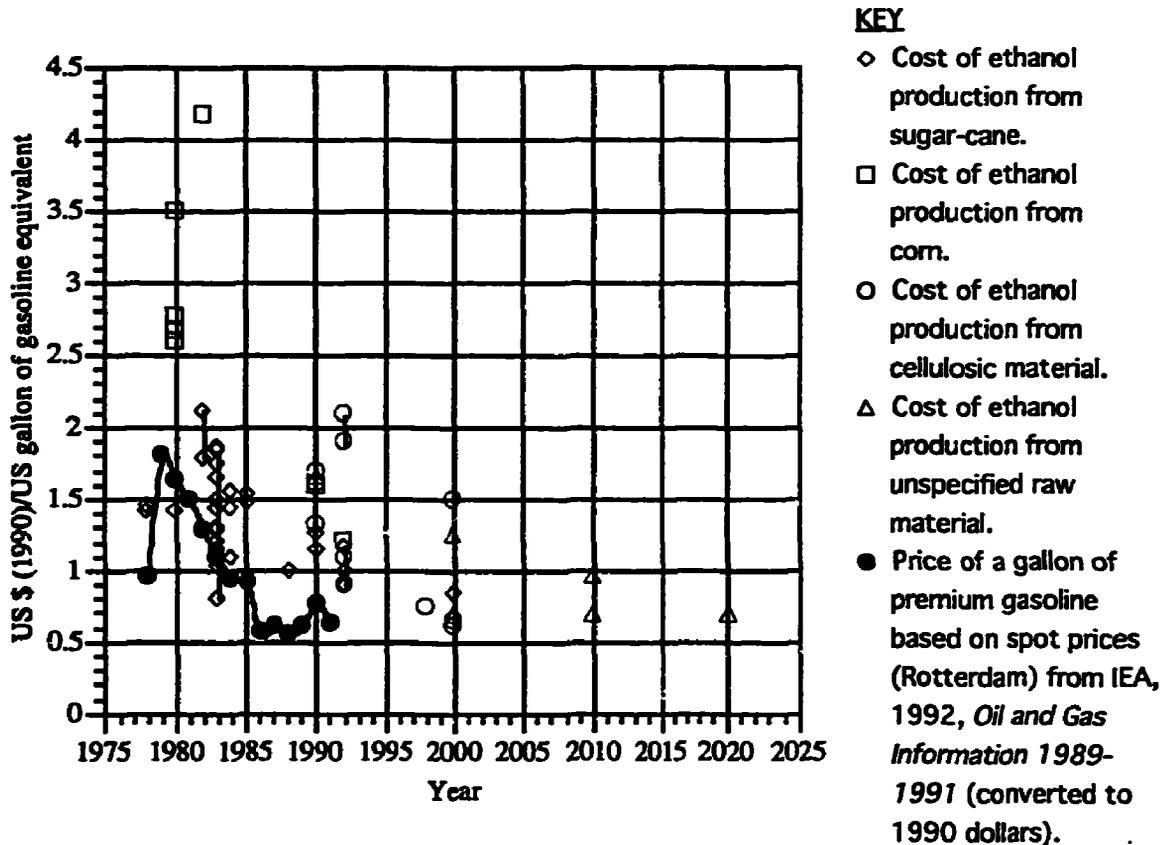


The decline in costs since the 1970s has been significant and is attributable to technology improvements and a shift toward cheaper crops. The outliers in the 1970s were corn crops in the United States, the costs of ethanol from sugarcane in Brazil being much lower; but costs have since declined for both types of material. The recent emergence of low-cost cellulosic materials—woody materials and agricultural residues—for ethanol production has been made possible by advances in biotechnology for converting the sugars in the materials to ethanol, and these advances promise further reductions in costs. Cellulosic materials have the advantage of not competing with food crops for land, which also helps to reduce costs. The costs of ethanol were beginning to compare well with gasoline until the collapse of oil prices in the mid-1980s.

The Costs of Electricity from Biomass

The costs of electricity from biomass show great variability, even for cogeneration plants using waste materials and residues. The boiler and generator technologies now in use are standard, have been used for many decades, and have seen no obvious decline in costs in recent years. Costs are site specific and vary with raw material costs; but, as Figure 1.2 shows, they compare well with the costs of fossil-fired generation and even hydro generation in favorable situations; some are as low as 2 to 4 cents per kilowatt hour.

Figure 1.2. Cost of Electricity from Biomass, 1985–2000

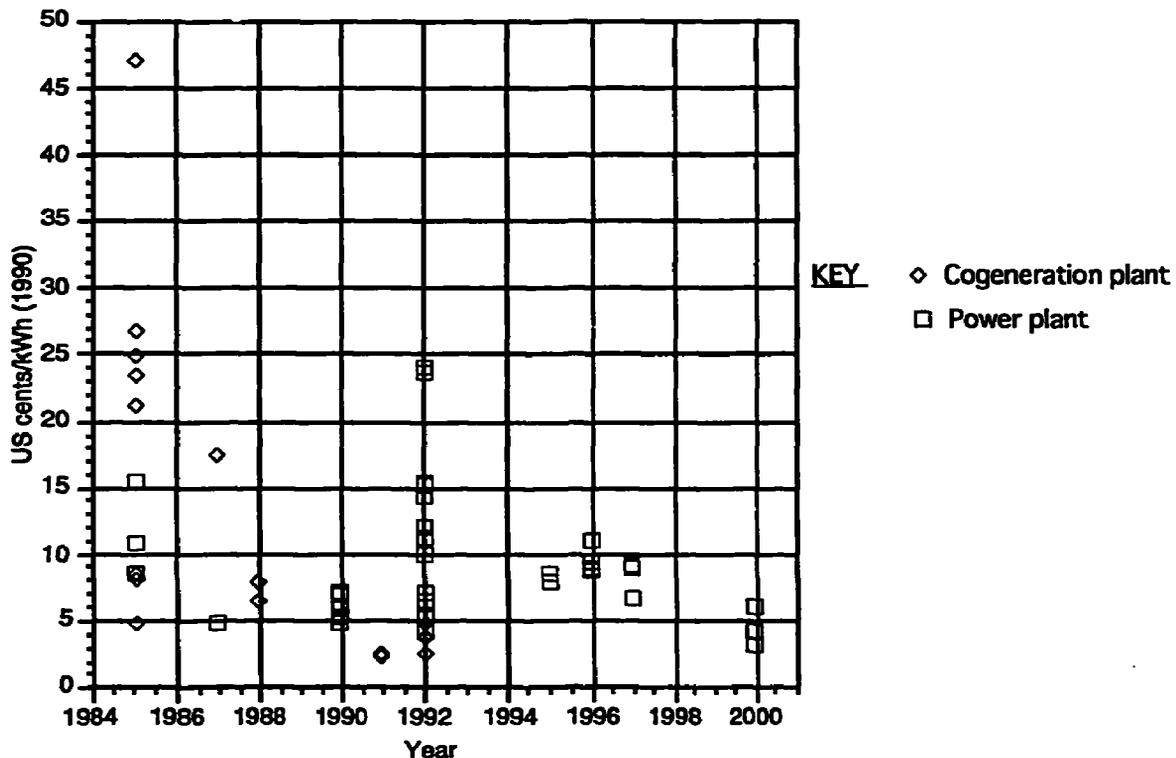


The recent proposals to use biomass gasification combined-cycle technologies show much promise for reducing costs for large-scale power generation—again in areas where wood yields are good. Another much-discussed way of reducing net costs (not studied here) is to use the schemes where they can serve more than one purpose, such as reforestation, restoration of degraded land, protection of watersheds, and generation of electricity.

Solar-Thermal Technologies for Power Generation

Recent experience with solar-thermal dates back only to the mid-1980s. Costs show much variability because—with the notable exception of the parabolic trough technology—all are in the experimental stage. Figure 1.3 shows the current and projected costs of generation from the three main technologies for larger-scale generation of about 50 MW and upward—parabolic trough, central receiver, and parabolic dish. Experience to date and engineering analysis both point consistently to costs in the 5 to 10 cents per kilowatt hour range in the next generation of schemes.

Figure 1.3. Calculated Cost of Electricity from Large-Scale Solar-Thermal Technologies, 1986–2010

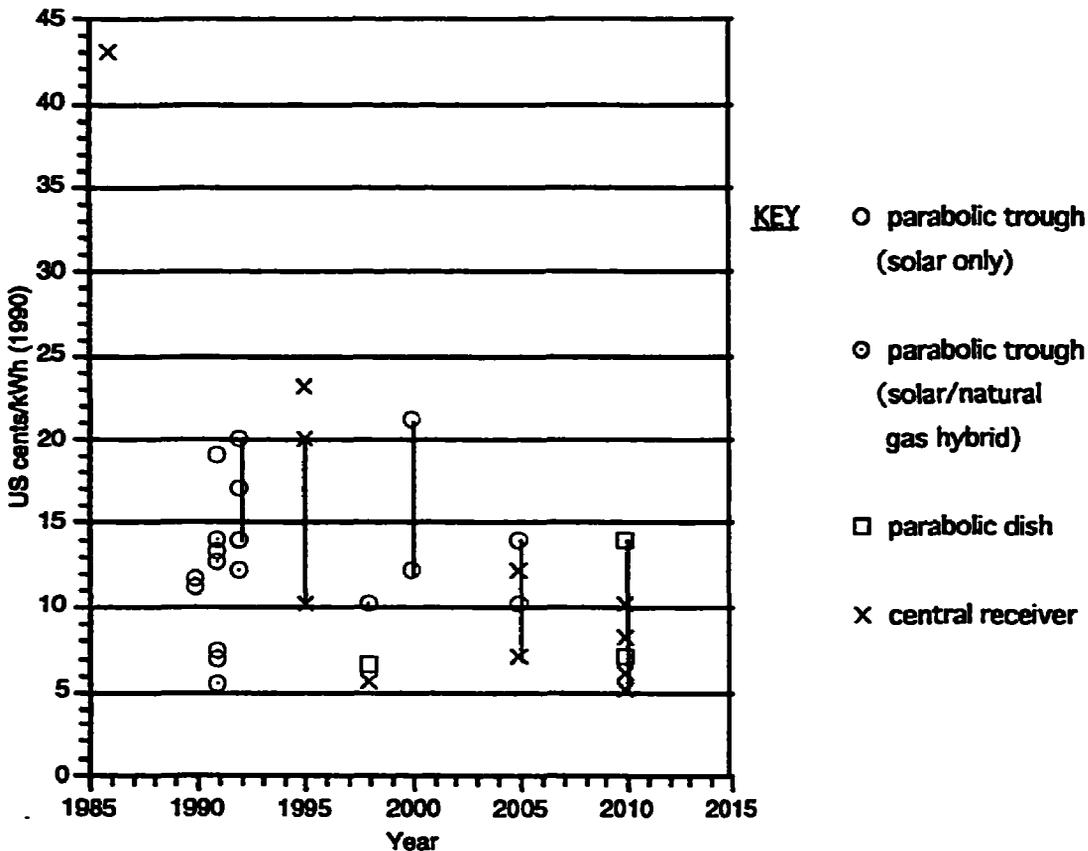


Three other factors deserve special mention: the possibilities for low-cost thermal storage, so schemes can be operated in the evenings or on cloudy days; the high temperatures of the central receiver technologies now being tested, which promise high conversion efficiencies; and short lead times for construction and installation (recent parabolic trough schemes in California were installed and operating within a year).

Photovoltaics

Costs of photovoltaic modules have decreased by a factor of 10 over the past 15 years and by more than 50 since the early 1970s (Figure 1.4). The dispersion in the cost data shown in the figure reflects the wide range of modules now under development; the size of the consumer's order also has an effect on unit costs. The general decrease in costs is clear from the data and can be attributed to technical progress in materials, to cell design and manufacturing methods, and to scale economies in manufacturing and gains in PV production experience. Large gains have also been made in conversion efficiencies, from about 7 percent for crystalline silicon modules in 1976 to 13 percent today. For amorphous silicon, stabilized efficiencies of monojunctional laboratory cells rose from less than 1 percent to more than 6 percent in the same period.

Figure 1.4. Costs of Photovoltaic Modules, 1972–2010

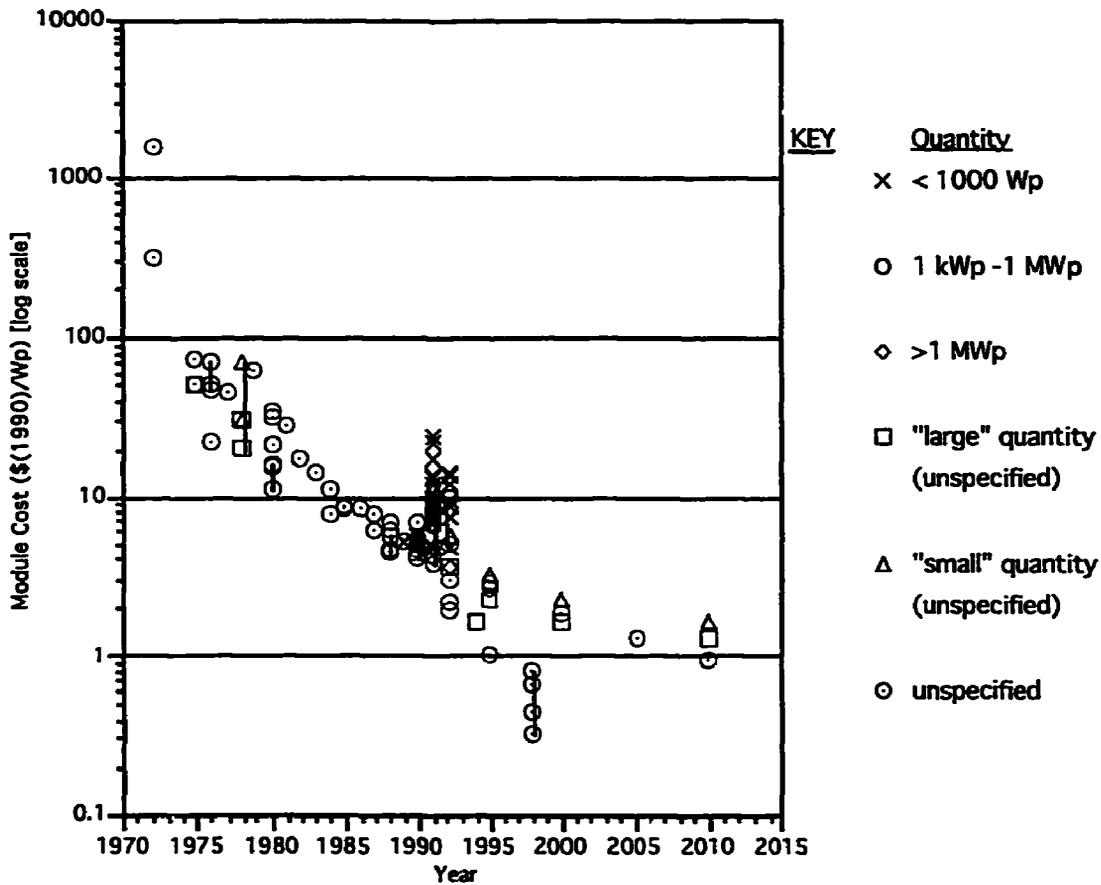

The possibilities for reducing costs further are far from being exhausted. The following are among the key developments taking place:

- The use of multijunction devices to improve conversion efficiencies
- Further developments in concentrator cells (already achieving efficiencies of more than 28 percent with crystalline silicon and 27 to 30 percent with gallium arsenide)
- New materials for thin-film devices, now ready for commercial production
- Improvements in cell design to improve photon capture and reduce resistive losses
- Introduction of batch production processes in manufacturing, which should also lead to significant scale economies.

The world market for PVs is still small, having increased from less than 1 MW in 1978 to 57.9 MW in 1992, and it is generally expected that the above developments will tend to appreciable reductions in costs as the market expands further and manufacturers move to larger production volumes. Numerous small-scale applications are now economical (see chapter 4).

Wind


Wind energy technologies are not reviewed here, but their costs fall into the same pattern as that for the other renewable energy technologies discussed, and for much the same reasons—technical progress in the design of the machines, short lead times, and scale economies in manufacture. Costs have declined to the range of 6 to 10 cents per kWh in the past eight years, and wind turbines are becoming established as a commercial source of supplementary power in areas with favorable wind regimes. Figure 1.5 shows some data for California, taken from Cavallo, Hock, and Smith (1993), who project costs in the 4 to cents per kilowatt hour range with the new generation of technologies. Offshore systems are also under development.

Conclusions and Implications

Progress in renewable energy technologies has been positive; the reported reductions in costs, improvements in conversion efficiencies, and technical progress in manufacturing are all well founded, and there are convincing engineering-economic reasons for expecting efficiencies to improve and costs to fall further. By financing applications of renewables in electricity generation, the GEF and the World Bank will help to develop markets, reduce costs, and demonstrate the technologies.

The applications are likely to be on a small scale in the near term, although with “bundling” the potential applications are sufficiently numerous that large-scale *programs* could be formulated. Solar-thermal would be suitable for larger-scale generation already if there were a greater commitment to its development and application in national R&D and demonstration programs.

Figure 1.5. Cost of Electricity from Wind Turbines in California, 1985–1995

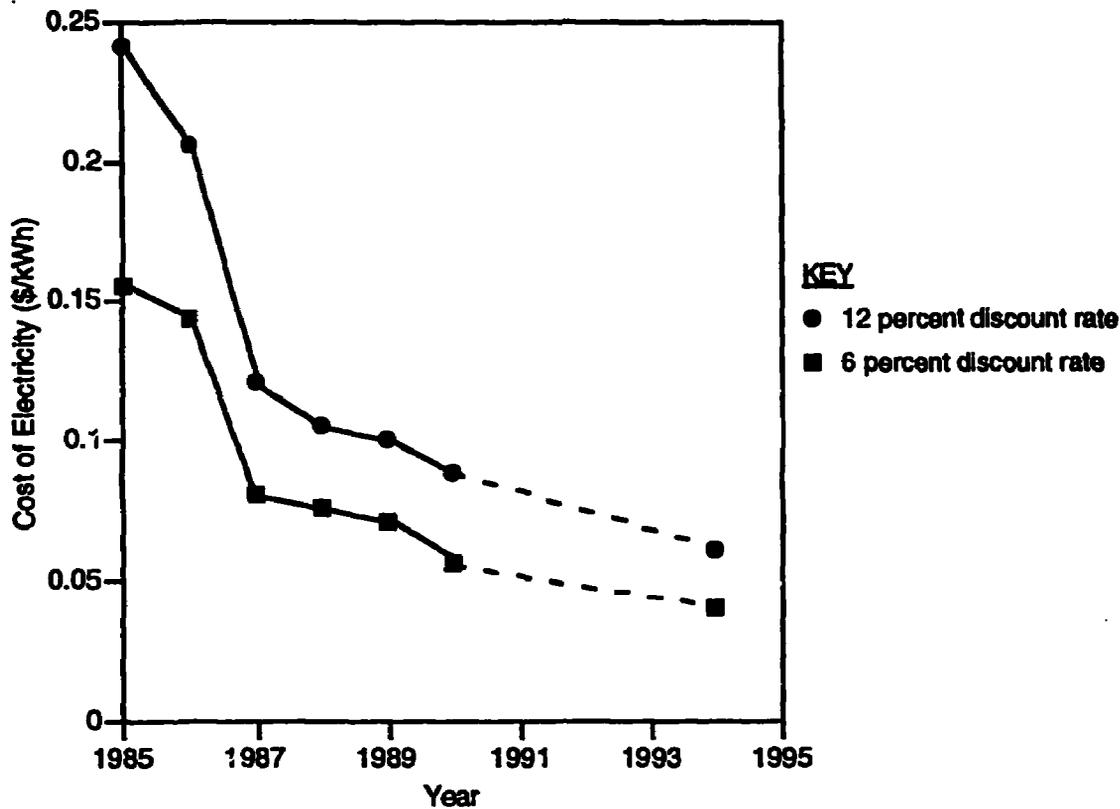

Source: Cavallo, Hock, and Smith (1993)

Specific types of investments that can be recommended confidently on the basis of this review include the following:

- *Expanded use of PVs for small-scale applications in high-insolation areas.* For many purposes they are already the least-cost option. Costs and performance compare well with diesel generation, for example, and sometimes with grid-supplied electricity in rural areas, depending on the community's distance from the grid.
- *Use of PVs to provide supplementary power on grid-connected distribution systems, if the peak load matches solar insolation.* (Wind energy, which is not reviewed below, also shows much promise for this purpose and could also be a good complement to existing hydro schemes.)
- *Expanded use of thermal-solar schemes for power generation on pilot basis.* A series of 100 to 200 MW of pilot projects in selected countries, financed on a concessionary basis, and perhaps built and operated under collaborative international arrangements, would do much to establish the technology. It is already competitive with nuclear energy, and prospectively with hydro energy.

- *Use of biomass for power generation.* Modeled on the forthcoming GEF project in Brazil, this type of activity is another promising area of investment.²

Costs considered in this review are hardware costs. In the comparisons of costs with conventional energy sources at a particular site, four factors are especially important to bear in mind.³ First, since markets are still small, transaction costs tend to be a large component of overall costs. These include the installation, operational, and learning costs of setting up and using a technology for the first time and of providing customer services. The GEF is to make a special study of this problem. The general assessment, however, is that these costs will decline appreciably as markets increase.

Second, scale economies and the gains from technical progress as applications increase are likely to be large during the next two decades. This means that marginal costs will be much less than average costs, and there is a good case for public policies to support the development and use of the technologies through tax incentives, financial support through public R&D programs, and other financial facilities such as the GEF. It is in fact remarkable how much has been accomplished over the past two decades, given the limited financial support for renewables. In the industrial countries, solar energy receives minuscule funding compared with fossil and nuclear technologies (about 5 percent of public R&D in energy), despite its promise.

Third, the analysis of investments needs to take into account the environmental costs and benefits of the technologies.

Fourth, attention will need to be given to deformities in energy prices. The sad fact is that the "playing field is not level" when it comes to competition between renewables and conventional fuels. Aside from the distortions just noted in public R&D policies, two further examples will suffice to make the point. One is the absence of peak-load pricing for electricity. The costs of meeting peak demands are two to three times those of meeting base-load demands in many countries. Peak-load costs are about 15 to 20 cents per kilowatt hour, depending on the system and the patterns of demand, compared with average costs of about 5 to 8 cents per kilowatt hour (for a base-load plant). The adoption of peak-load pricing would provide a significant stimulus to the development of short-term storage technologies for solar energy. The other example is rural electrification, which is widely subsidized, again making it difficult for the renewable energy alternatives (and PVs in particular) to compete in applications for which they would otherwise be, for consumers, the financially more attractive alternative. Removing such distortions in public policy will do much to facilitate the development and use of renewable energy.

2. Further information on this and other Global Environment Facility projects can be found in the *its Reports of the Chairman* (various dates).

3. These factors are discussed further in relation to the use of GEF funds in Anderson and Williams (1993).


2

Biomass Energy

Introduction

Biomass is the term used to describe all plant-derived material. It may be used to generate energy by direct combustion or by conversion to either a liquid or a gaseous fuel. Plant materials use the sun's energy to convert atmospheric carbon dioxide to sugars during photosynthesis. On combustion of the biomass, energy is released as the sugars are converted back to carbon dioxide.


Figure 2.1. Energy from Biomass

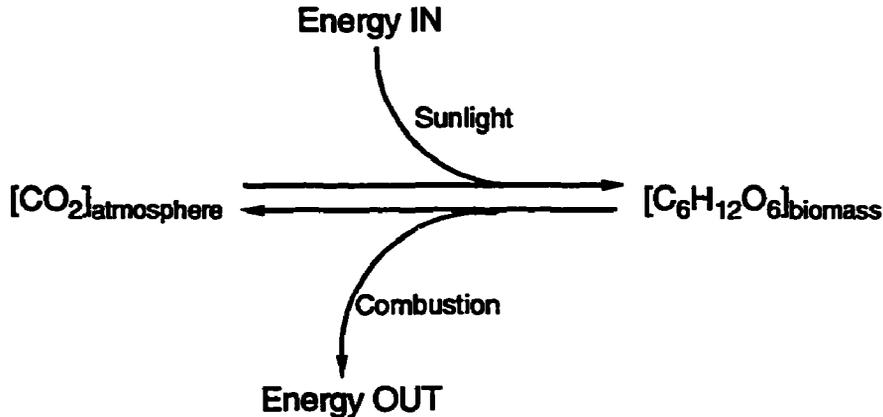

Thus, energy is harnessed and released in a short time frame, making biomass energy a renewable energy source. Fossil fuels have also ultimately been derived from atmospheric carbon dioxide, as they are degraded residues of plant and animal sources. However, the time frame is very long—in the order of millions of years rather than a few years, as in the case of biomass.

Biomass has been used as a source of energy for centuries, and even today is the major type of energy source in the developing world. As is illustrated in Figure 2.2, biomass forms 35 percent of total sources of energy in developing countries. This energy is mainly used for cooking and heating.

Figure 2.2. Sources of Energy in Developing Countries, 1987

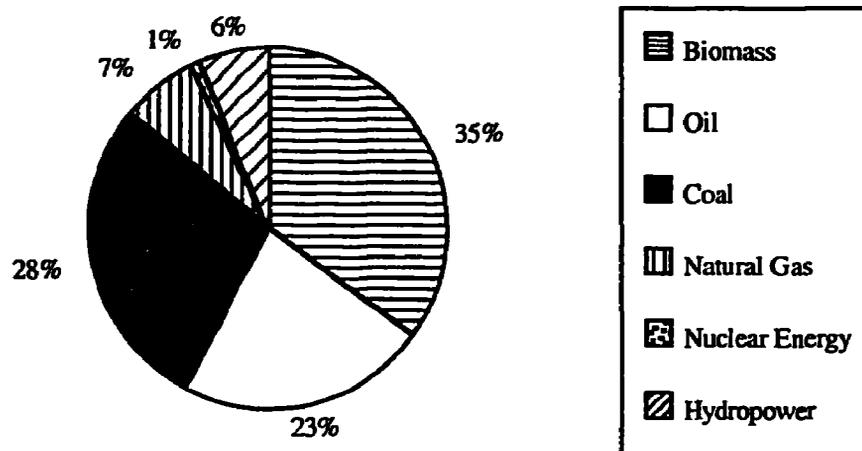

Source: *World Development Report 1992* (World Bank 1992); based on Hall, background paper.

In some “renewables intensive” scenarios, a number of studies show biomass as a major player (see Johansson and others 1993, chap. 1; U.S. DOE 1990a; and World Energy Council 1992). Several reasons are given for this. The foremost, perhaps, is the versatility of biomass. It may be converted directly to electric power by burning, or it may be converted to liquid or gaseous fuel by physical or biological means. It is also amenable to storage. In many respects it can be compared to fossil fuels. However, it is worth noting that its energy density is lower. Hall and others (1993) quote heating values of 17.5 to 20 gigajoules per ton (on a dry weight basis) for biomass compared with 30 to 35 gigajoules per ton for bituminous coals and 23 to 26 gigajoules per ton for lignite. Therefore, transport and storage costs play a significant part in cost evaluations.

The main growth in energy demand is expected to occur in developing countries (World Bank 1992). It is worth noting that biomass combustion is a familiar idea in most of these countries, and this familiarity could play an important part when the feasibility of biomass projects, albeit on a larger and more efficient scale compared to current uses, is considered in these countries.

Efficiency is perhaps the key determinant of costs. To begin, therefore, the following looks at some points presented in the current literature on the efficiency with which (a) biomass is created and (b) biomass is converted to commercially usable energy.

Formation of Biomass

The limiting factor is the efficiency with which sunlight is converted to biomass energy. The maximum theoretical value quoted is 6.7 percent; this is for C_4 plants (so-called because the first product of photosynthesis is a 4-carbon sugar), such as maize, sorghum, and sugar-cane, which grow best in relatively hot climates. A value of 3.3

percent is given for C₃ plants, such as wheat, rice, and trees, which account for 95 percent of global plant biomass. Once factors such as temperature, leaf cover, disease and pests, and presence of adequate nutrients and water are taken into account, however, the real values become much lower (2 to 3 percent and 1 percent of incident sunlight are quoted for C₄ and C₃, respectively, by one authority and 0.2 to 0.3 percent by another).⁴ Another point of interest is the possible effect of increased carbon dioxide levels, and therefore resulting climatic change, on growth. This is an important issue, and work on it includes some studies being carried out currently at Oak Ridge National Laboratory (ORNL; information is from the Environmental Sciences Division of ORNL and from discussions with ORNL staff on their Global Environmental Studies research).

The main point illustrated by the theoretical photosynthetic efficiency is the high land intensity of biomass energy compared with other sources of energy, such as photovoltaics, which have a solar energy to electricity conversion percentage of 3 to 17 percent in the field and even higher experimental efficiencies (6 to 34 percent) and theoretical efficiencies (47 percent for a tandem cell with two crystalline layers; see chapter 4). This raises the issue of whether the land might be better used for something else, such as crop production, given that increases in the world's population in the coming decades seem likely to place increasing pressures on land resources, even allowing for increases in crop yields (for discussion, see chapter 7 of the *World Development Report 1992* [World Bank 1992]). Particular cases need to be considered in detail, however. Examples are growth of biomass for restoration of degraded land, as a by-product of afforestation schemes, and as a new livelihood for farmers in some developed countries in order to replace food production of excess capacity.⁵ An example of this high land requirement is the figure quoted in an Energy Department Working Paper of 600 hectares of plantation per megawatt or 30,000 hectares (300 square kilometers) for a 50 MW dendrothermal plant, quite a small plant by conventional fossil-fuel standards (Terrado 1985). These figures, although not completely up-to-date, illustrate that the use of biomass for commercial energy production will place significant demands on land and forestry management.

Several factors play an important part in determining the "efficiency" and therefore cost-effectiveness of a biomass plantation (Terrado 1985; Hall and others 1993; and literature from ORNL Environmental Sciences Division). These include site establishment, including species selection, land cost, and equipment costs; plantation running costs—for example, costs of labor, fertilizer, and herbicides; and transport costs to the site of energy

4. See Hall and others (1993) for a good discussion of these factors and for the derivation of the higher value and Anderson (1992) for the lower value, which does not distinguish between C₃ and C₄.

5. An example of the use of biomass for restoration is an Oak Ridge National Laboratory (ORNL) project being carried out in Poland in conjunction with the European Community to set up a biomass plantation; the land being used has a high soil alkali metal content and therefore is of limited use. For discussion of growth of biomass as a byproduct of afforestation, see Anderson (1992); see also Perlack, Ranney, and Russell (1991), who describe an ORNL project in China. With regard to biomass production as an alternative livelihood for farmers, Hall and others (1993: 623) give an example in Sweden.

conversion. Naturally, the species selection and crop rotation play an important part, since the biomass energy density, leaf cover, productivity, water requirements, nutrient requirements, soil erosion, susceptibility to diseases, and effect on the biodiversity of the plantation and its surroundings are all related to this one factor. The United States Department of Energy's Oak Ridge National Laboratory (ORNL) has carried out extensive research on crop selection and rotation.

Aside from using plantations for energy production, there are many examples—some going back many years—of the use of biomass residues for the production of energy. These are instances where crop residues are used, usually by the industry producing them, to generate both heat and power for use within the plant, with excess electricity being sold to the utility. These are called cogeneration plants. These plants can be very cost-effective, especially if the residue has no other value, and a good price (say, based on avoided costs as in the United States under the Public Utility Regulatory Policies Act [PURPA]) can be obtained from the utility. Lately, an increase in the availability of second-hand boilers is making the costings feasible for cogeneration facilities in a number of developing countries, resulting in a flourishing private industry (Willem Floor, personal communication, 1992). However, because of subsidies in many countries, the cost of power from the grid can be artificially low, and thus setting up a cogeneration plant may not necessarily be economically feasible (see ESMAP 1988 for an example). Other problems may include electricity boards refusing to take privately generated power at all, imposing a sales tax on self-generated electricity, or even decreasing the maximum power available to industries with cogeneration facilities and providing no backup power (U.S. Congress 1992).

Energy from Biomass

Biomass can be converted to energy by a variety of methods: direct combustion and use of the heat generated for space heating and cooking, combustion of biomass or biomass-derived products to generate steam, which in turn is used to drive steam turbines for power generation, and biochemical or thermochemical degradation of biomass to form biogas and liquid fuels. These in turn may either be used directly as fuel or converted to electric power by combustion in an internal combustion engine or in a gas turbine to obtain shaft power, which in turn can be coupled to a generator.

Liquid Fuels from Biomass

The fermentation of sugars to produce ethanol is an age-old process and essentially forms the basis for the production of alcohol from biomass. Both methanol and ethanol may be produced from biomass. Ethanol may be produced from sugars (such as sugarcane), starches (such as corn), or cellulosic material. In the first case, the sugar is directly fermented to produce ethanol, with the waste bagasse sometimes being burned for cogeneration. In the latter two cases, the material has first to be broken down into sugars before fermentation. This is done either by using acids or hydrolytic enzymes. These two processes, saccharification and fermentation, may be carried out in "one pot" (see Johansson and others 1993 and U.S. Congress 1992 for details of the latest technologies).

In cases other than sugarcane, fossil-fuel energy is also required, and therefore prices vary significantly according to the method of production. The main cost, however, is that of the raw material. According to most sources, this makes up 60 to 80 percent of the total cost of ethanol production (World Bank data; see also Hall and Overend 1987: 318). Brazil is most well known for use of ethanol as a transport fuel (Goldemberg, Monaco, and Macedo 1993; Monaco 1989; CENAL 1988; and unpublished World Bank data). Ethanol, of course, has other uses—for example, in the chemical and beverage industries—but these are not considered here.

Methanol can be made by a thermochemical degradation reaction in the presence of oxygen to form “synthesis gas,” followed by a shift-gas reaction to obtain a precise mixture of hydrogen and carbon monoxide, and finally by passage through a pressurized catalytic reactor to form liquid methanol. This is not a commercial process as yet (see Johansson and others 1993 and U.S. Congress 1992 for details of the latest technologies).

Ethanol and methanol may of course be burned to generate energy or electricity. However, this is not economically desirable in normal situations. Their main use is as an additive to gasoline, and ethanol is considered to be more desirable in that respect than methanol in the United States, in terms of its physical properties, as on blending the ethanol mixture has a lower Reid Vapor Pressure than the methanol blend (Wyman and others 1993).⁶ “Pure” ethanol can either be used in its hydrated form (95:5 ratio of ethanol to water) as a transport fuel, or its anhydrous form can be blended with gasoline. The latter is naturally more expensive, because it involves the extra step of distilling the hydrated ethanol.

Electricity from Biomass

The conversion efficiency of biomass to heat for cooking and heating—the traditional role—is highly inefficient, being only a few percent. Considerable work has been carried out on the improvement of domestic stoves to improve efficiency (see Johansson and others 1993 or World Bank 1992, for example).

Most of the components of a direct combustion system plant are the same as in a conventional fossil-fuel-fired thermal plant. The main exception is the furnace, as biomass has a lower energy density and requires a furnace designed to cope with the higher moisture content of the fuel and the greater quantity of ash generated. The technology, nevertheless, is well developed, and a number of different types of commercial furnaces for firing wood in boilers are available (Terrado 1985; Johansson and others 1993; and U.S. Congress 1992 all describe the technology further).

Biomass may be converted to producer gas by thermochemical means or to biogas by anaerobic digestion; these, in turn, are used to generate electricity by combustion in an internal combustion engine. A number of small-scale facilities of this type already exist,

6. However, in Europe, methanol is routinely used in gasoline at levels up to 3 percent.

particularly in Brazil (producer-gas-based) and in China and India (biogas-based).⁷ The cost of producing electricity from these systems is given in the section on cost of electricity from biomass, below. The technology utilizing biomass gaseous fuels in gas turbines is under development (see Elliott and Booth 1990; Johansson and others 1993; and U.S. Congress 1992 for detailed description of technologies). The heart of the technology already exists, but technological advances are needed to cope with the high ash and impurity content of the biomass-derived gaseous fuel and its consequent low efficiency. Elliott and Booth (1990) quote a current figure of 42 percent fuel efficiency. They also provide a lucid account of the technology advances needed to increase efficiencies and decrease capital costs. These include technology to cope with the low calorific value of the gas, the higher ash content from combustion of biomass compared with coal, and the higher concentration of alkali metals in the ash. This volatile ash can carry over and causes rapid deterioration of the turbines. There is one scheme, however, in which a ceramic heat exchanger separates combustion gas from heated air to drive a gas turbine (Edwin Moore, personal communication 1993). The U.S. Congress's Office of Technology Assessment (1992) feels that some of these problems may already be resolved and describes technologies that are near commercialization, as well as others that may be available by the end of the century with a concerted R&D effort. These are all larger-scale operations than internal combustion engines. Estimated costs of electricity using these technologies are also discussed in the section, Cost of Electricity from Biomass.

Environmental Effects

For environmental reasons, the "recycling" of carbon dioxide is important. There is no net increase in the short term of atmospheric carbon dioxide from burning biomass or biomass-derived fuels—a factor that is becoming increasingly important in the context of discussions about imposing a "carbon tax" because of the greenhouse effect. Biomass also has a far lower sulfur content than coal (0.01 to 0.1 percent sulfur by weight for typical biomass feedstocks compared with 0.5 to 5 percent for coal; Hall and others 1993). Thus, acid deposition from sulfur dioxide emissions on combustion are significantly lower than for coal. Some work is being carried out at Oak Ridge National Laboratory (ORNL), in conjunction with the Tennessee Valley Authority, on the co-combustion of wood and coal in coal-fired plants to reduce sulfur dioxide emissions.⁸ The NO_x emissions of biomass, however, are higher than those of coal, and this may be something to consider in terms of their effect on the atmosphere. Biomass power plants also have far higher particulate emissions than conventional coal-fired plants (Terrado 1985).

7. Rajabapaiah, Jayakumar, and Reddy (1993) describe a particular case of electricity generation from biomass in India in detail; and U.S. Congress (1992) gives figures of 5 million digestors in China and 300,000 in India at present.

8. This information is based on discussions with Oak Ridge National Laboratory, University of Tennessee, and Tennessee Valley Authority and data on the biomass resource assessment for the TVA region available from the Environmental Sciences Division at ORNL.

The environmental aspects of burning ethanol as a fuel are also worth noting. First, the net quantity of carbon dioxide released to the atmosphere is zero if the initial capture of carbon dioxide from the atmosphere by the biomass is taken into account, and carbon monoxide emissions are lower than for gasoline. Second, ethanol does not contain lead additives (unlike gasoline), and therefore lead emissions are zero for "neat" ethanol use. Hydrocarbon emissions are also lower compared with gasoline. Opinion varies on whether NO_x emissions are different, and in which direction.⁹ However, aldehyde emissions are significantly greater; this may prove to be a serious problem, as aldehydes are reactive species; acetaldehyde, for example, is a known irritant and possible carcinogen, and formaldehyde is a known carcinogen. Finally, the burning of sugarcane residues on plantations (preharvest burning of dry leaves to promote pest control and lower harvesting costs, and postharvest burning of residues to expedite replanting) does cause concern. The problem is made worse in some countries by the proximity of the plantations to urban areas (Goldemberg, Monaco, and Macedo 1993). Initially, on the introduction of the Proalcool program in Brazil, pollution of waterways increased in several cases because of the discharge of stillage from distilleries directly into the waterways. This is no longer a problem, as the stillage is now being used as fertilizer or being treated before discharge (World Bank data).

The Cost of Biomass Energy

The costs of producing liquid fuels from biomass are considered first, followed by the costs of producing electricity.

Cost of Liquid Fuel Production from Biomass

Annex 2 gives some of the costs quoted in the literature for the production of ethanol from various biomass sources. Figures 2.3 to 2.5 provide a graphical presentation of the data. Before interpreting these results, a note of caution needs to be sounded. First, the quoted costs vary in their assumptions, and this is one reason why estimates vary so much. Examples are as follows:


- a. It is not stated in all cases whether the cost of anhydrous or hydrous ethanol is being quoted. The former is more expensive than the latter, as it involves the extra production step of distillation. Nevertheless, both have been plotted on the graph without any adjustments.
- b. Capital costs are treated as sunk costs in some cases and are not included in the cost of production. These cases, where known, are noted in the table in Annex 2, but they have *not* been plotted on the graph.

9. In Goldemberg, Monaco, and Macedo (1993: 852-53), the text states lower emissions, but the table shows higher emissions. Wyman and others (1993) explain that per se NO_x emissions are less from ethanol, but this effect is negated by an increase in engine compression ratio. Monaco (1989: 26-31), gives data showing variation with car make.

- c.** It is not always clear whether the cost quoted includes government subsidies and credits from sale of byproducts of ethanol production. By-products include stillage for fertilizer, electricity from bagasse in the case of sugarcane, and carbon dioxide and animal feeds from corn.
- d.** The scale of production is rarely mentioned.
- e.** It is worth noting that the cost of setting up a distillery will vary depending on whether the plantation already exists, as this is a major cost. Also, the proximity of the plantation to the distillery is important because of high transport costs.
- f.** In the case of ethanol production from sugarcane, the data presented here is mainly from Brazil, and the following should be noted:

 - Details such as the variation in price caused by the number of ratoon cuts (cuttings) per year or the proportion being sold directly as sugar in different distilleries are not taken into account and only averages are presented.
 - Official data from Copersucar (the cooperative of sugarcane, ethanol, and sugar producers responsible for one-third of Brazilian sugar-cane production) tend to be on the high side. Copersucar estimate that making adjustments for the over-valued exchange rate and lowering the land value to reflect existence of large uncultivated areas could lead to a 20 percent reduction in costs (Goldemberg, Monaco, and Macedo 1993).
- g.** Costs given for ethanol production beyond 1992 are predictions that vary depending on the scenario assumptions. For example, some are based on a business-as-usual scenario, whereas others are based on an intensified R, D, & D scenario. These are noted in the table in Annex 2.
- h.** Costs shown for ethanol production up to and including 1992 are either actual costs or are results of engineering studies based on the technology of the time.

Figure 2.4. Cost of Ethanol Production from Cellulosic Material Using Different Hydrolytic Processes

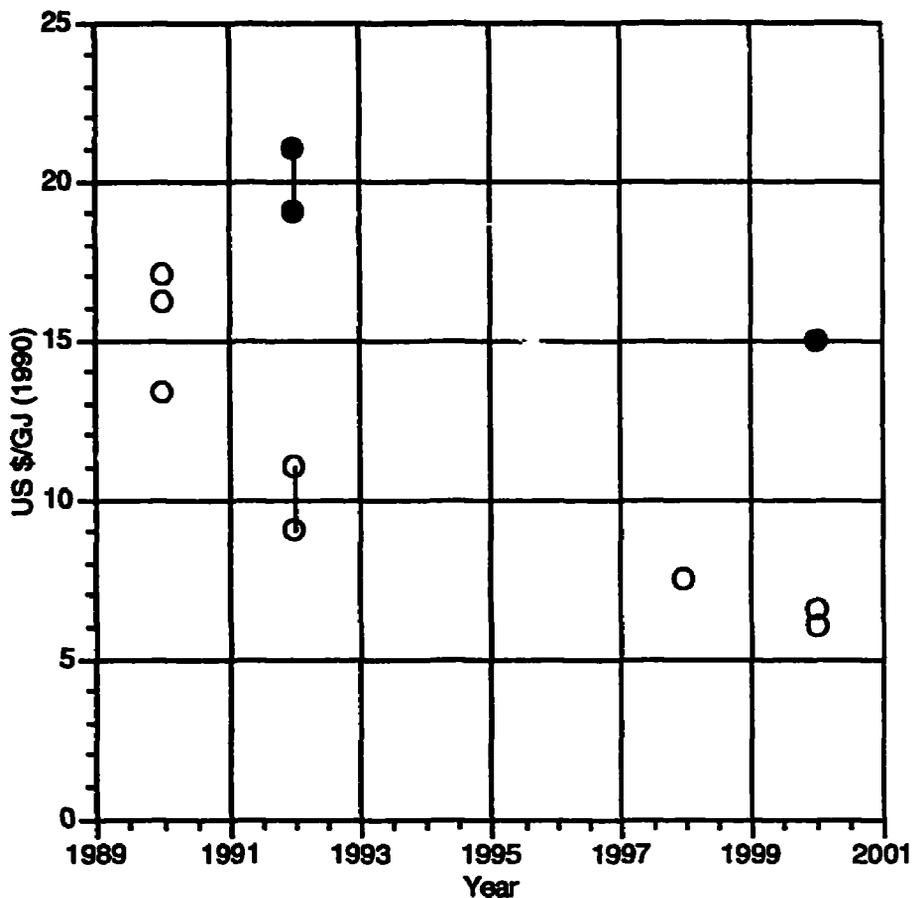


All values for years up to and including 1992 are costs from actual facilities or are costs from engineering studies based on the technology of the time.

KEY

- Raw Material:** ○ cellulosic material-enzyme hydrolytic process
 ● cellulosic material-acid hydrolytic process

Figure 2.5. Cost of Ethanol Production Compared with Gasoline Prices

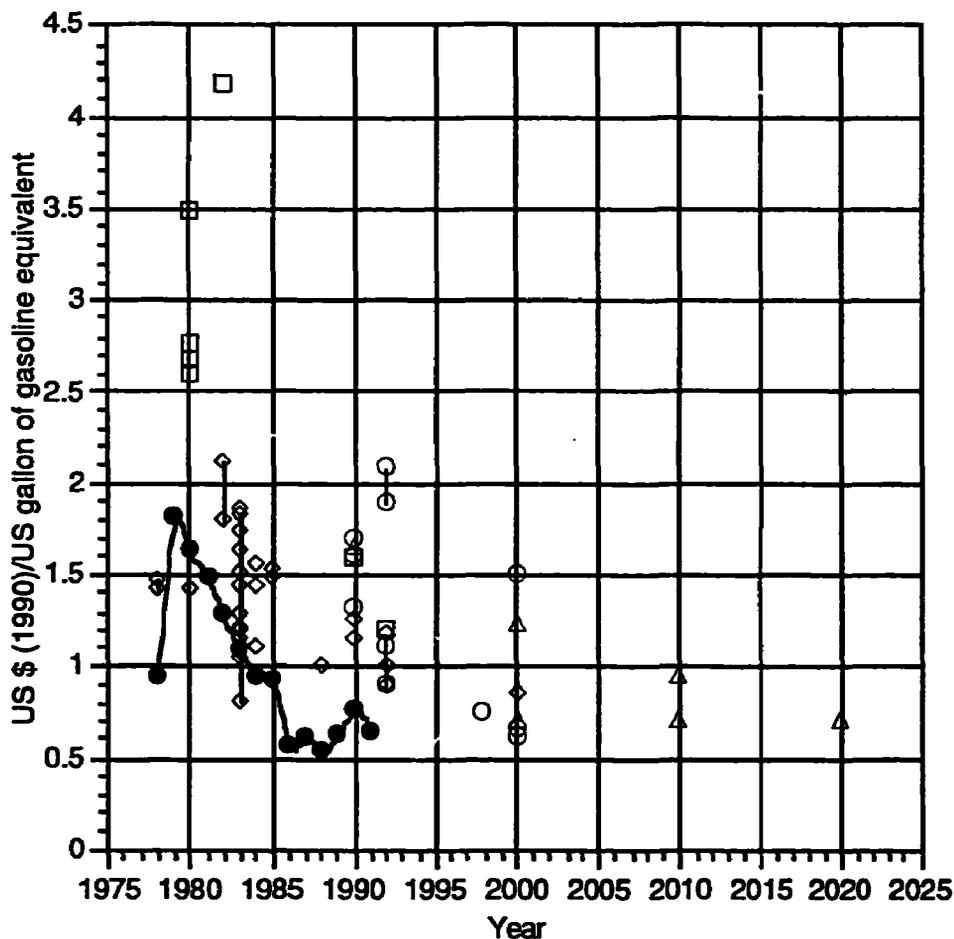

All values for years up to and including 1992 are costs from actual facilities or are costs from engineering studies based on the technology of the time.

- KEY** Cost of ethanol production from the following raw materials:
- ◇ sugarcane
 - cellulose
 - corn
 - △ not specified
 - Price of a gallon of premium gasoline based on spot prices (Rotterdam) from International Energy Agency, "Oil and Gas Information 1989-1991" (1992) converted to 1990 dollars.

Second, the following must be taken into account when converting all production costs to 1990 U.S. dollars (using the procedure described in Annex 1):

- a. Different constituents of the production cost—such as machinery, land, labor, and raw materials—will have increased by different inflation rates over time. The method used for converting costs to 1990 dollars does not take this into account.
- b. The conversion of the Brazilian cruzado to its foreign exchange equivalent poses special problems. It is overvalued, and thus quite distinct official and black market rates exist. Not all sources mention how this conversion is dealt with when quoting Brazilian ethanol costs in U.S. dollars.
- c. In most cases, the source material gives the year of the price. Where it does not, this is noted in Annex 2, and the document's publication date is used as the year.

The following data from Annex 2 has not been plotted on the graphs:

- a. Items 21, 23, 25, 27, 29, 31, 49, 51, and 67 to 70 have not been plotted as the quoted values do not include capital costs.
- b. The data from CENAL (items 32 to 37), World Bank data (items 42 to 47), and item 56 from Goldemberg, Monaco, and Macedo (1993) have not been plotted. The source data has been plotted instead (items 71, 72, and 74).
- c. Items 57, 60 to 61, and 66 (from Wyman and others 1993) have not been plotted, as the data has not been specified for a particular year, and the sources from which the numbers are derived span several years.
- d. Item 73 has not been plotted, as the labor costs have been shadow-priced.

Despite the reservations discussed, which are illustrated by the dispersion in the graphs, these conclusions may be drawn on the basis of the data in Figures 2.3 to 2.5:


- a. There has been a reduction in the cost of production of ethanol in the last 15 years (Figure 2.3).
- b. Presently, ethanol from sugarcane is cheaper than that from corn and cellulosic material (the latter has yet to be commercialized; Figure 2.3).
- c. For cellulosic materials, acid hydrolysis is more expensive than enzymatic hydrolysis (Figure 2.4).
- d. Ethanol from cellulosic material is expected to become the cheapest alternative by the year 2000.

Let us now examine these in a little more detail. As discussed earlier, the delivered cost of the raw material accounts for 60 to 80 percent of the cost of production. This is the main reason why ethanol from cellulosic materials (e.g., woody materials and agricultural residues), which are more abundant and lower in cost, is expected to be the cheapest alternative in the future (Hall and Overend 1987; U.S. DOE 1990a; Wyman and others

1993; and U.S. Congress 1992). This is not currently the cheapest source of ethanol, as the technology needs further development.

Woody materials and starch crops (such as corn) need first to be broken down (or hydrolyzed) to sugars before fermentation (the process is shown in simplified form in Figure 2.6; Hall and Overend 1987; U.S. DOE 1990a; Wyman and others 1993; and U.S. Congress 1992). As the figure shows, either enzymes or acids are used as catalysts in the reaction. Of the two processes, enzymatic hydrolysis is preferable, as it is more specific, and only one product is formed, unlike acid hydrolysis, in which competing side reactions decrease the yield of product and lead to higher production costs. In either case, the sugars are then fermented to form ethanol. For woody materials, this process is more difficult, and not all the sugars formed can be easily converted into ethanol, resulting in a lower yield of ethanol per ton of material. Advances in biotechnology have opened up some solutions that show promise for future low-cost ethanol production (Wyman and others 1993), but further evaluation is required before these methods are commercialized.

Figure 2.6. Formation of Ethanol (Simplified Scheme)

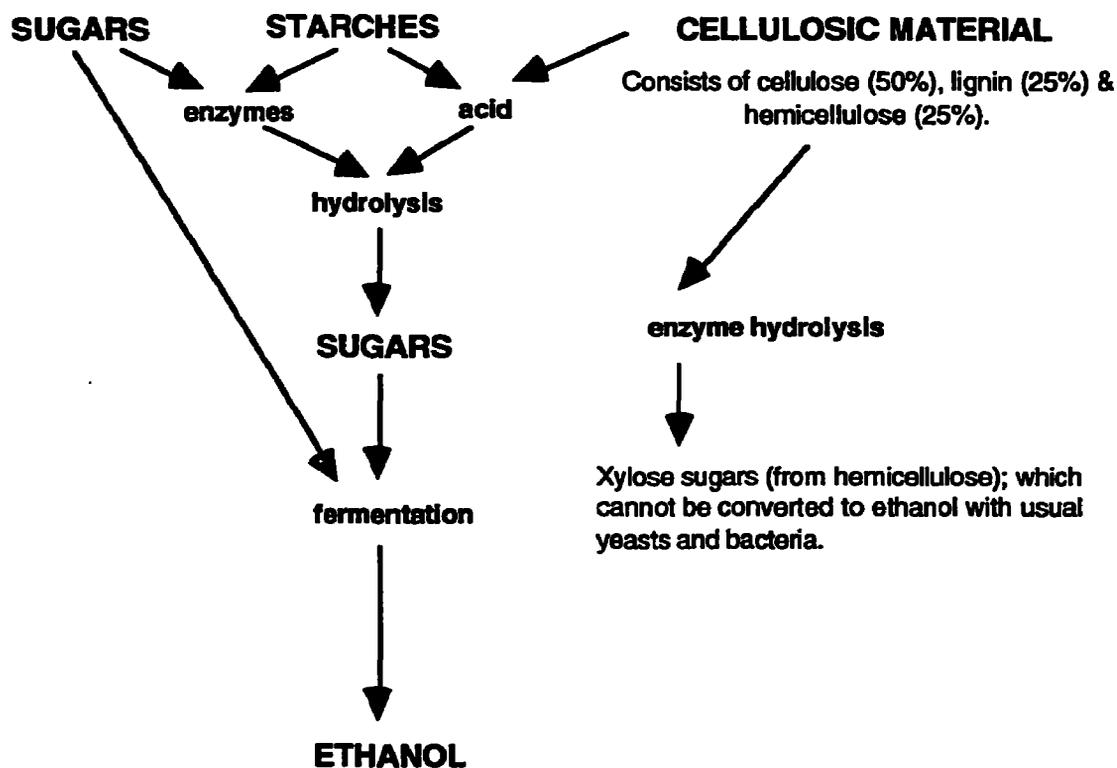

The costs quoted are for ethanol production from sugarcane in Brazil and from corn in the United States. In both cases, the distillery is one part of an operation that also sells the raw material as is, or other products derived from it. Thus, it is difficult to break up the cost estimate accurately. Various co-products are formed as a result of ethanol formation

(see Wyman and others 1993 for a comprehensive summary). In the case of corn, carbon dioxide and animal feed are sold as by-products. However, the U.S. Department of Agriculture projects that as ethanol production increases, the cost of corn will rise and that of co-products will drop (Wyman and others 1993). For sugarcane, the stillage from fermentation is used as a fertilizer on the plantation, and bagasse residues are used for co-generation purposes, with surplus electricity being sold to the grid (Goldemberg, Monaco, and Macedo 1993). Naturally, this revenue is not likely to decrease in the same way as that from corn co-products. In corn-derived ethanol, fossil fuels are required to generate energy. Other points of difference between corn- and cane-derived ethanol are the extra processing (hydrolysis) of corn to produce ethanol, and differences in the simple costs of raw material production in Brazil versus the United States, such as the price of land (Goldemberg, Monaco, and Macedo 1993; Geller 1985; Hall and Overend 1987). Corn may be processed to produce ethanol either by wet or dry milling. The former is the cheaper alternative (Flaim and Hertzmark 1981 and Wyman and others 1993 give costs).

Finally, as can be seen from Figure 2.5, the cost of producing ethanol has decreased over the last 15 years. However, since the ethanol is replacing gasoline, its cost relative to gasoline is crucial. Figure 2.5 gives the same data from Figure 2.3, but converted to \$/U.S. gallon of gasoline equivalent by applying a simple multiplier.¹⁰ The price of a gallon of premium gasoline based on spot prices (Rotterdam) over the same period is also shown up to the present (International Energy Agency 1992). Note that the cost of producing ethanol was beginning to compare well with gasoline prices before the collapse of oil prices in 1986.

Methanol and synthetic petroleum can also be derived from biomass. Neither of these are commercial processes at present. Calculations show that gasoline could be produced from biomass for \$0.85 to \$1.00 per gallon (U.S. DOE 1990a). In the case of methanol, current cost estimates range from \$7 to \$20 per GJ.¹¹

Cost of Electricity from Biomass

Annex 3 summarizes data from a variety of sources. Figures 2.7 to 2.9 illustrate this data in graphical form. As in the discussion on liquid fuels from biomass, a note of caution needs to be sounded. The figures being compared on the graphs vary in their underlying assumptions. The following are examples:

- a. The graphs show costs for cogeneration facilities as well as grid-connected plants, although Figure 2.7 distinguishes between the two.

10. The lower heating value of ethanol is 21 megajoules per liter, and its technical equivalence to gasoline (based on engine output) is 80 percent (Goldemberg, Monaco, and Macedo 1993).

11. Wyman and others (1993) give figures of \$7.65 to \$19.60/GJ assuming a discount rate of 12 percent, U.S. Congress (1992) gives values of \$11 to \$14/GJ for a small plant producing 10 million GJ/yr, with capital being the largest fraction of the total cost, and \$7 to \$8/GJ for a 40-million GJ/yr plant, where feedstock is the dominant cost.

- b. Costs of actual facilities and engineering study estimates are given (Figure 2.8).
- c. The costs are for plants based at different locations worldwide.
- d. The method used for power generation ranges from direct combustion, to biogas-gas turbines, to producer-gas internal-combustion engines.
- e. The plant sizes vary from 5 kWp to 100 MWp. Figure 2.9 highlights larger units.
- f. The method and underlying assumptions for the cost calculations (such as discount rates used) are not always specified in detail.
- g. The revenues from sale of surplus electricity to the grid in the examples of cogeneration facilities may or may not be taken into account when quoting a cost for electricity generation. Furthermore, the sale of the electricity may have been accounted for at different rates.
- h. The type of biomass used for power generation varies in the examples given. Furthermore, this biomass will have been acquired in different ways, such as in entry number 19 the biomass is grown on a plantation on the premises and costs take into account the setting up of this plantation, whereas, in the case of entry 38, the biomass is purchased municipal solid waste. Entry 34, on the other hand, utilizes bagasse from an adjoining sugar mill.
- i. Costs given for electricity generation beyond 1992 are predicted costs which vary in terms of technology being utilized and scale of production.
- j. In the case of cogeneration plants, capital costs may only include the cost of additional equipment, rather than all equipment to generate electricity.

The hazards of converting currencies to 1990 U.S. dollars (using the procedure in Annex 1, unless specified differently in the table) in order to compare costs are again worth considering. For example, some currencies are overvalued, and inflation may affect different parts of the estimate in different ways. In most cases, the year of the currency is given in the source material. Where it is not, the price is assumed to be that obtained in the year of publication and is noted to this effect in Annex 3.

With the above caveats in mind, data from Annex 3 were plotted in Figures 2.7 to 2.9. The value of this type of analysis is that quoted costs for the production of electricity from biomass are being compared. Each situation is different, and therefore attempts to make the calculations uniform may not be any more meaningful and may suffer in terms of other aspects.

Figure 2.7 distinguishes between cogeneration facilities and power plants. As the graph shows, the costs span a wide range of values. The lowest costs are for electricity generated in cogeneration facilities. However, some of the highest costs are also for electricity from cogeneration facilities. Although no distinct pattern is evident, there may be a slight decrease in costs over time. The range of costs in a particular year does appear to decrease, but this probably represents a reflection of the data collected rather than a real effect.

Figure 2.8 highlights the values based on actual operating facilities. The small number illustrates the general lack of actual data available and the degree to which even well-known authorities cite values on the basis of tabletop studies when discussing electricity generation from biomass.

Figure 2.9 shows the cost of electricity from plants greater than or equal to 30 megawatts (peak). The costs are lower for these cases, because of economies of scale. The higher costs for 1992 and those for 1995-96 are from a European source (Grassi 1992). Costs of electricity generation from biomass tend to be greater in Europe than in other areas, particularly compared with the United States. However, it is worth noting that the dominant part of the 9,000 MW of power generated in the United States from biomass is from cogeneration facilities, where the biomass source is mainly residue from the pulp and paper industries. Table 2.1 shows the type of biomass utilized by percentage in the United States for power generation (U.S. DOE 1992a).

Table 2.1. Power Generation in the United States by Type of Biomass


<i>Type of biomass fuel</i>	<i>Percentage of total biomass capacity</i>
Wood	88
Landfill gas	8
Agricultural waste	3
Gas from anaerobic digestors	1

The low costs turn out to be heavily dependent on the biomass being purchased at a price of \$2/MilBtu or less (U.S. DOE 1990a). First, consider the cost calculation formula shown in Annex 1. This may be written in a more simplified form, for the purpose of discussion, as follows:

$$\text{Cost of electricity} = \text{Capital cost factor} + \text{O\&M factor} + \text{Fuel factor (cost} + \text{efficiency)}$$

The operating and maintenance (O&M) costs are generally considered a fraction of the capital costs (about 4 percent). Capital costs vary with the technology being used to generate power, and for the larger plants also vary between the biomass gasifier plant and the conventional steam turbine plant.


Figure 2.7. Cost of Electricity from Biomass

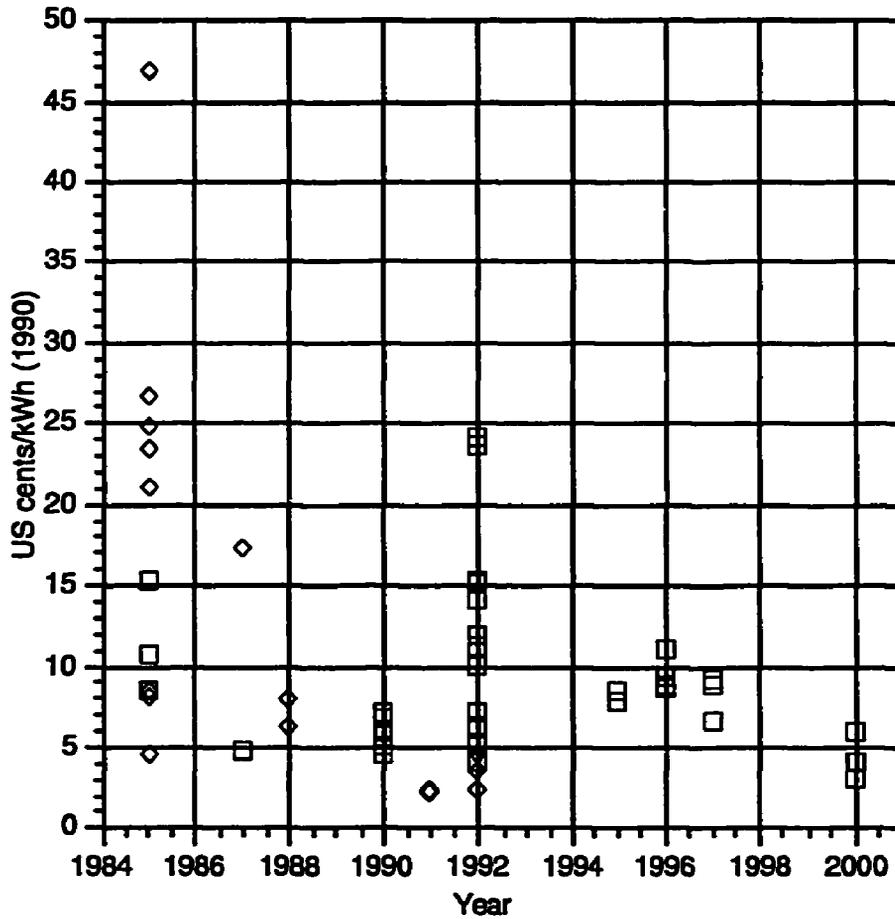

All values for years up to and including 1992 are either actual costs for plants or are based on studies using the technology of the time. Costs after 1992 are projected values.

KEY ◇ Cogeneration plant
 □ Power plant

Figure 2.8. Cost of Electricity from Biomass (Operating Facilities versus Engineering Studies and Projections)

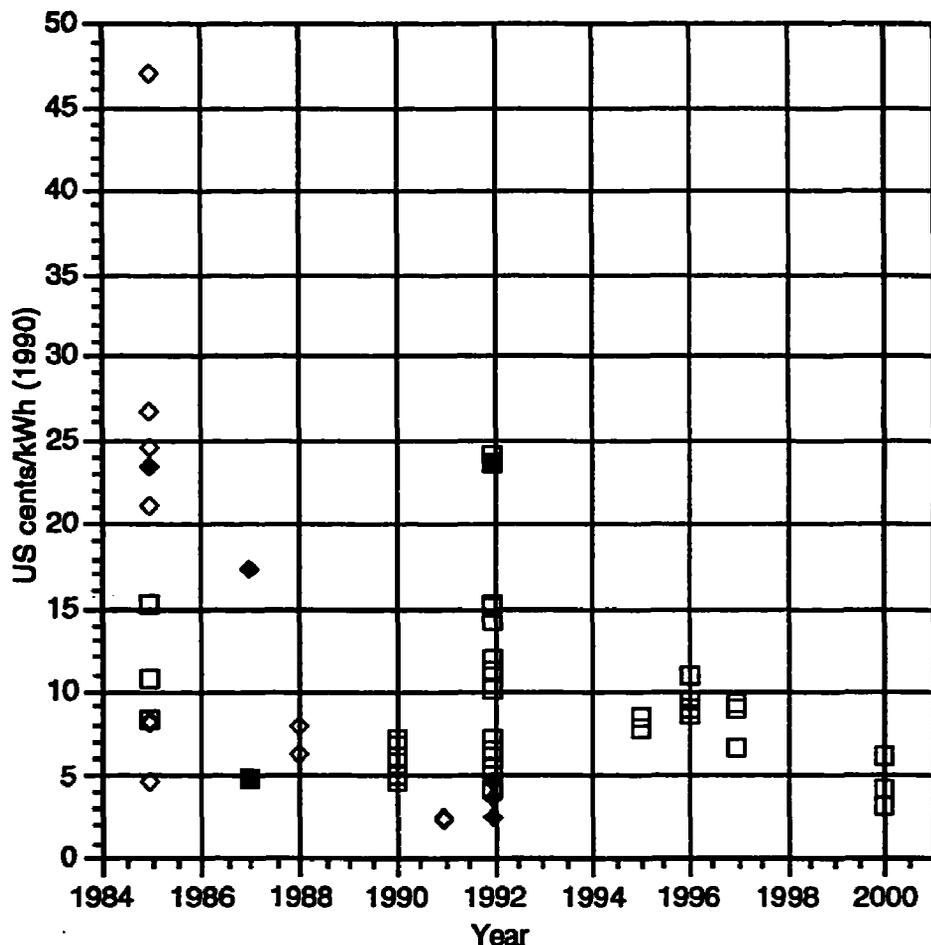


All values for years up to and including 1992 are either actual costs for plants or are based on studies using the technology of the time. Costs after 1992 are projected values.

Highlighted values are based on actual operating facilities.

KEY ◇ Cogeneration plant
 □ Power plant

**Figure 2.9. Cost of Electricity from Biomass
(Large- versus Small-Scale Plants)**

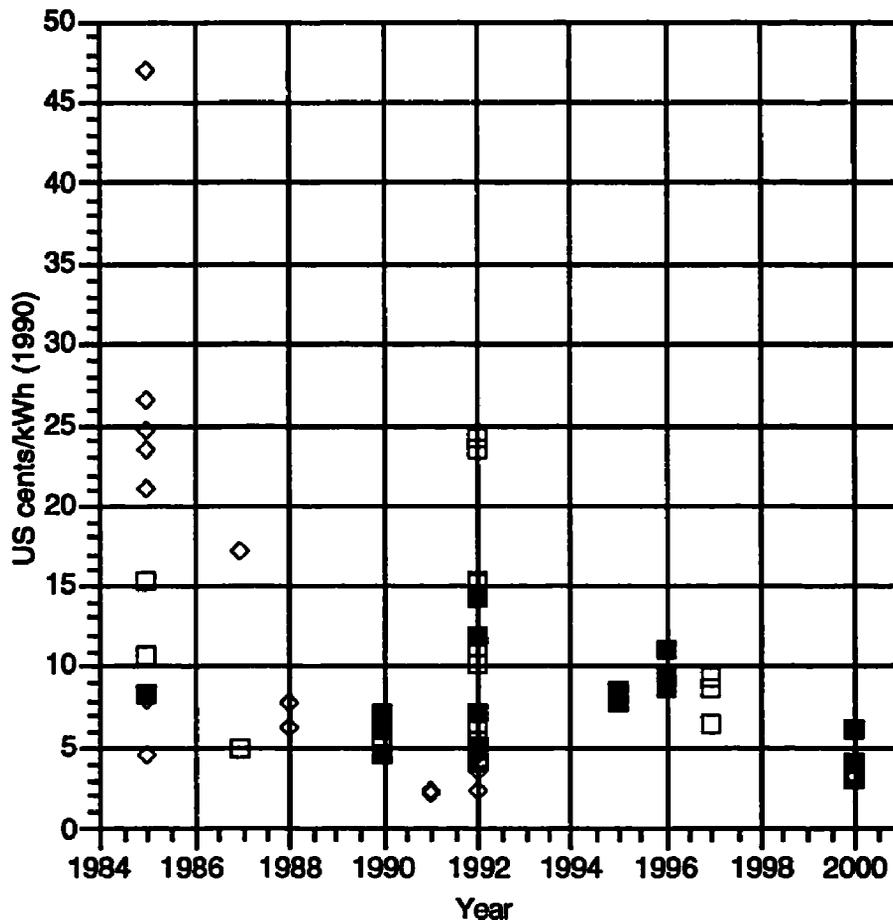

All values for years up to and including 1992 are either actual costs for plants or are based on studies using the technology of the time. Costs after 1992 are projected values.

Highlighted values are for facilities greater than (or equal to) 30 MWp in size.

KEY ◇ Cogeneration plant
 □ Power plant

Table 2.2 shows some historical and current capital costs (taken from Annex 3), for plants greater than 20 MWp. They have been converted to 1990 dollars, using the methods described in Annex 1. The costs in Table 2.2 are from only four sources, all based on theoretical calculations rather than on a particular power plant. It is also necessary to take into account that the capital cost in the case of item 19 includes the setting up of the plantation (about \$1,000/kW (1990) for 50 MW power plant only, excluding plantation), and in the case of items 1 through 4 and 20 appears to be the cost of the plant only. Clearly, no conclusions may be made on the basis of the above limited data regarding change in costs with time, other than the range of costs being quoted by different authorities. The only point that can be made is that the capital costs of the biomass gasifier plant are expected to be lower in the very near future compared with the steam turbine technology. Predicted costs for the gasifier technology range from \$1,200 to \$1,300/kW to as low as \$870/kW, for the biomass-integrated gasifier/intercooled steam-injected gas turbine by the year 2000 (Elliot and Booth 1990 for the former figure, Johansson and others 1993 for the latter).

Table 2.2. Capital Costs for Large-Scale (>20 MW) Biomass Energy Plants

<i>Reference from Annex 3</i>	<i>Type of technology</i>	<i>Cost (1990 \$/kWh)</i>	<i>Year</i>
19	Steam turbine	1,599	1985
3	Steam turbine	1,695	1990
20	Steam turbine	1,900	1992
1	Biomass gasifier	1,600-1,700	1990
4	Gas turbine	1,239	1990
2	Biomass gasifier	1,200-1,300	>1990

The delivered fuel cost is the other main factor that contributes significantly to the cost of the biomass-generated electricity. This consists of two factors, the transport cost and the cost of the biomass. The former is dependent on the distance of the biomass source from the power plant and the energy density and hence bulk quantity of fuel. The cost of the biomass is not only the cost of producing the biomass (i.e., land costs, plantation costs, and labor costs) but also the perceived cost of the biomass in terms of its other uses. For example, using maize for biomass power generation would mean a fuel cost the same as the market price for maize as a food crop rather than the actual cost of growing the crop. On the other hand, municipal solid waste could have a negative fuel cost, as burning it in a power plant would be a means of disposal. These are two extreme cases, however. Consider a short-rotation woody crop (SRWC) plantation. First, the setting up of any plantation will result in a large increase in the total capital cost of a biomass power plant/plantation (Terrado 1985). Second, the price of land is a major factor in developed

countries and may be an important factor in developing countries in the future as population increases. Hall (1991) quotes an estimated cost of \$56.36/ton (1990 dollars), equivalent to \$2.9/GJ, for the total delivered cost of wood chips from poplar plantations in the United States. Earlier estimates for the delivered cost for SRWC were in the range of \$3 to \$4.10/GJ (1985 dollars) using the technology of the time (Hall 1991). This indicates considerable progress. Hall feels that \$2/GJ is achievable for the United States. Note, however that the value of \$2/MilBtu (equivalent to \$1.9/GJ) is used in a number of estimates quoted earlier, although that value is an average and is probably heavily weighted by the cost of biomass residues (U.S. DOE 1990a; U.S. Congress 1992). Nevertheless, these figures are for current establishment of a SRWC site, and perhaps future figures may require the use of a higher value for land costs.

The Future of Biomass Energy

For ethanol production from biomass sources, costs have decreased over the last 15 years. The production of ethanol from cellulosic material promises another significant decrease in costs in the future.

The gasifier/gas turbine technology does appear to offer a cost-effective method of power generation in the future. The land intensity, however does remain an important factor, together with associated problems of utilizing large amounts of land for producing biomass such as competition over land for food crops.¹² However, each individual case requires particular attention, and in some cases, biomass for power generation will be the best alternative. An example is the ORNL/China project, where the setting up of the plantation/power plant serves a dual purpose: reforestation and electricity generation (Perlack, Ranney, and Russell 1991).

Cogeneration plants appear to be much more viable, especially if there are no fuel costs and the surplus electricity can be sold to the grid. Another important requirement is that the grid electricity is not already subsidized heavily. However, their use is limited to the quantity of "free" fuel available.

12. Johansson and others (1993) base a great deal of their material on the assumption that biomass for the purposes of fuel and for electricity generation may all be obtained from degraded land. However, the methods of converting this degraded land into good agricultural sites are not discussed.

3

Solar-Thermal

Introduction

The earth continuously receives a power input of 1.73×10^{14} kW from the sun. This translates to 1.5×10^{18} kWh/year, which is about 10,000 times the world's current annual energy consumption (Dunn 1986). The conversion of this huge renewable energy resource directly to electrical energy is the topic of this chapter and that of chapter 4.

Solar-thermal power plants use the sun's rays to heat a fluid, from which heat transfer systems may be used to generate steam that in turn is used to drive a turbo-generator. Or, the fluid may be used to operate an engine directly. At the outer atmosphere, the solar energy constant (indicative of the power density) is 1.373 kW/m^2 . Energy is then absorbed and scattered by the earth's atmosphere. The final incident sunlight is diffuse, with a peak power density of only 1 kW/m^2 at the earth's surface at noon in the tropics (International Energy Agency 1987). The insolation available for conversion to energy varies with factors such as the location of the sun in the sky (daily and seasonally), atmospheric conditions, altitude of the site, and number of daylight hours. Therefore, it is usually concentrated first by the use of mirrors. Three main technologies for concentration are in use or under development and are described in the section entitled Solar-Thermal Electric Technologies. Their current and prospective costs for electricity generation are discussed in the subsequent section.

It is worth pointing out that the methods of solar-thermal power generation are essentially the same as conventional technologies, except that the "fuel" is direct heat energy rather than stored energy in the form of fossil fuels, from which the heat energy needs to be released by combustion. This has led to criticism of the technology for its inability to store energy, unlike fossil fuels or biomass. However, storage of thermal energy is possible, and a number of systems are under development. These are discussed in more detail in the technology sections. Furthermore, as shown in the section on costs, thermal storage may help to reduce the unit cost of electricity generation from thermal-solar plants by improving the capacity utilization of the turbo-generating and electrical plants. In addition, thermal storage could be unnecessary if thermal-solar plants were used in

conjunction with existing hydro schemes; use of the solar plants would reduce the rate of drawdown of the reservoirs in the dry seasons.

The land requirement of solar-thermal plants is also worth consideration. Annex 4 gives land intensities of a dendrothermal plantation (based on an engineering study); an operating parabolic trough solar-thermal plant; and the collector areas of three existing central receiver test facilities. For completeness, the array area of three photovoltaic concentrator schemes is also given. These are compared with the inundated area of several existing or planned hydro plants in Brazil. The data are also shown in Figure 3.1 below.


As can be seen, the range of sizes in the case of hydroplants is large, and the collector or array area of solar plants is at the lower end of this range; whereas that of a dendrothermal plant is at the higher end of the range. This is only a rough comparison, and a comparison of total area occupied by the plant to the kilowatt hours generated by the plant would be more accurate (see Anderson 1992). However, Figure 3.1 does provide a *comparison* of the areas involved; this is unlikely to be altered significantly even if the areas are changed to allow for spacing.

The land requirements for solar-thermal plants, when compared with dendrothermal plants and hydroelectric dams, therefore, are not high; furthermore, solar-thermal plant sites are likely to be desert areas with low land values.¹³ Many experts feel that thermal-solar schemes, relative to hydro and biomass, are an attractive option for these very reasons, as they can be sited away from populous agricultural areas. This is particularly important when arable land is scarce or resettlement issues are controversial.

From an environmental viewpoint, solar-thermal technologies are benign. There are no emissions to the atmosphere. There is a water requirement, since areas of high insolation are usually dry (U.S. Congress 1992; unpublished IFC data). However, that problem can be minimized by using recycling systems (such as those commonly used in thermal power plants).

13. De Laquil and others (1993) say that land costs normally represent less than 1 percent of the facility's total capital costs; Charters (1991) writes that "solar technologies can often be sited on marginal use land."


Figure 3.1. Land Requirements for a Biomass Plantation, Solar-Thermal Plants, and the PV Array Areas of Existing Solar Plants Compared with the Inundated Area of Hydroplants

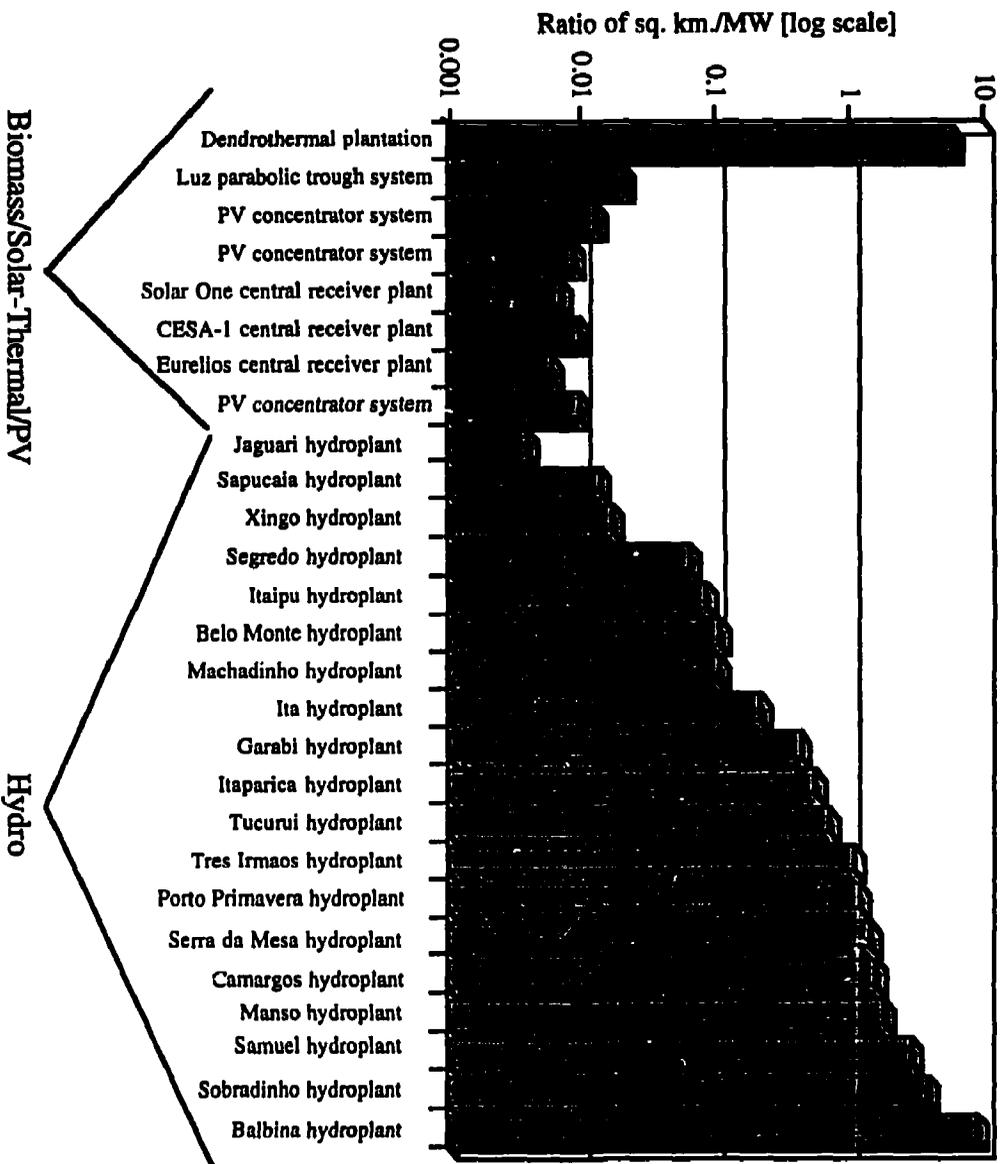

Solar-Thermal Electric Technologies

The three main types of system in use for concentrating and collecting diffuse sunlight are shown in Figure 3.2.

Figure 3.2. Concentrator and Receiver Systems for Solar-Thermal Electric Technologies

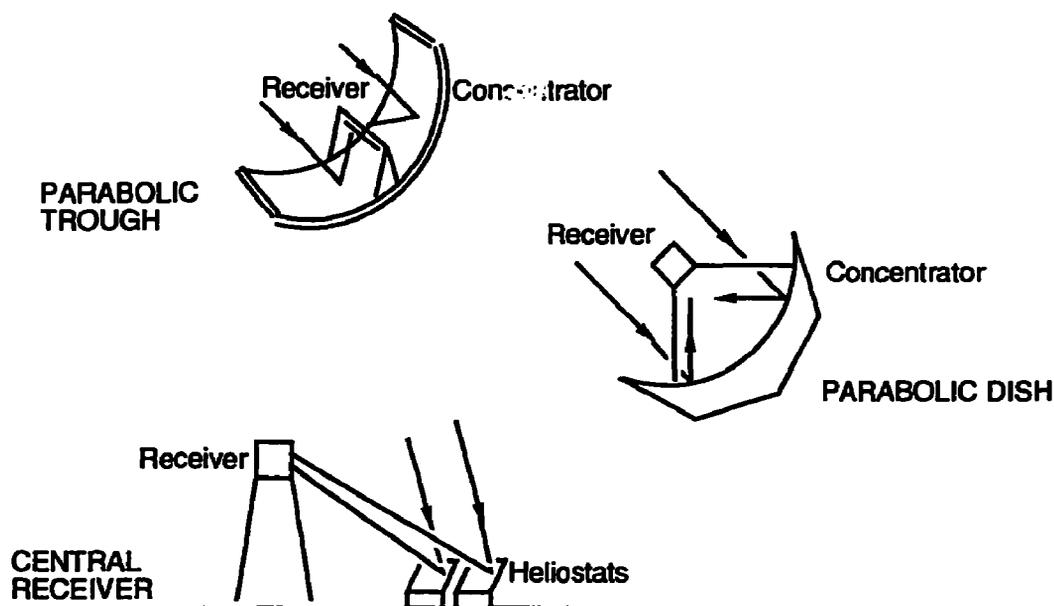

Parabolic Trough

Currently, the most advanced of the “concentrator” systems is the parabolic trough. This is the technology used in the largest commercial grid-attached solar-thermal power plants, which together make up 90 percent of the world’s solar electric capacity (U.S. DOE 1990a). These have a total net capacity of 354 MWp and are based in Southern California. They were installed by Luz International Limited and operated by that company until March 1992, when operation and maintenance were taken over by new operating companies, such as the Kramer Junction Operating Company for the Kramer-based plants, after Luz suffered financial difficulties (Kearney and Price 1992; Lotker 1991). These difficulties are summarized in Annex 5. The plants are still generating electricity and continue to provide information on technical performance and costs.

Parabolic troughs track the sun along one axis, concentrating the energy onto a receiver tube located at the trough’s focal line. Concentration ratios of 10 to 100 are typically achieved, with operating temperatures of about 400° C. In commercial plants, the receiver tube usually has water or oil running through it as the heat transfer medium. This fluid is then piped from each of the parabolic trough assemblies to a central area, where the energy is converted to electricity (De Laquil and others 1993; U.S. DOE 1992b;

International Energy Agency 1987). Research is being carried out on direct steam generation (DSG), which is expected to cut costs further as it eliminates the need for the heat transfer fluid as well as centralized oil-heated steam generators (De Laquil and others 1993). Commercialization of DSG technology was planned for 1996 by Luz, which launched a major program to develop the technology in 1989. This is now in doubt, however, because Luz has filed for bankruptcy (see Annex 5). In commercial plants, electricity demand when solar radiation intensity is low is currently met by the use of auxiliary gas-fired boilers or heaters. Thermal storage systems do exist but are not cost effective so far; however, three new concepts that promise to be cheaper than current alternatives have been identified, although they still need significant development to reach technical readiness (De Laquil and others 1993).

The lack of economical storage and the combustion of a fossil fuel on cloudy days to maintain the output has prevented the technology from being a fully independent alternative to fossil fuel plants. The Luz plants are all 25 to 30 percent natural gas hybrids. This has not only helped to maintain their electrical output on cloudy days but has also helped to increase the capacity factor and reduce costs, resulting in a more economic scheme for the sale of power to the grid under U.S. PURPA regulations on the basis of avoided costs (Kearney and Price 1992).

Parabolic Dish

A parabolic dish operates on the same principle as the parabolic trough, but it tracks the sun on two axes, concentrating the energy at the focal point of the dish because it is always pointed at the sun. The parabolic dish's concentration ratios are considerably higher than the trough's. Dish ratios are 600 to 2,000, and operating temperatures can exceed 1,500° C (De Laquil and others 1993). The power-generating equipment for use with parabolic dishes may be mounted at the focal point of the dish itself, or, as with the trough, energy may be collected from a number of separate installations and converted to electricity at a central point (International Energy Agency 1987). The former option is perhaps the most promising use of the dish technology, making it very well suited to remote or stand-alone applications.

The two most promising engines for mounting at the focal point appear to be the Brayton-cycle engine and the Stirling-cycle engine (De Laquil and others 1993). These convert the heat to power as heat is continuously supplied to a gas in a closed system, which in turn drives a piston as it cycles between hot and cold spaces in the engine. Extremely high solar-to-electricity efficiencies have been achieved for this technology; the record is 29.4 percent for the Vanguard parabolic dish-Stirling engine 25 kWp module in California, which was tested jointly by the U.S. Department of Energy and the Advanco Corporation between 1984 and 1985 (De Laquil and others 1993). Several parabolic dish test facilities have been constructed and operated; of these, some are still operational, but others have been disassembled (De Laquil and others 1993). The U.S. Department of Energy, in a joint venture with Cummins Power Generation, is working on the development and commercialization of a 5 kW dish/engine system and intends to initiate another project, involving the utilities, on 25 kW dish/engine systems (U.S. DOE 1992b).

Central Receiver

This is a very promising technology for large-scale grid-connected power generation, even though it is at an early stage of development compared with parabolic trough technology. In this case, flat tracking mirrors, called heliostats, concentrate the sun's energy onto a central receiver tower. Concentration ratios are 300 to 1,500, and systems can operate at temperatures of 500° to 1,500° C (De Laquil and others 1993). Energy losses from thermal-energy transport are also minimized as solar energy is being directly transferred by reflection from the heliostats to a single receiver rather than being moved through a transfer medium from several receivers to one central point, as with parabolic troughs. Solar-to-electric efficiencies for test systems are in the 8 to 13 percent range (De Laquil and others 1993). There are several test facilities in operation in both Europe and the United States. Work has been carried out on a number of different heat-transfer media, such as water/steam, molten sodium, air, and molten salt. The latter two are especially promising, as they could provide an economical energy storage system. Currently, the largest demonstration of the molten salt technology has been in France on the THEMIS 2 MWp central receiver system, using Hitec molten salt, giving the plant six hours of electricity production capability without the sun. This experimental facility completed its operation in 1986, having achieved lower annual power production than expected, but having demonstrated the advantages of the new technology and highlighted problems that needed further resolution (De Laquil and others 1993; International Energy Agency 1987)

The U.S. Department of Energy, in collaboration with a consortium headed by Southern California Edison, is currently converting the successful 10 MW Solar One (water/steam) central receiver pilot-plant to Solar Two (U.S. DOE 1992b). The Solar Two project will use molten nitrate salt as the heat transfer and storage system and will be able to provide power for about four hours after sundown or during cloudy periods. The molten nitrate salt technology has been validated at Sandia National Laboratory, but the Solar Two pilot will be the first large-scale field demonstration of the technology. It will highlight technical issues that appear to require further resolution, such as crystallization of the molten salt and energy losses from the salt during piping. New stretch-membrane heliostats will also be added to the existing heliostat field to increase the system's energy output. New improved heliostat design and new receiver technologies continue to be tested in the United States with a view to improving performance (see U.S. DOE 1992b and De Laquil and others 1993). The U.S. Department of Energy believes that the Solar Two project will lead to the utilities setting up as many as four 100 MW central receiver plants by 1997-98 (discussions with R.H. Annan, Director, Office of Solar Energy Conversion, U.S. DOE, Washington, D.C.).

Another project under development uses air as the heat transport medium, with heat storage in a porous ceramic material. The work is being carried out by a European industry group called the PHOEBUS Consortium (De Laquil and others 1993; Grasse 1992). The advantages of this system are great because of its simpler design, ease of operation and maintenance, and lower cost. However, current disadvantages are the heat losses from the

open receiver and the low effectiveness of the storage system. Plans are under way to construct a 2.5 MW experimental facility in Spain by 1993 to validate the system before building a 30 MW central receiver/fossil fuel hybrid plant with about three hours storage capability (due to solar only) near Aqaba, Jordan, in 1995.

Cost of Electricity Generation from Solar-Thermal Electric Technologies

Costs of electricity production using solar-thermal electric technologies are given in Annex 6. The "calculated cost" is calculated from the quoted capital cost, quoted operating and maintenance cost, and quoted fuel cost (natural gas only) using the formula given in Annex 1, assuming a 10 percent discount rate. The cost has then been converted into 1990 dollars according to the method described in Annex 1. The "quoted cost" is the cost exactly as given in the reference.

Two points need to be emphasized. First, all costs, other than those listed in entries 9, 10, 14, 15, and 16, are predicted costs. Those noted above are based on the Luz plants operating in Southern California. The Luz SEGS (Solar Electric Generating System) power plants in California are the main source of cost data, because they are the main example of commercial grid-attached electricity production from solar-thermal technologies. Other plants do exist, but are smaller in scale and, in the main, experimental; because of the significant R&D expenditure involved, their power production costs (which are often not quoted) are not indicative of actual production costs.

Second, the graphs in this section have been plotted using the "calculated costs" (i.e., costs calculated on a common basis) rather than the quoted costs for electricity generation, in order to remove discrepancies caused by different assumptions. For example, for entry 29, the cost of electricity generation using central receiver technology assuming a 5 percent discount rate is 23 cents/kWh (1984 currency), but 34 cents/kWh (1984 currency) with a 10 percent discount rate, with all other parameters equal. On a less obvious note, for the same system, the study quotes a cost of electricity generation of 13 cents/kWh (1984 currency), assuming a 3.15 percent discount rate with "favorable tax credits." Recalculating the same using the formula in Annex 1, with the same 3.15 percent discount rate but *no* tax credits, gives 19.5 cents/kWh (1984 currency). When the cost could not be calculated because of insufficient data, the relevant references, together with quoted costs, were given in the table in Annex 6 but were not plotted on the graphs.


Figure 3.3 shows the calculated costs of electricity production from parabolic trough (solar/natural gas hybrid and solar only operation), parabolic dish, and central receiver solar-thermal technologies. The costs are for large-scale generation of about 50 kW and upward. Discussion on the costs of electricity production by each of the individual technologies follows.

Cost of Electricity Generation from Parabolic Trough Solar-Thermal Technology

Figure 3.4 shows the calculated costs of electricity production using parabolic trough technology (Annex 6, entries 1 to 16). The highlighted values are based on the Luz plants. The following may be noted from the graph:

- a. The current calculated cost for electricity production (solar with 25 to 30 percent natural gas) at the SEGS plants varies between 11 to 14 US¢/kWh (1990) due to the difference in quoted capital costs.
- b. The solar only values are higher, ranging from 13 to 20 US¢/kWh (1990), because of the lower capacity factor. The outlier based on data from entry 16, of 11 US¢/kWh (1990), stems from an usually low quoted capital cost compared with the other data and does not appear to be representative (Walton and Hall 1990).
- c. As the natural gas contribution is increased to 50 percent, the cost decreases further because of the increase in the capacity factor.
- d. The cost of electricity production is expected to decrease further to 10 to 14 US¢/kWh (1990) for solar only use by 2005. Thus, correspondingly, the cost of electricity production from the natural gas hybrid will also decrease. This decrease is caused by a decrease in capital costs and by a decrease in operating and maintenance costs, which constitute as much as 15 to 25 percent of the total cost of electricity production (Kearney and Price 1992; U.S. DOE 1992b). The U.S. Department of Energy is currently working on a project with the SEGS plants' owners and operators to reduce the latter, not only to make these plants more economical, but also with a view to using the lessons learned in other solar-thermal technologies, especially central receivers (U.S. DOE 1992b).
- e. Economies of scale in manufacture should result in further lowering of costs. This is illustrated in the dispersion of costs in 1991 in Figure 3.4. Entries 11 to 13 in Annex 6 are for 200 MW plants; all others (entries 1 to 10, 14 to 16) are for 80 MW plants. As can be seen, this results in a 30 percent decrease in costs from the 80 MW plants. (Compare entries 8 and 10 with 11 and 13, respectively). The costings for the 200 MW plants are based on technology proven on an experimental scale only, but one that Luz felt confident enough to offer to prospective clients in 1991 (IFC data 1991).


Figure 3.3. Calculated Cost of Electricity from Large-Scale Solar-Thermal Technology

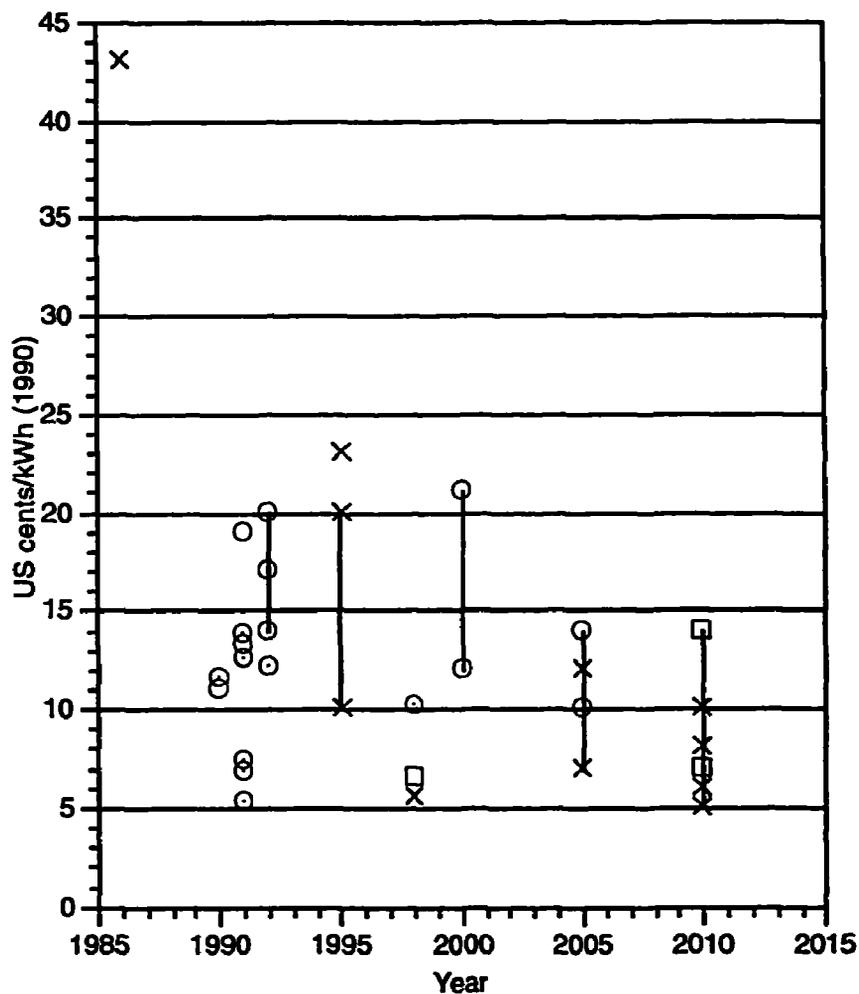

Costs for years up to and including 1992 are based on the technology of the time; costs for years after 1992 are from projected data.

KEY ○ parabolic trough (solar only)
 ⊙ parabolic trough (solar/natural gas hybrid)
 □ parabolic dish
 × central receiver

Figure 3.4. Calculated Cost of Electricity from Parabolic Trough Solar-Thermal Technology

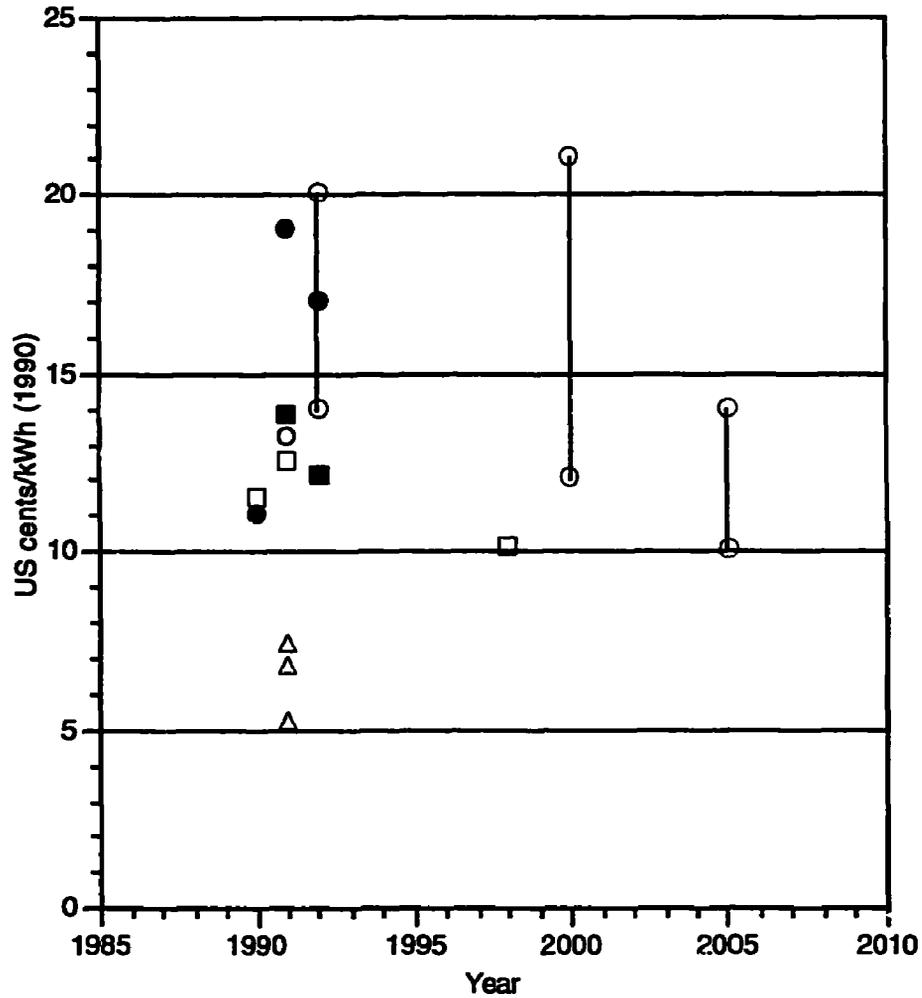

Highlighted values are based on data from the Luz plants in California.

Costs for years up to and including 1992 are based on the technology of the time; costs for years after 1992 are from projected data .


- KEY**
- solar only
 - solar/natural gas (25-30%) hybrid
 - △ solar/natural gas (50%) hybrid

Cost of Electricity from Parabolic Dish Solar-Thermal Technology

Figure 3.5 shows the expected decrease in costs over time for electricity generation from the parabolic dish system. The data points were obtained from only two sources (De Laquil and others 1993; U.S. DOE 1992c) and are all predicted costs. As shown by its predictions for 1998, the DOE expects the cost to fall faster than do De Laquil and others. The DOE's reasoning is based on an increase in production for a utility-scale market. The range quoted (5.8 to 20.3 US¢/kWh in 1990 dollars) is for a distributed system, whereas the single value (6.5 US¢/kWh in 1990 dollars) is for a modular system. This may be as a result of their projects for the development and commercialization of 5 kW and 25 kW dishes, as described in the section on parabolic dish technology.

Entries 26 to 28 in Annex 6 give more projections for costs from the U.S. DOE in terms of increasing market. The decrease in cost appears to stem both from improved technology and from increased production. According to the U.S. DOE (1992c) the cost of dishes has fallen from \$1500/m² in 1978 to \$150/m² in 1992. In comparison, Charters (1987) quotes \$300/m² in 1987, and De Laquil and others (1993) use a figure of \$300 to \$500/m² in 1995-2000, with the cost decreasing to \$150 to 200/m² in 2005-10.

Figure 3.5. Calculated Cost of Electricity from Parabolic Dish Solar-Thermal Technology

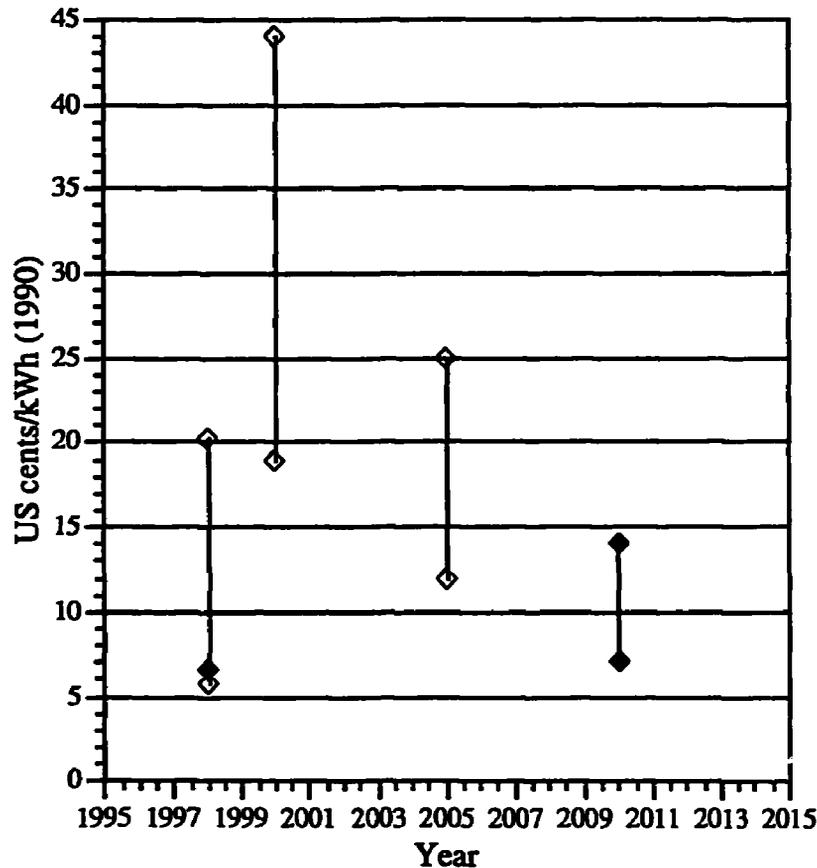


All costs are derived from projected data. Highlighted values are for larger-scale applications.

Cost of Electricity Generation from Central Receiver Solar-Thermal Technology

Figure 3.6 shows the costs of electricity production using central receiver technology (data from Annex 6). As can be seen, the predictions for the costs of electricity generation have decreased substantially in the last few years and are expected to decrease further. The outlier on the graph, 5.6 US¢/kWh (1990 dollars) in 1998, is the latest projection by the U.S. DOE, on the basis of current projects in progress. Entries 37 to 40 in Annex 6 show the expected decrease in costs with increasing market, according to the U.S. DOE. Thus, the main difference between the other predictions and that of the DOE is a faster expansion of the market, with a 200 MW plant being set up as early as 1998, compared with 2005, according to De Laquil and others (1993).¹⁴

Figure 3.6. Calculated Cost of Electricity from Central Receiver Solar-Thermal Technology

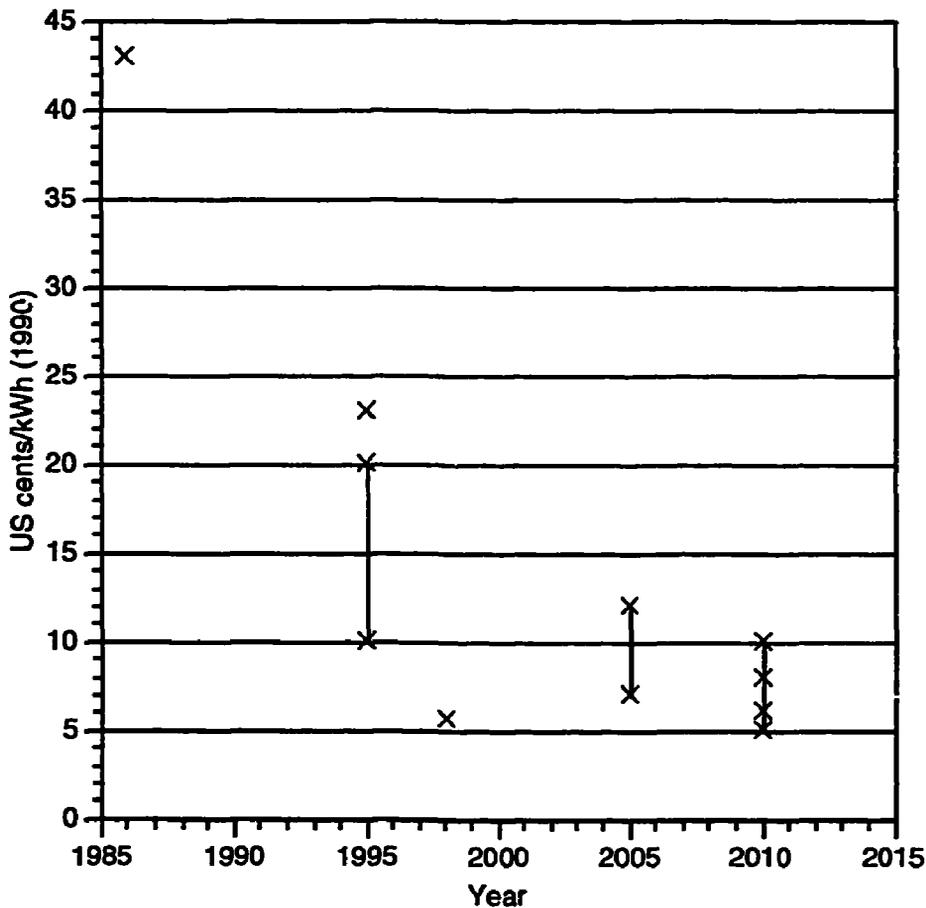


Costs through 1992 are based on the technology of the time; those after 1992 are projected.

14. The data points are from U.S. DOE 1992c; de Laquil and others (1993); and International Energy Agency (1987). De Laquil's figures are based on data gathered from several sources, including U.S. DOE material and studies by various U.S. utilities. The IEA data is from a U.S. DOE study in 1986.

Let us look at reasons for this expected decrease. First, capital costs of central receiver solar-thermal power plants from several sources are given in Table 3.1 and Figure 3.7. As can be seen, the costs do not show as marked a trend as the decrease in cost of electricity. This is because recent studies have taken account of storage capability for plants. Storage adds to capital costs but improves the utilization of the turbo-generator, and, since it costs much less than the latter, it reduces generation costs.

Table 3.1. Capital Costs of Central Receiver Plants

<i>Reference</i>	<i>Quoted capital cost (\$/kWp)</i>	<i>Capital cost (\$/kWp, 1990)</i>	<i>Year</i>	<i>Notes</i>
Palz (1978)	930 (1975)	2257	1975	
International Energy Agency (1987)	2900 (1984)	3645	1986	Study in 1986 U.S. DOE Five Year Research and Development Plan
Walton and Hall (1990)	2100 (1990)	2100	1990	"Overnight construction cost" (i.e. ignoring interest during construction); based on data from Luz.
International Energy Agency (1987)	2200 (1984)	2765	1995	Study in 1986 U.S. DOE Five Year Research and Development Plan
De Laquil and others (1993)	3000-4000 (assume 1992)	2804-3738	1995	
U.S. DOE (1992c)	2961 (1990)	2961	1998	
De Laquil and others (1993)	3000-2225 (assume 1992)	2079-2804	2005	
De Laquil and others (1993)	2900-3500 (assume 1992)	2710-3271	2005- 2010	
De Laquil and others (1993)	1800-2500 (assume 1992)	1682-2336	2005- 2010	

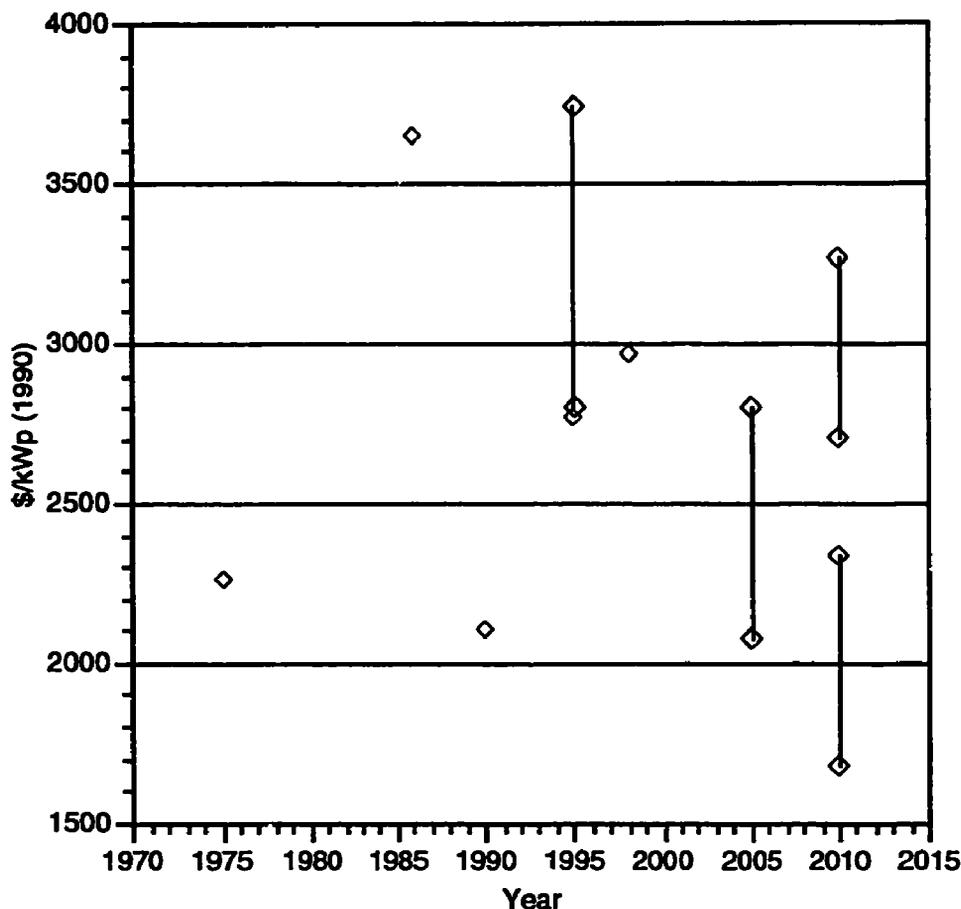Figure 3.7. Capital Costs of Central Receiver Solar-Thermal Plants

The capability for storage has a significant effect on the capacity factor and decreases the overall cost of electricity production markedly. For example, entry 30 in Annex 6 utilizes a capacity factor of 17 percent, compared with entry 31, which has a capacity factor of 70 percent. Both are originally from U.S. Department of Energy studies, the former in 1986 and the latter in 1992. The details are compared in Table 3.2. Note the higher capital cost of the more recent estimate but the lower overall cost of electricity production because of the higher capacity factor.

The single largest cost component of the system is the heliostat field. In the United States, this exhibits an "86 percent" learning curve, with costs decreasing by 14 percent as production doubles (International Energy Agency 1987). The U.S. DOE (1992c) describes a tenfold decrease in costs from \$1,000/m² in 1978 to just over \$100/m² today, with costs expected to decrease to between \$65/m² and 85/m² on mass production of the new stretched-membrane heliostats currently under development. De Laquil and others (1993) use similar values for heliostat costs in their estimates. It appears, however, that the time scale for achieving these technological improvements and for setting up the larger scale plants is shorter in the case of the U.S. DOE's costings.

Table 3.2. Comparison of Two Estimates for a Large-Scale Central Receiver Plant

Entry from Annex 6	Reference	Size (MW)	Capital cost (\$/kWp)	O&M costs (\$/yr)	Capacity factor (%)	Calculated cost US¢/kWh (1990)	Quoted cost US¢/kWh	Year
30 ^a	International Energy Agency (1987)	100	2,200 ^b	3000000 ^b (0.02 cents/kWh)	17 ^c	23	11.5 ^b	1995
31	U.S. DOE (1992c)	200	2,961 ^d	625464000 ^{d,e} (0.51 cents/kWh)	70	5.6	—	1998

^a From study in 1986 by U.S. DOE, "Five Year Research and Development Plan."


^b Costs are in 1984 dollars.

^c Capacity factor derived from quoted value for electricity production of 148 GWh/yr.

^d Costs are in 1990 dollars.

^e O&M costs derived from quoted value of 0.51 cents/kWh.

Figure 3.8. Load Dispatching Capability of Central Receiver Plants

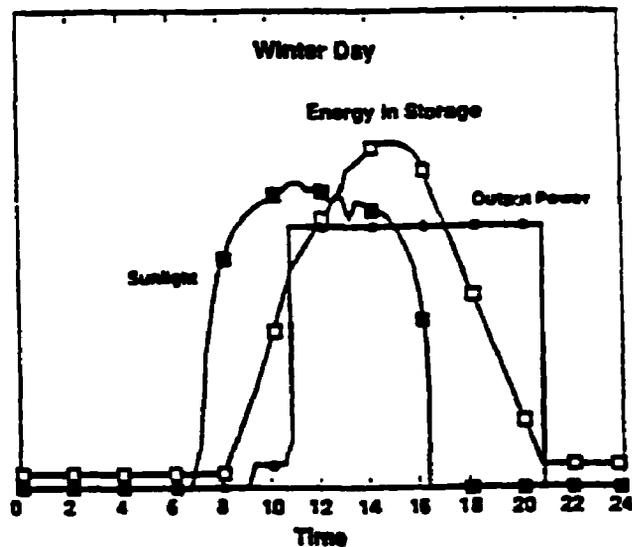

Source: U.S. DOE (1992d) "Solar Thermal Electric Five-Year Plan" Draft.

The Future of Solar-Thermal Electric Energy

Parabolic trough systems have so far been the most thoroughly tested of the solar-thermal technologies. The Luz plants have demonstrated and continue to demonstrate the capability of the technology to deliver power reliably to the grid. The capital costs, however, are high (13 to 20 US¢/kWh in 1990 dollars for solar-only operation). Some cost reductions are considered possible from economies of scale if the approach is expanded and if Direct Steam Generation (DSG) technology is developed and tested successfully. Costs are predicted to fall to 10 to 14 US¢/kWh (1990) by 2005.

The parabolic dish appears to be best suited for remote application, because of its modular nature. However, the technology still has not been commercialized. Costs are predicted to be in the range 7 to 14 US¢/kWh (1990) by the year 2010.

Central receiver systems (with thermal storage) have considerable promise. Cost projections are as low as 7 to 12 US¢/kWh (1990) in the next 10 years or so, and 5 to 10 US¢/kWh (1990) in the long term. However, the technology has still not been commercialized, and therefore the most important factor affecting future prospects is the time scale in which initial test facilities can be set up and operational problems can be highlighted and investigated. Some confirmation of the ability to reduce costs is the tenfold decrease just mentioned in the unit costs of heliostats over the period 1978 to 1992. Test facilities (with no storage capability) have been operated successfully, but these were never scaled up to commercial size. This may be because of the high capital cost, which stems from the inherently greater size of the plants, compared with the other solar-thermal technologies.¹⁵

15. De Laquil and others (1993) give an estimate of approximately \$300 million (1987 dollars) for the first 100 MW central receiver power plant (with thermal storage) and approximately \$450 million (1987 dollars) for the fifth to tenth 200 MW central receiver plant.

4

Photovoltaics

Introduction

The previous two chapters have described the conversion of solar energy to electricity through either the combustion of the product of photosynthesis to generate heat energy or the use of direct solar energy to heat a fluid and drive a turbo-generator. This chapter describes a completely different way of generating electricity from sunlight: converting light energy directly to electrical energy using photovoltaic (PV) devices.

Photovoltaic devices work by using an effect first discovered in 1839 by Becquerel but not used in commercial applications until the 1950s (see Annex 7; "The Photovoltaic Effect"). These early applications were in the space industry, and development of photovoltaics for terrestrial use began only in the 1970s. In the last two decades, however, development of photovoltaics has been nothing short of remarkable. The technology is described briefly and then discussed in relation to costs.

The recent and rapid advances in photovoltaic technology have been driven by technical innovations and contributions from several distinct scientific disciplines, including materials sciences, solid-state (semiconductor) physics, and optics. The technology is also notable for the variety of approaches being pursued by different laboratories and manufacturers, resulting in a healthy competition of ideas among innovators and in significant progress in the laboratory and in manufacturing.


The world market for photovoltaics was 57.9 MW in 1992, having increased from less than 1 MW in 1978 (Figure 4.1).¹⁶ Current uses of photovoltaic modules include the following:¹⁷

16. Data before 1980 is for U.S. manufacturers *only* and after 1983 is of PV manufacturers worldwide. The curve in Figure 4.1 was drawn in on the basis of the available data.

17. Information is derived from Sandia National Laboratories studies by Thomas, Post, and Poore (1989) and Stevens and others (1990); and from discussions with W.E. Howley and H.-D. von Lobbecke of Siemens Solar Industries, December 1992.

- Lighting (e.g., street lights, highway signs, parking lots, health clinics, and homes).
- Electricity for facilities in remote locations (e.g., refrigeration in remote health clinics or homes).
- Communications (e.g., telephones, radio communications, and emergency call boxes).
- Water pumping (e.g., village water supply, irrigation and drainage).
- Warning signals (e.g., navigational beacons such as buoys and lighthouses, audible signals, railroad signals, and aircraft warning beacons).
- Monitoring at remote sites (e.g., seismic recording, meteorological information, structural conditions and scientific research).
- Cathodic protection (e.g., preventing corrosion of pipelines, bridges, and buildings).
- Battery charging for vehicles.

Figure 4.1. Global Photovoltaic Market, 1976-1992

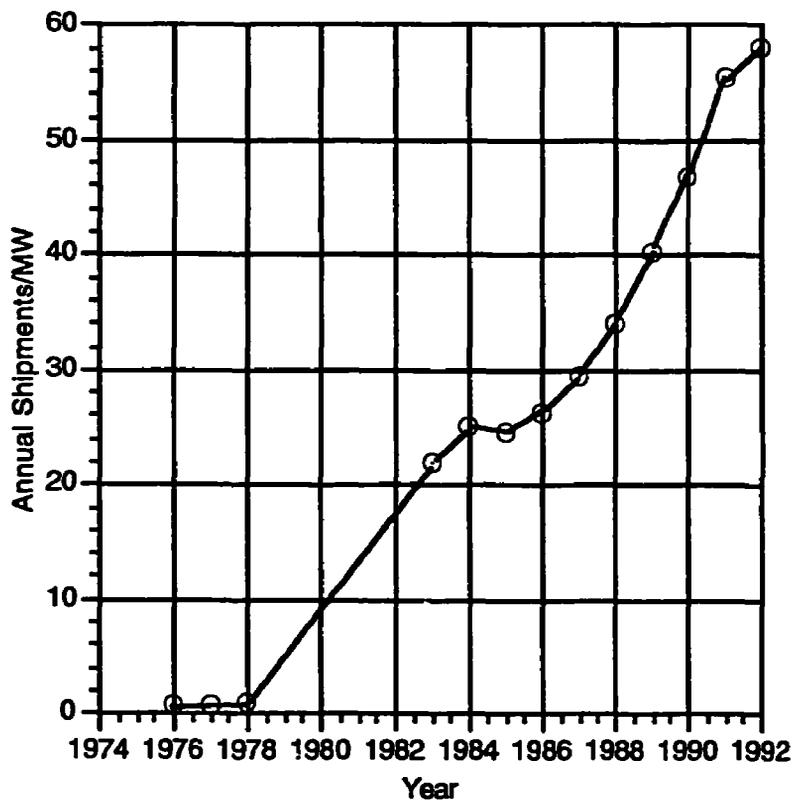

Sources: Maycock (1985, 1986, 1993); Carlson (1990); Costello and Rappaport (1980).

Photovoltaic Manufacturing and Technology

Photovoltaic modules are made from a number of materials and fabricated in a variety of different designs. An understanding of the designs and the direction of further improvements requires some knowledge of the principle of the photovoltaic effect (Annex 7 explains the effect for single-crystal silicon; the principle is the same for other semiconductor materials). In brief, when sunlight shines on these materials, it frees electrons from fixed sites. The wavelength of the sunlight absorbed depends on the “band gap” of the material. The materials are designed so that the electrons cannot return to these sites easily except by flowing through an external circuit, thus generating a current. A typical solar cell consists of a layer of semiconductor material sandwiched between conducting top and bottom layers. Photovoltaic modules are made up of several interconnecting solar cells, as the individual PV cells do not provide much power. PV modules are generally less than 1m² in size and deliver between 50 and 150 W of electric power (Thornton and Brown 1992). The whole is encapsulated in a clear, waterproof coating to protect the cells from the environment. Modules can be further interconnected to form arrays. These are generally of two types: “nontracking” arrays that remain in a fixed position and “tracking” arrays that follow the sun’s movement across the sky. The latter are more complex and more expensive, but they can optimize the system’s performance (Thornton and Brown 1992).

Efficiency

The efficiency of a solar cell is measured by the percentage of solar energy incident on the cell that is converted to electrical energy. This percentage varies with cell materials and design. Strategies for increasing cell efficiencies include the following (Kelly 1993; U.S. DOE 1991):

- The surface of the cell is textured with small, pyramidal shapes that allow light reflected off the surface to reflect back into the cell so that it can be absorbed.
- Electrical contacts on the front of the cell are designed so that the maximum amount of light can reach the semiconductor (e.g., top contacts can either be transparent or in the form of a metal grid with thin, conductive “fingers”).
- The amount of light that passes through the material without colliding with an electron can be minimized by selecting materials that are good light absorbers.
- Light-generated electrons and holes recombine easily if they reach a flaw or an impurity in the crystal. These flaws are minimized in polycrystalline or amorphous silicon by reaction with hydrogen.
- Electrical resistance within the cell can be minimized by good cell design.
- Stacking of cells with different band gaps can ensure that a broader range of the solar spectrum is captured, despite restrictions imposed by the band gaps of individual cells. These stacked configurations are called multijunctional devices.

A number of approaches are therefore available for increasing the efficiency of photovoltaic cells. However, there are trade-offs between increases in efficiency and resulting increases in costs. For example, gallium arsenide has a near-ideal band gap for single-junction devices, and it is a particularly good light absorber. But its cost is considerably greater than that of silicon. Hence, gallium arsenide has yet to penetrate the terrestrial market significantly. Similarly, although single-crystal silicon modules have achieved higher efficiencies (10 to 13 percent) than amorphous silicon modules (stabilized efficiency of 3 to 5 percent), the manufacturing cost of the latter is much lower. Thus, despite their lower efficiency, the amorphous silicon modules have captured a third of the world market.

Annex 8 summarizes data relating to photovoltaics from a large number of sources. Annex 9 shows only the efficiency data extracted from Annex 8, with the exception of items 117 to 128, 168 to 172, 225, and 267. These have not been used because in items 117 to 128 and 168 to 172 it is not clear whether the values are for cells or modules.¹⁸ In the case of items 225 and 267, the date for these projected efficiency values is not given. The data have then been plotted in several graphs according to semiconductor material (Figures 4.2 to 4.6). Figure 4.7 shows efficiencies of cells and modules where the semiconductor material has not been specified.


The following points need to be noted with regard to interpretation of these data and estimates:

- Efficiencies quoted for years after 1992 are projected; those quoted up to and including 1992 are actual values.
- Cell efficiencies, experimental efficiencies, and laboratory efficiencies have been taken to mean efficiency values obtained in the laboratory for individual cells.
- Module efficiencies and commercial module efficiencies have all been assumed to be field module efficiencies. Distinctions between prototype and field modules have been noted, if they have been specified by the source. The latter tend to be lower because of the effects of dust and other factors experienced in the field.
- Submodule efficiencies, where specified as such (i.e., for smaller modules), have been noted as prototype module efficiencies.
- Light-induced degradation occurs when amorphous silicon devices are operated, thus reducing the initial efficiency to a stabilized value after a few months of operation (see the explanation in the section on thin-film solar cells). The efficiencies have been noted as such in Figure 4.3.

18. Cells are typically a few square centimeters in size; submodules are about 1,000 square centimeters; and commercial modules are about 4,000 square centimeters. Cells are more efficient than modules because they are not encapsulated. Encapsulants around modules reduce the light reaching the interconnected cells. Efficiency of field modules may be reduced further because of the effect of dust or other factors such as temperature.

- Efficiency also varies with manufacturing method. For example, a single-crystal silicon cell manufactured by the dendritic web method differs in efficiency from the same cell made by the Czochralski method (see the section on “thick-film” cells).
- The lines drawn on the graphs are only to aid the reader in visualizing trends and are not based on actual efficiency values.

Figure 4.2. Efficiencies of Crystalline Silicon Cells and Modules

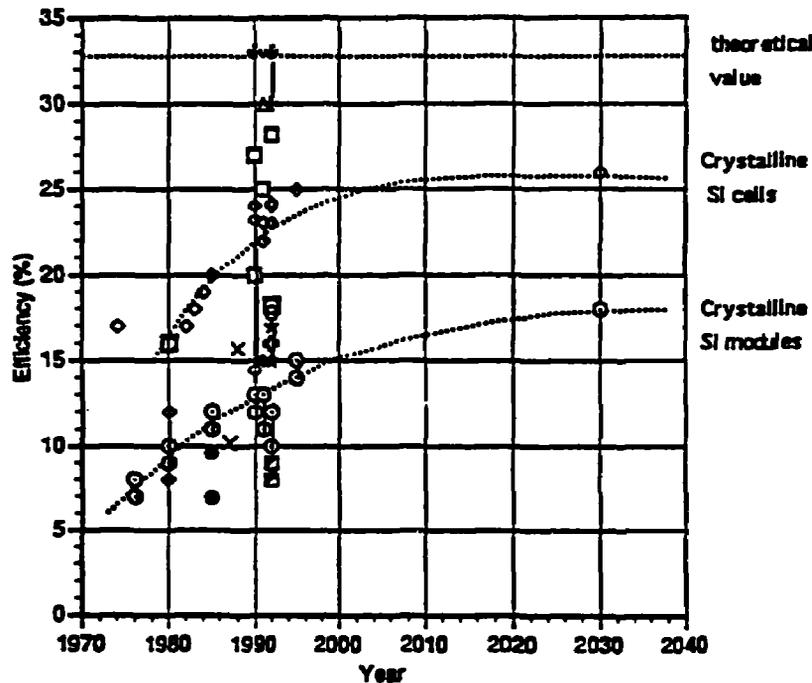


KEY

⊙	Crystalline Si (field module)
○	Crystalline Si (prototype module)
◇	Crystalline Si (laboratory cell)
+	Crystalline Si (theoretical limit)
□	Crystalline Si (concentrator; laboratory cell)
★	Crystalline Si (concentrator; field module)
△	Crystalline Si (concentrator; theoretical limit)
◆	Thin film crystalline Si (laboratory cell)
◇	Thin film crystalline Si (field module)
●	Thin film Si on steel (laboratory cell)
×	Thin film Si on ceramic (laboratory cell)
▣	Polycrystalline Si (field module)
□	Polycrystalline Si (laboratory cell)

All efficiencies through 1992 are actual; those after 1992 are projected.

Figure 4.3. Efficiencies of Amorphous Silicon Cells and Modules

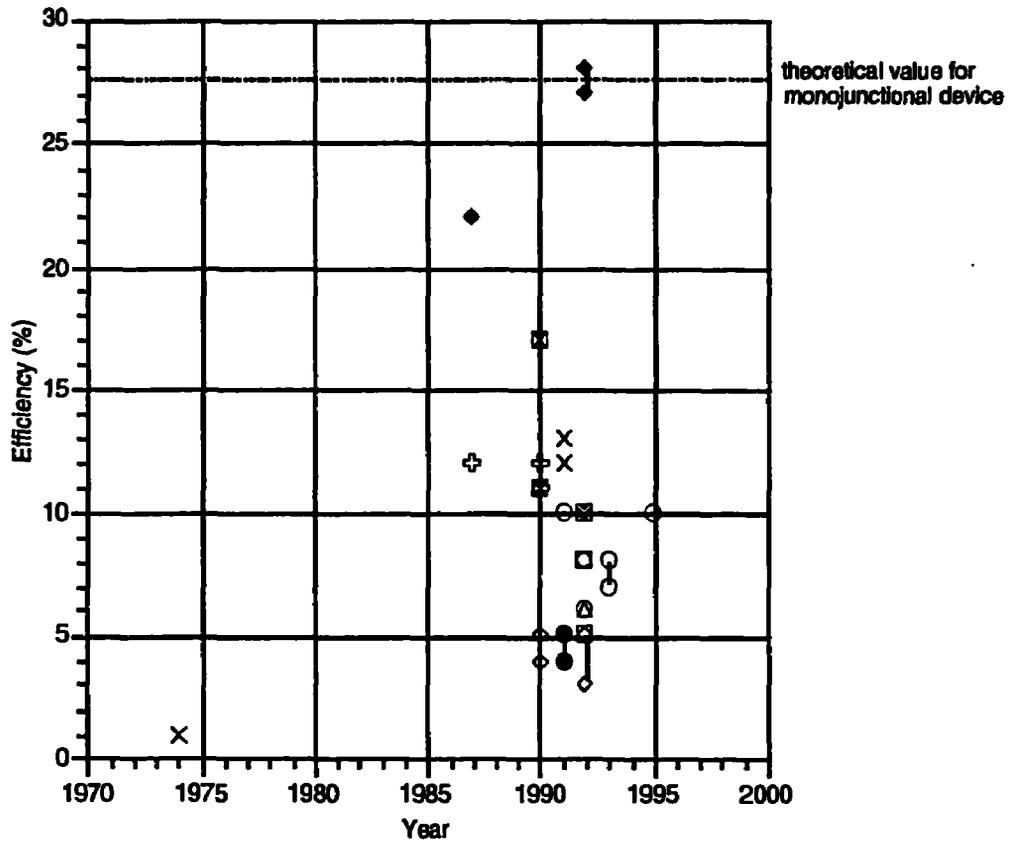


KEY

- ◇ amorphous Si (field module) (stabilized value)
- amorphous Si (field module) (not specified)
- amorphous Si (prototype module) (stabilized value)
- amorphous Si (prototype module) (not specified)
- △ amorphous Si (laboratory cell) (stabilized value)
- × amorphous Si (laboratory cell) (initial value)
- ⊕ amorphous Si (laboratory cell) (not specified)
- ◆ amorphous Si (theoretical limit)
- ⊠ amorphous Si (multijunctional laboratory cell) (stabilized value)
- ⊞ amorphous Si (multijunctional laboratory cell) (not specified)
- amorphous Si (multijunctional field module) (stabilized value)
- ⊠ amorphous Si (multijunctional prototype module) (stabilized value)

All efficiencies through 1992 are actual; those after 1992 are projected.


Figure 4.4. Efficiencies of Cadmium Telluride (CdTe) Cells and Modules

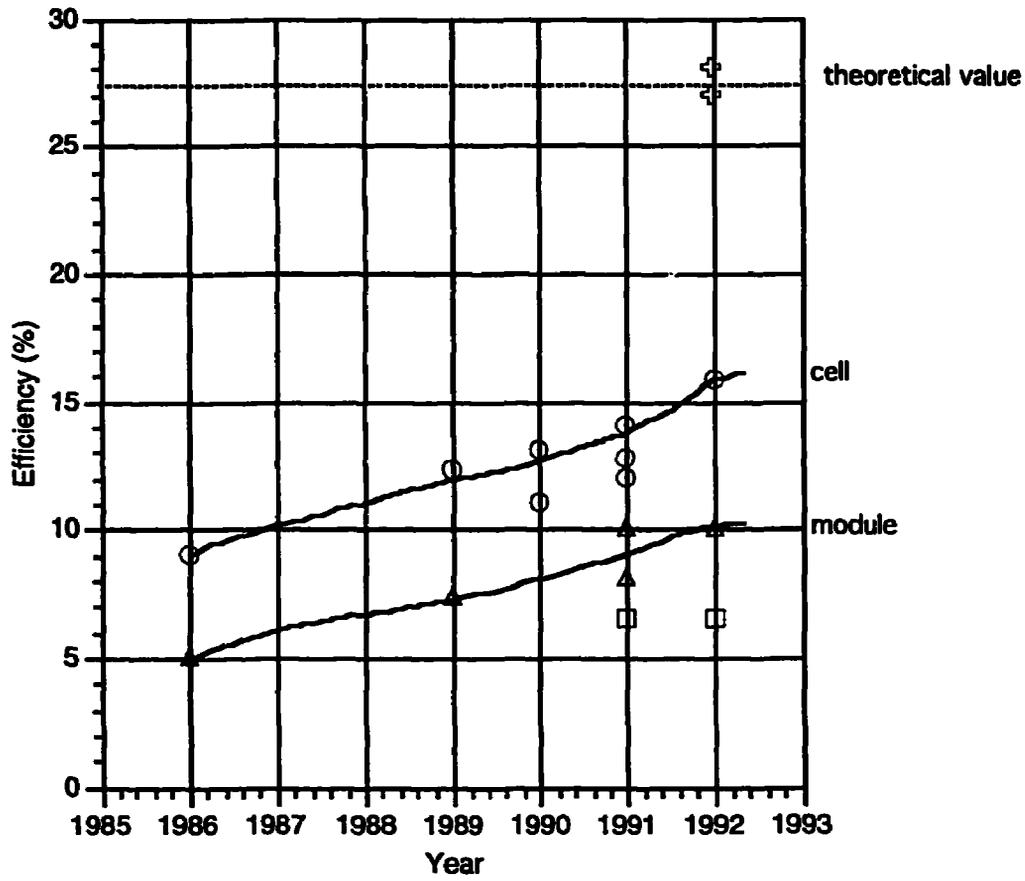

KEY

- CdTe (field module)
- △ CdTe (prototype module)
- CdTe (laboratory cell)
- ⊕ CdTe (theoretical limit)

Figure 4.5. Efficiencies of Copper Indium Diselenide (CIS) Cells and Modules

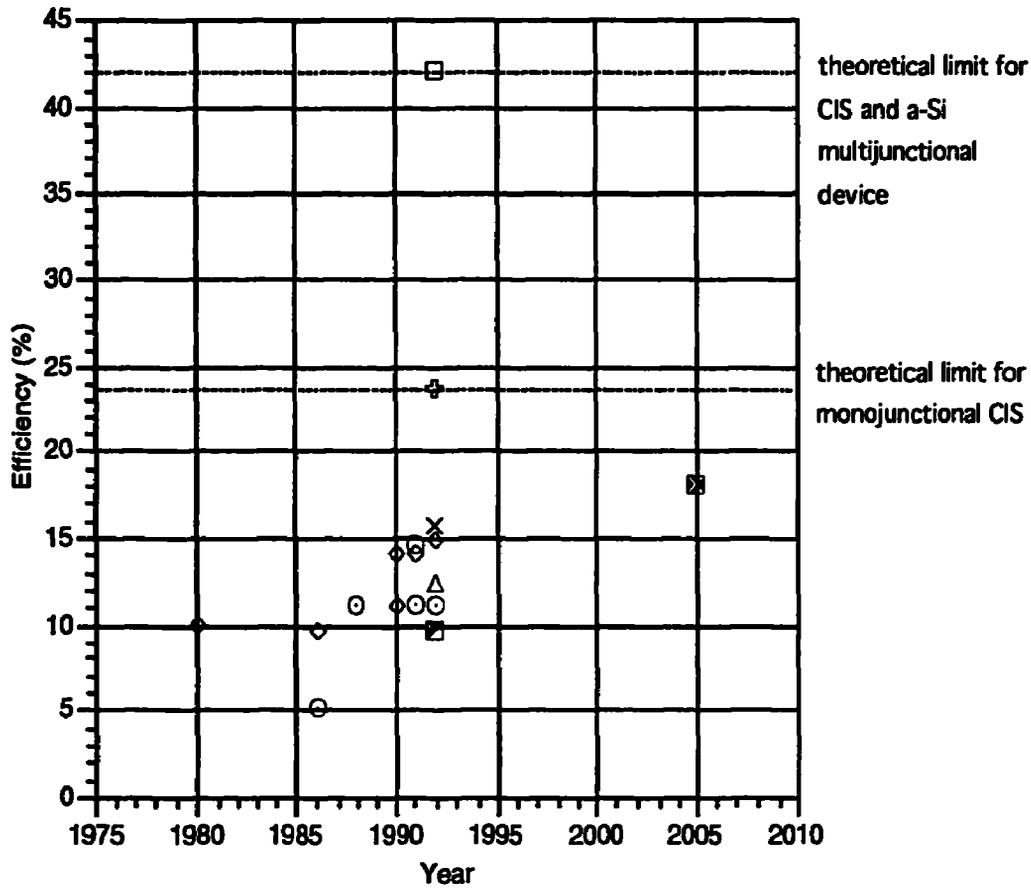


KEY

- CIS (field module)
- CIS (prototype module)
- ◇ CIS (laboratory cell)
- ⊕ CIS (theoretical limit)
- × CIS and amorphous Si (multijunctional laboratory cell) (initial value)
- CIS and amorphous Si (multijunctional laboratory cell)
- △ CIS and amorphous Si (multijunctional prototype module) (initial value)
- CIS and amorphous Si (multijunctional; theoretical limit)
- ⊠ CIS and amorphous Si (multijunctional field module) (stabilised value)

All efficiencies for years up to and including 1992 are actual; those after 1992 are projected.


Figure 4.6. Efficiencies of Gallium Arsenide (GaAs) Cells and Modules

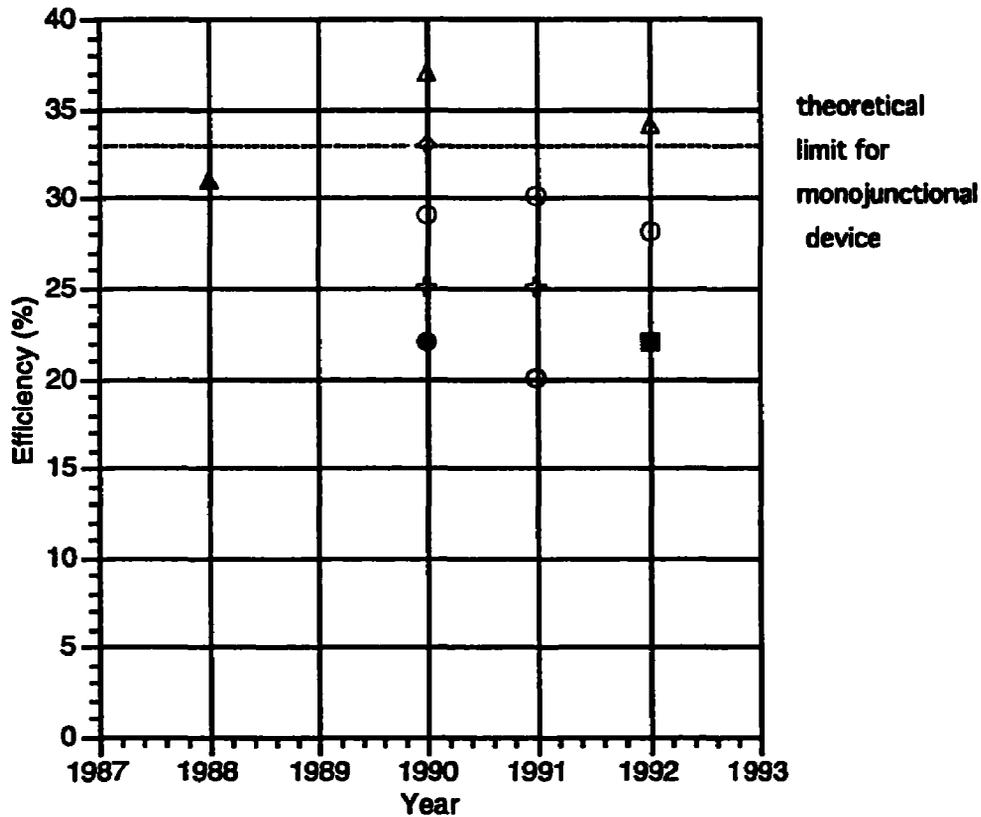**KEY**

- GaAs (concentrator; prototype module)
- GaAs (concentrator; laboratory cell)
- ▲ GaAs on single crystal Si (concentrator; multijunctional laboratory cell)
- △ GaAs on GaSb (concentrator; multijunctional laboratory cell)
- GaAs grown on Si or Ge support (laboratory cell)
- GaAs grown on GaAs support and then removed (laboratory cell)
- ⊕ Crystalline GaAs (laboratory cell)
- ◇ Crystalline GaAs (theoretical limit)

All efficiencies for years up to and including 1992 are actual.

Figure 4.7. Efficiencies of Photovoltaic Cells and Modules

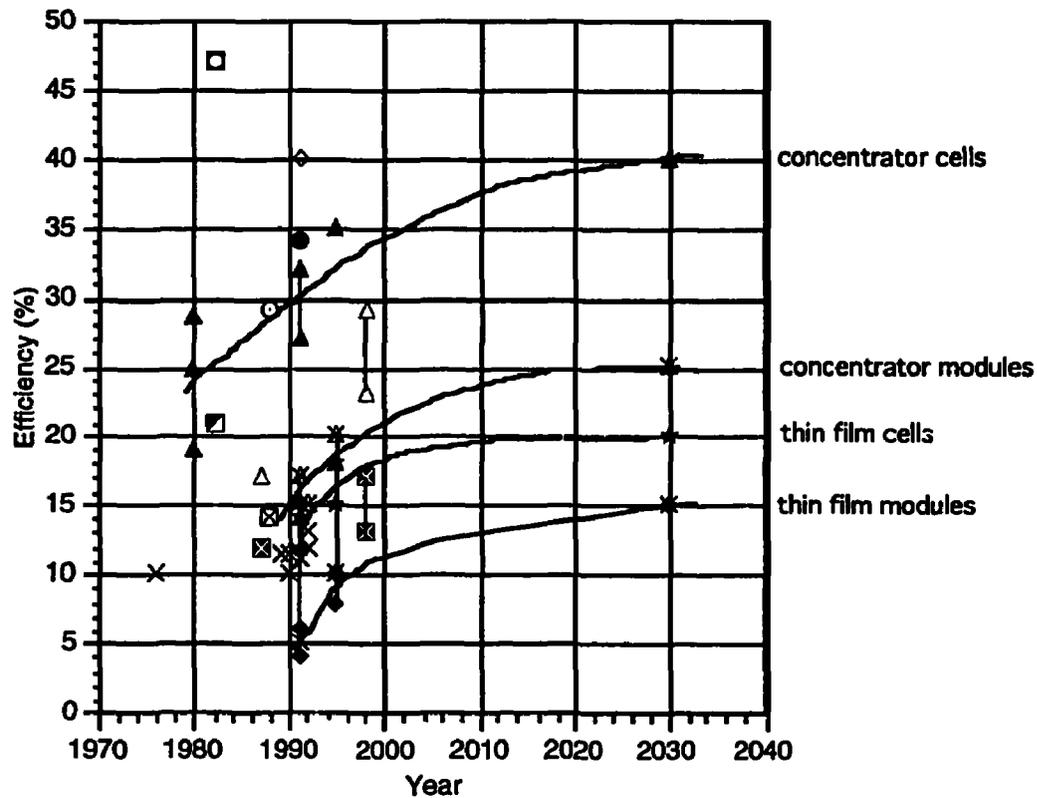

KEY

×	Not Specified (commercial modules)
●	Not Specified (cells)
○	Multijunction concentrator laboratory cells
◇	Multijunction concentrator laboratory cells; theoretical limit
◆	Flat plate thin film commercial modules
★	Flat plate thin film laboratory cells
△	Concentrators (commercial modules)
▲	Concentrators (laboratory cells)
⊠	Flat plate commercial modules
⊞	Tandem cell with 2 amorphous layers (laboratory cell)
⊙	Tandem cell with 2 amorphous layers (theoretical limit)
⊠	Tandem cell with 2 crystalline layers (laboratory cell)
□	Tandem cell with 2 crystalline layers (theoretical limit)

All efficiencies through 1992 are actual; those after 1992 are projected.

The following general conclusions may be drawn from the graphs:


- *Efficiencies have increased in the last few years.* For example, efficiencies of crystalline silicon modules have increased from 7 to 8 percent in 1976 to 10 to 13 percent in 1992 (Figure 4.2); for cadmium telluride thin-film prototype modules, from 5 percent in 1986 to 10 percent in 1992 (Figure 4.4); and for CIS thin-film prototype modules, from 5 percent in 1986 to 11 percent in 1992 (Figure 4.5).
- *Cell efficiencies are greater than module efficiencies.* The time lag is not only different for different types of photovoltaic module but is also different for different time periods.¹⁹ For example, in the case of crystalline silicon, the time lag appears to have been about five years between 1980 and 1985; but modules are not expected to reach efficiencies of 17 percent (achieved by cells in 1984) till 2030 (Figure 4.2).
- *Concentrator and multijunctional cells are more efficient than monojunctional cells operating under regular light.* For example, amorphous silicon monojunctional cells have stabilized efficiencies of 6 percent, whereas the multijunctional cells have stabilized efficiencies of 10 percent (Figure 4.3). This is also partly because stacking reduces light-induced cell degradation. Crystalline gallium arsenide cells under regular light have exhibited efficiencies of 25 percent, whereas the concentrator cells have efficiencies of 27 to 30 percent (Figure 4.6). Similarly, under regular light, crystalline silicon cells have efficiencies of 22 to 24 percent, whereas the concentrator cells have achieved efficiencies of 28 percent (Figure 4.2).
- *The scope for further efficiency improvements is significant.* Practical theoretical efficiencies for monojunctional cells, under regular light, are about 30 to 33 percent for crystalline silicon, 27 to 28 percent for amorphous silicon, 27 to 28 percent for thin-film cadmium telluride, 23.5 percent for thin-film copper indium diselenide, and 33 percent for crystalline gallium arsenide. Theoretical values are given in the literature of 40 percent for multijunctional concentrator cells, 29 percent for a tandem cell with two amorphous layers, 47 percent for a tandem cell with two crystalline layers, and 42 percent for mechanically stacked amorphous silicon and copper indium diselenide.

Details in Figures 4.2 to 4.6 are discussed further in the following sections.

The scale of the variety in solar cell manufacture and design is illustrated by Figure 4.8 and can be seen in the charts on efficiency (Figures 4.2 to 4.7). Many devices are also being investigated and manufactured, and allowing for these makes the total range of approaches being followed by scientists and engineers in research laboratories and in commercial companies even larger. As noted, no dominant approach has emerged, and the competition among ideas is intense and healthy. Some common types of solar cells are described in more detail below.

19. However, Anderson (1992) describes a time lag of 5 to 7 years between commercial and laboratory units, on average.

Figure 4.8. Variety In Photovoltaic Cells and Manufacturing Processes

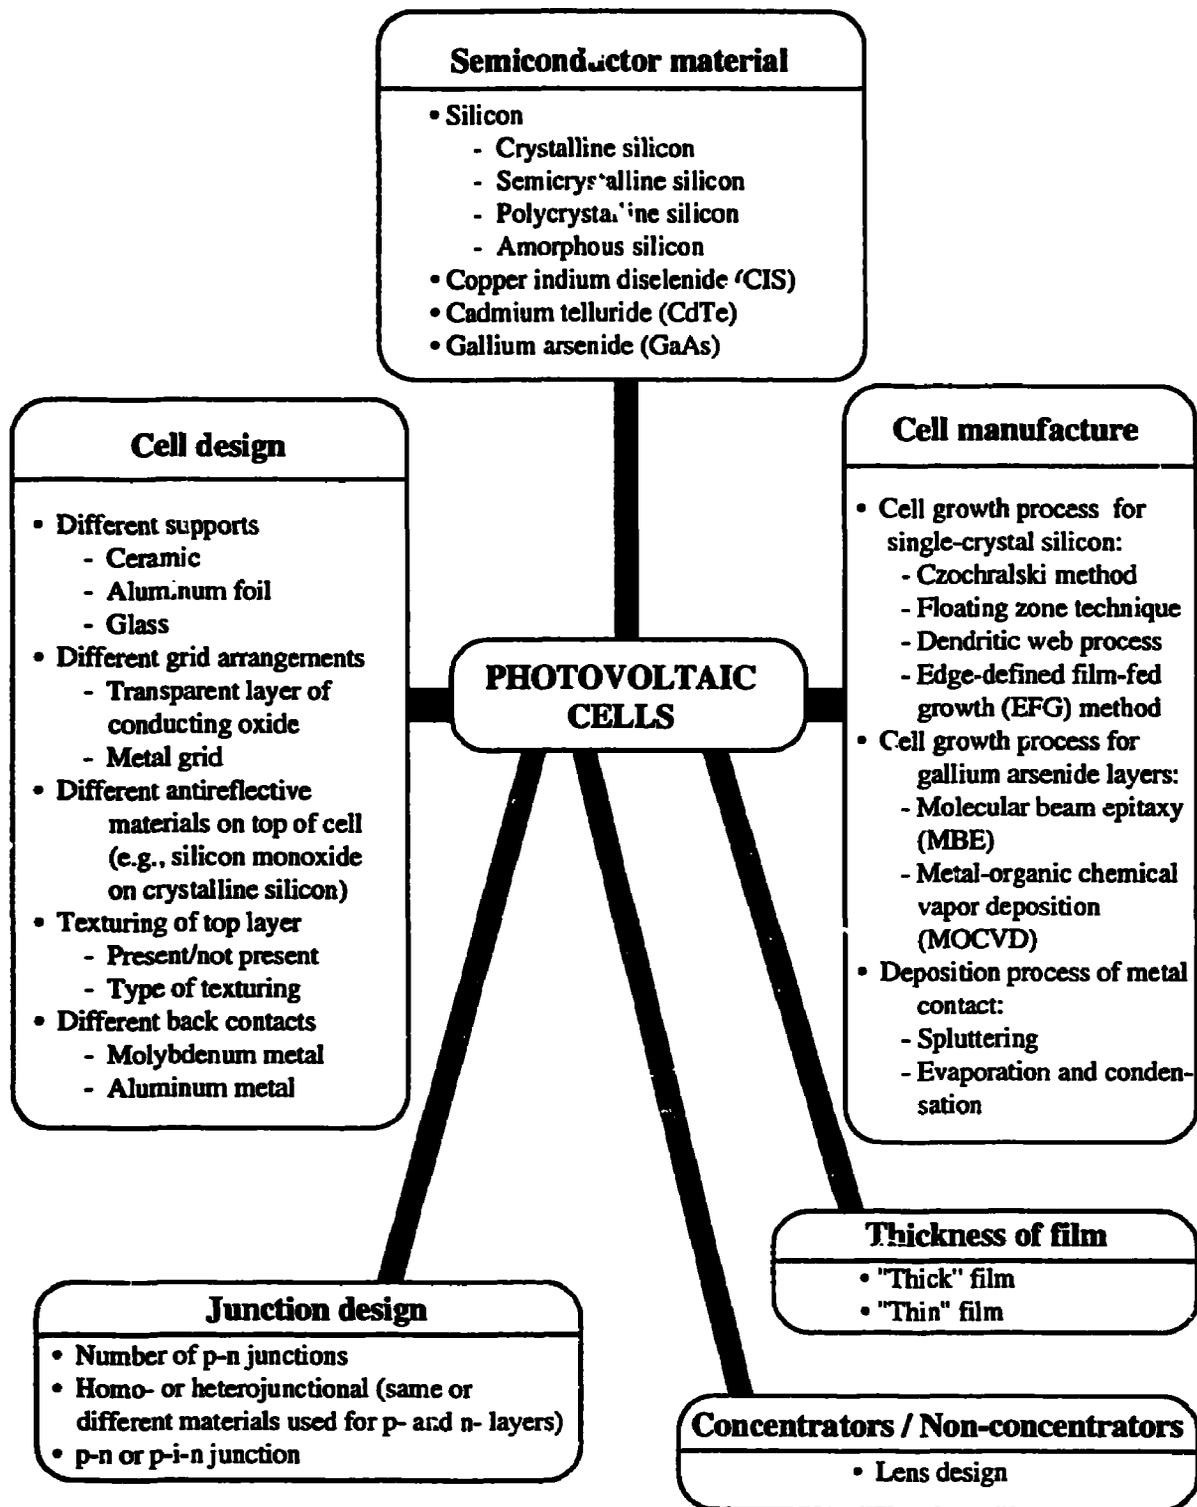

Crystalline Silicon Solar Cells ("Thick" Film)

Single-Crystal Silicon. In 1980, single-crystal silicon cells accounted for 90 percent of commercial PV cells. In 1990, they were only 35 percent of the total world market, with amorphous silicon at 31 percent and semicrystalline silicon at 33 percent.²⁰

The cell contains a wafer cut from a single crystal of silicon. The raw material is waste silicon from the semiconductor industry, which PV manufacturers purchase at a reduced price (Remy and Durand 1992; Kelly 1993). The silicon is melted and regrown into large crystals. The two most established methods for this are the Czochralski method and the floating-zone technique. In the former, a seed crystal is dipped into a reservoir of molten silicon and slowly drawn from it to form a large cylindrical crystal; in the latter, a rod of polysilicon is placed above a seed crystal, and movable heating coils are used to melt the polysilicon rod at the interface, allowing it to resolidify as a single crystal (see U.S. DOE 1991; Green 1993 for descriptions of the methods). These crystals are then sliced into wafers.

This process results in the waste of much silicon, as the cylindrical ingots are much larger in diameter than the required wafers. Alternative methods that minimize waste and cut manufacturing costs, such as the use of thinner saws to slice the wafers or direct growth of thin crystalline sheets or ribbons of silicon are being investigated actively to reduce manufacturing costs (see Green 1993; Carlson, 1990; and U.S. DOE 1991). These methods include (a) the dendritic web approach, in which two dendrites a few centimeters apart are drawn from the melt, trapping a thin sheet of molten silicon in between, which solidifies; (b) the edge-defined film-fed (EFG) growth method, in which molten silicon moves by capillary action between two faces of a graphite die and a thin sheet is drawn from the top of the die; and (c) the S-Web approach, in which a carbon web is coated with silicon as it is drawn through a silicon melt.

One potential problem in PV manufacture is that the quantity of silicon that will be required in the near future, as the market of photovoltaics increases, is in excess of the current silicon waste produced by the semiconductor industry, indicating that silicon production specifically for the PV industry will be required. Silicon is the second most abundant element on Earth, but it is present in the form of silica (silicon and oxygen) and silicates (compounds of silicon, oxygen, metals, and possibly hydrogen). Silica is processed into silicon, which is then refined. The silicon used in PV manufacture can be less pure than that needed for semiconductors, but current production procedures are expensive, and some work is being carried out to develop new, low-cost methods for silicon production (U.S. DOE 1991; Green 1993). However, some authorities feel that this matter merits more attention (Remy and Durand 1992; and Pistella 1992).

20. See IEA (1987) and U.S. DOE (1991). However, Meridian Corporation (1992) described the 1990 market share as single-crystal silicon (35 percent), polycrystal silicon (20 percent), amorphous silicon (25 percent), and concentrators (1 percent). Kelly (1993) states that "about 45 percent of the modules sold in 1990 were made from traditional crystalline materials and 35 percent from thin films."

Efficiencies of single-crystal cells and modules are shown in Figure 4.2. Currently, efficiencies of experimental cells are 22 to 24 percent, and those of modules (based on field experience) are 11 to 13 percent. Theoretical efficiencies for single-crystal silicon are 30 to 33 percent. A multijunction device of a mechanically stacked gallium arsenide cell on top of a single-crystal silicon cell is reported to have achieved 31 percent efficiency under concentrated light in 1988 (see the section on solar concentrator cells; U.S. DOE 1991).

Polycrystalline Silicon. Polycrystalline silicon is also used for PV cell manufacture. Here, the semiconductor material consists of many crystals of silicon. The associated problems in terms of increased electrical resistance caused by the electrons and holes meeting at cell boundaries and recombining are overcome to a certain extent by reaction with hydrogen or oxygen to fill the broken bonds at the grain boundaries or by heating and cooling the material so that the crystals are enlarged further, thus reducing the number of cell boundaries within the material (U.S. DOE 1991). Nevertheless, polycrystalline cells are less efficient than single-crystal silicon cells, with efficiencies of 8 to 9 percent for field modules and 18 percent for experimental cells (Figure 4.2).

However, the corresponding decrease in efficiency is compensated to a certain extent by the lower cost of manufacture for these cells. Silicon wafers are manufactured by cooling molten silicon in a crucible in a controlled manner to form an ingot, which is then cut into smaller blocks and sliced into wafers. Methods for producing thin films of silicon on different supports (such as ceramic and steel) are also being investigated, with the intention of reducing costs, as less silicon is used in these devices.

Thin-Film Solar Cells

Thin films require substantially less active material than single-crystal silicon. Films are typically of thicknesses 0.001 to 0.002 mm, as opposed to about 0.3 mm for a typical thick-film single-crystal or polycrystalline silicon cell (Thornton and Brown 1992). Manufacturing techniques are also different, with thin layers of different materials being deposited sequentially, in a continuous process, on top of each other on a substrate (usually glass), from the back electrical contact (usually a thin layer of transparent oxide) to the semiconductor material to the antireflective coating to the front electrical contact, to eventually make up the module. The sheets are then divided into individual (interconnected) cells by scoring with a laser beam (U.S. DOE 1991). The manufacturing procedures are potentially much less costly than growing single crystals, because in addition to using as little as 1 percent of active material compared with the latter, they hold great potential for low-cost, automated, large-scale production (Kelly 1993; Zwiebel and Barnett 1993; U.S. DOE 1991).

Amorphous Silicon. Amorphous silicon (a glassy alloy of silicon and about 10 percent hydrogen) was regarded as an insulator until 1974, when it was demonstrated to be a semiconducting material. By 1990, amorphous silicon PV cells formed 31 to 32 percent of the world market for PVs (Carlson and Wagner 1993; U.S. DOE 1991). The active cell has slightly different construction, with a neutral layer of amorphous silicon (the "i" or

intrinsic layer) present between the thin, highly doped, top p-layer and the bottom n-layer. It is here that the electron-hole pairs are generated, thus facilitating their movement, as electrons and holes are far less mobile in amorphous silicon than crystalline silicon, and doping worsens this situation (U.S. DOE 1991).

The first cell had an initial efficiency of 1 percent in 1974, which decreased on exposure to light to as little as 0.25 to 0.5 percent (Carlson and Wagner 1993). Efficiencies for amorphous silicon cells are shown in Figure 4.3. It is worth noting that a decrease of 10 to 20 percent from the initial efficiency occurs in the first few months of use because of light-induced degradation of the amorphous silicon (Carlson and Wagner 1993; U.S. DOE 1991). Currently, stabilized monojunctional experimental cell efficiencies are about 6 percent, and stabilized field module efficiencies are in the range of 3 to 5 percent.²¹ Estimates in the literature for theoretical efficiency limits for single-junction amorphous silicon cells are 22 percent and 27 to 28 percent (Cody and Tiedje 1992 for the lower value; Kelly 1993 for the higher).

Multijunctional devices, with higher efficiencies, have also been developed for amorphous silicon. Use of this configuration not only improves the overall efficiency of the cell but, in the case of amorphous silicon, results in a further increase in the overall efficiency of the individual cells because the thinner layers of material result in less light-induced degradation (International Energy Agency 1987; U.S. DOE 1991). The band gap of amorphous silicon can be altered by the formation of alloys with germanium, carbon, tin, and nitrogen. Thus, typically three amorphous silicon cells with different band gaps are stacked to form a multijunctional cell. Multijunctional amorphous silicon cells have stabilized laboratory efficiencies of 10 percent (6 percent for field modules; Figure 4.3). An amorphous silicon cell has also been stacked on top of a CIS cell, achieving initial efficiencies in the laboratory of 16 percent and 12 percent for submodules (Figure 4.5).

The lower efficiency of the modules relative to single-crystal silicon is balanced by their significantly lower cost per unit area due to the smaller quantity of active material needed because of its high absorptivity (40 percent greater than single-crystal silicon), as well as the lower temperatures required for production and the use of low-cost substrates for deposition of the active material (U.S. DOE 1991).

Cadmium Telluride (CdTe). Efficiencies of cadmium telluride-based laboratory PV cells are in the range of 12 to 16 percent, with prototype modules having efficiencies of 8 to 10 percent (see Figure 4.4.). Theoretical efficiencies are estimated at 27 to 28 percent. CdTe cells do not show the light-induced instability found in amorphous silicon. Two cell designs are predominant. In the first, CdTe forms the p-layer, and cadmium sulfide forms the n-layer. However, CdTe is highly resistive when doped, and this problem has been

21. The higher values shown in Figure 4.3 for module efficiency of 4 to 7 percent are from Meridian Corporation (1992); this source does not specify whether the values are initial or stabilized efficiencies. Several other sources quote stabilized efficiencies as 3 to 5 percent. Similarly, the cell efficiencies of 11 to 12 percent cited by Carlson (1992) are not classified as initial or stabilized values. The lower value of 6 percent is from Kelly (1993).

circumvented in another design that makes CdTe into an intrinsic layer, sandwiched between p-zinc telluride and n-cadmium sulfide (U.S. DOE 1991). Cadmium telluride-based cells are about to be commercialized, after benefiting from the experience of research in the late 1970s and early 1980s, when several companies unsuccessfully attempted to commercialize these cells (Zweibel and Barnett 1993).

Copper Indium Diselenide (CIS). Efficiencies of copper indium diselenide PV cells are in the range of 14 to 15 percent, with prototype modules demonstrating efficiencies of 11 percent (see in Figure 4.5). The theoretical efficiency for single-junction thin-film CIS cells is estimated as 23.5 percent by one source (Kelly 1993). These cells consist of a p-layer of CIS and an n-layer of cadmium sulfide (U.S. DOE 1991). Copper indium diselenide is also both being used in various designs of multijunctional cells (U.S. DOE 1991). An amorphous silicon cell has also been stacked on top of a CIS cell, achieving initial efficiencies in the laboratory of 16 percent (12 percent for submodules; Figure 4.5).

CIS not only has high absorptivity, absorbing as much as 99 percent of the incident light, but also displays good stability with regard to light degradation (U.S. DOE 1991). CIS modules are amenable to low-cost, large-scale manufacture and are seen by many as the "model" thin film. It is worth noting, however, that indium supply may become an issue if CIS modules enter large-scale production. Indium is thought to be as abundant as silver, but current supply capacity cannot meet heavy future demand. This could well lead to an increase in indium prices that would impede growth of CIS module production. However, several companies have expressed interest in producing sufficient supplies of indium (Zweibel and Barnett 1993).

Concentrator Solar Cells

The high cost of the active semiconductor material has stimulated research into methods to reduce this cost further. One innovative idea is the concentrator cell (Boes and Luque 1993). Here, mirrors or Fresnel lenses are used to concentrate the sunlight onto a smaller-area photovoltaic cell, allowing low-cost mirrors or lenses to replace high-cost PV cells. Furthermore, because only a small area of PV cell is required, one can pay a slightly higher price for it and still have a lower overall cost compared with a conventional PV cell of the same material. Both single-crystal silicon and single-crystal gallium arsenide have been used in concentrator cells, as well as in various multijunctional cells. Cell efficiency also appears to increase in concentrator cells, although the increase seems to depend on factors such as cell material and design (U.S. DOE 1991). However, concentrator cells, unlike conventional cells, cannot use diffuse sunlight and thus require direct-beam insolation, which is more variable than the total (diffuse plus direct) insolation at a particular site.

Silicon. Several silicon PV concentrator systems have been installed and are operational (Boes and Luque 1993). The efficiencies of laboratory concentrator cells are in the range 20 to 28 percent and of commercial concentrator modules under 20 suns are 15 to 17 percent (Figure 4.2).

Gallium Arsenide. Gallium arsenide is an excellent active material for use in PV cells because its band gap of 1.43 eV is near ideal for single-junction solar cells; it also has high absorptivity, and it is relatively insensitive to heat (U.S. DOE 1991). The last factor is particularly important in concentrator devices, where the cell is subjected to high temperatures. Single-crystal gallium arsenide, however, is very costly, and therefore its use in concentrator devices is more economical than its operation under regular light. To date, because of its high cost, gallium arsenide has been used primarily in modules for applications in space rather than for large-scale terrestrial uses. Approaches to reduce module costs include fabrication of cells on cheaper substrates, such as silicon or germanium (U.S. DOE 1991). Efficiencies for gallium arsenide cells under regular light are 20 to 25 percent; efficiencies for concentrator cells are in the range 28 to 30 percent, with concentrator prototype modules showing efficiencies of 22 percent (Figure 4.6). It is worth noting that gallium arsenide devices show little difference between module and cell efficiencies.

Much of current research on multijunctional cells focuses on gallium arsenide as either one or as all of the component cells. In 1988, the record for the highest efficiency (31 percent) PV device was set by a gallium arsenide cell on top of a single-crystal silicon cell under concentrated light (U.S. DOE 1991). The current record for the highest efficiency cell is also held by a multijunction device consisting of a gallium arsenide cell on top of a gallium antimonide cell. Under concentrated light of 100 suns, an efficiency of 34.2 percent was achieved.²²

Environmental Effects

From an environmental point of view, the use of photovoltaics for electricity generation is a benign operation.

The solar cells themselves are made from either silicon or certain heavy metals, such as gallium arsenide, cadmium telluride, and copper indium diselenide. Silicon is obtained from silica by reaction with hydrogen, to form silicon and carbon dioxide (U.S. DOE 1991). Thus, a small quantity of carbon dioxide, dependent on the amount of silicon, is released to the atmosphere. However, when compared with the amount of carbon dioxide released from a fossil fuel power station over its life, this quantity is negligible. At the manufacturing stage, silicon dust is an important occupational hazard, but its risk can be minimized with careful handling (Holdren, Morris, and Mintzer 1980). In the case of disposal, silicon solar cells are thought not to pose any apparent health and safety risk (Zweibel and Barnett 1993).

The toxicity of the other heavy metals is worth some consideration. Cadmium telluride, cadmium sulfide, copper indium diselenide, and gallium arsenide pose occupational risks and a hazard to the public if the arrays are consumed by fire (see both

22. U.S. DOE (1991) and Boes and Luque (1993); however, Carlson (1990) gives a value of 37 percent for apparently the same cell.

Holdren, Morris, and Mintzer 1980 and Zweibel and Barnett 1993). Arsenic, a constituent of gallium arsenide solar cells, is very poisonous (U.S. DOE 1991).

Hydrogen selenide, used as a feedstock in copper indium diselenide thin-cell manufacture, is an extremely toxic gas. It can be used safely, however, if documented safety procedures are followed. Research is being conducted to find a substitute to replace the use of the gas altogether. After manufacture, sealed modules of copper indium diselenide contain small quantities of selenium, sandwiched between glass layers. This selenium could threaten groundwater if modules are disposed of improperly (Zweibel and Barnett 1993).

Tests have been conducted by the U.S. Environmental Protection Agency on copper indium diselenide solar cells (which also contain a layer of cadmium sulfide; see the section on thin-film cells). On grinding the cells and suspending them in various solutions, it was found that tests for leaching of cadmium, selenium, and other substances were within limits. Thus, under present U.S. laws, these modules are not considered hazardous waste (Zweibel and Barnett 1993; and discussions with R.H. Annan, Director, Office of Solar Energy Conversion, U.S. Department of Energy, Washington D.C.).

Cadmium is another toxin; it is both poisonous and a possible carcinogen. Both at the manufacturing stage and at the disposal stage, health and safety issues and environmental concerns must be addressed, as the technology matures, for cadmium telluride solar cells. Recycling procedures are being studied (U.S. DOE 1991). However, it is worth bearing in mind that the quantities are small compared with the amounts of cadmium waste from disposal of nickel-cadmium batteries and the cadmium entering the food stream from phosphate fertilizers. For example, in the United States 1,000 tons of cadmium enters the waste stream yearly from discarded batteries; this is equivalent to the waste that would be created from 20 billion watts of discarded PV modules (Zweibel and Barnett 1993). Coal burning also produces some cadmium waste (about one kilogram/GWh of electricity, equivalent to 150 m² of cadmium sulfide/cadmium telluride modules producing the same 1 GWh in 30 years; Zweibel and Barnett 1993).

The Cost of Photovoltaic Power

The cost of electricity from photovoltaics is dependent on the following factors:

- *Insolation at the site.* This determines the amount of electricity generated from a specific system, as it is analogous to the amount of fuel available.
- *Module and system efficiency.* The system efficiency is important, as it is the percentage of available energy converted to electrical energy, after energy losses during electricity generation. Data taken from Annex 8 on system efficiencies are shown in Figure 4.9. Values beyond 1992 are projected; the others are values used in calculations of various photovoltaic schemes. System efficiencies have increased with time. The main component of the system efficiency is the module efficiency.

For most PV systems, the system efficiency is about 70 to 85 percent of the module efficiency.²³ The module efficiency varies considerably between different PV modules, as illustrated in Figures 4.2 to 4.7. The module efficiency is also of importance in its contribution toward other costs, because generating a specific amount of power, will require different amounts of land, and will therefore result in different total area-related costs for modules with differing efficiency.


- **Module cost.** The module cost depends on the cost of the materials comprising the module, the particular technique used to manufacture it, and the size of the module order. Costs are discussed in detail in the next subsection.
- **Balance-of-system (BOS) cost.** This can include the cost of the supporting structure, power conditioners (to convert the DC power to AC current), control devices, electrical wiring, batteries for storage, site preparation, installation, and the secondary system (such as lights or a water pump). Different sources differ about what constitutes the balance-of-system costs, and these inconsistencies make it difficult to compare BOS costs directly unless the costs of the individual constituents are given. These BOS costs can account for approximately 40 to 60 percent of the total capital cost according to varying sources.²⁴ Balance-of-system costs are discussed in more detail in the cost subsection.
- **System life.** The life of the system is also important. Most sources quoted in this report assume a photovoltaic life of 30 years in calculations. One PV manufacturer has recently increased its warranty to 20 years, but most currently guarantee only 10 years, even though modules are expected to function longer (Real Goods 1991). National Renewable Energy Laboratory (1992c) reports current module lifetimes as 10 to 15 years. These are expected to increase to 20 years by 1995-2000 and to 30 years by 2010-2030, according to the U.S. DOE's Photovoltaics Program Plan (NREL 1992c). The International Energy Agency (1991) states that the technology has already approached a 30-year lifetime for single-crystal silicon.
- **Interest rate.** The main distinguishing feature of this technology is the high capital cost and the zero fuel cost, unlike conventional technologies, in which fuel costs are high and the initial investment is low. For example, a conventional system may have a capital cost of \$1,500/kW and an operating cost (including fuel) of 4 cents/kWh, whereas a PV system can have a capital cost which is six times higher

23. International Energy Agency (1987) and Zweibel and Barnett (1993) assume system efficiencies of 85 percent and 75 to 80 percent of module efficiencies, respectively, for calculations. In ESMAP reports on Yemen and Pakistan (ESMAP 1991b and ESMAP 1989, respectively), a system efficiency equal to 70 percent of the module efficiency was used in calculations.

24. BOS cost estimates as percentages of total capital cost are 40 to 60 percent according to Perlack, Jones, and Waddle (1990); 38 to 55 percent (system cost is 60 to 120 percent higher than module cost) according to Kimura (1992); 40 to 50 percent according to Kelly (1993) for flat plate systems; and 50 percent according to SERI (1989).

(\$10,000/kW) but an operating cost which is six times lower (0.6 cents/kWh) than the conventional system.

Figure 4.9. System Efficiencies

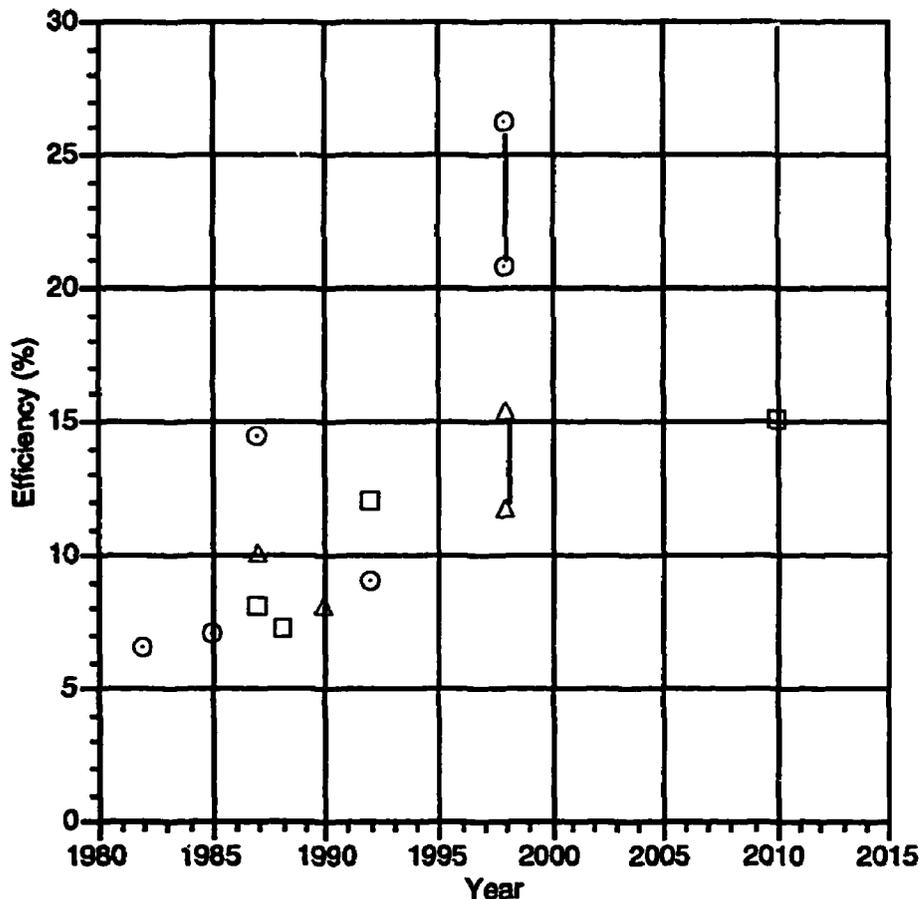

KEY	
△	System (flat plate)
⊙	System (concentrator)
□	System (type not specified)

Operating and Maintenance Cost. Operating and maintenance (O&M) costs are generally low, because of the absence of moving parts in the electricity-generating components. Items 54 and others in Annex 8 quote O&M costs of about 0.5¢/kWh for small PV systems. This is small relative to the O&M costs of a small diesel system (about 1.0 to 1.5¢/kWh for maintenance and about 5.0 cents/kWh for fuel). Operating and maintenance costs of 0.39 to 1.44¢/kWh are found for utility-scale flat-plate systems (U.S. Congress 1992). Another source quotes a study of seven medium-scale U.S. PV projects

as having O&M costs of 0.4 to 7.0¢/kWh (Kelly 1993). These are shown below in Table 4.1 and may be divided into flat plate (0.39 to 1.44 ¢/kWh) and concentrator systems (4.81 to 6.97 ¢/kWh). In the case of concentrator systems, almost 40 percent of the O&M cost in Arizona was for the tracker, whereas in Texas, 80 percent resulted from problems with the power conditioner.

Table 4.1. The Operating Experience of Large PV Systems

Site	Power (MW)	System type	O&M costs (¢/kWh)			
			Observed		Potential	
			Tracker only	Total	Best parts	Double efficiency
Lovington, CA	0.10	FP/OD	0.00	0.39	0.13	0.11
Washington, DC	0.30	FP/OD	0.00	1.44	0.14	0.12
Sacramento, CA	2.00	FP/1D	0.02	0.61	0.15	0.13
Carissa Plains, CA	6.50	FP/2D	0.18	0.80	0.29	0.20
Lugo, CA	1.00	FP/2D	0.37	1.10	0.29	0.20
Phoenix, AZ	0.23	C/2D	1.78	4.81	0.53	0.30
Dallas / Fort Worth, TX	0.03	C/2D	0.82	6.97	0.73	0.35

Notes: FP = flat plate; C = concentrator; OD = no tracking; 1D = one-dimensional tracking; 2D = two-dimensional tracking.

Source: Electric Power Research Institute, "Photovoltaic Operation and Maintenance Evaluation," EPRI GS-6625, December 1989; cited in Kelly (1993).

Potential using "best parts" corrects known design defects and assumes use of parts with proven low O&M costs. Potential using "double efficiency" assumes best parts are used but module output is doubled by improved cell design (affects only some O&M).

Of O&M in Dallas/Fort Worth system, 80% resulted from problems with the power conditioner. More than half of the Sky Harbor (Phoenix) costs result from moisture leakage into the arrays, forcing extensive component replacement. The design defect has been corrected with improved seals.

Costs In Detail

The following subsections look at module costs, balance-of-system costs, and electricity generation costs in more detail.

Module Costs

Module costs, both historic and future, according to various sources in the literature, are given in Annex 10. These were obtained from Annex 8, except items 62, 67 to 68, 159, 187 to 188, 194 to 195, 201, 207, 235 to 237, 267, and 278 to 285, which were excluded for one of the following reasons:


- Costs for arrays were excluded, because they may also include the cost of the racks for supporting the modules.
- Tracker or racking (support) costs were included in the quoted cost.
- It was not clear from the text whether the cell or module cost was being stated.
- Costs were based on achieving a particular production level (this necessitates certain assumptions about the rate of market increase).
- Costs were cited, but it was not possible to ascertain the date of the quote.
- Costs were *projected* for years up to and including 1992.

The costs in Annex 10 were converted into 1990 U.S. dollars per peak watt using the methods described in Annex 1. These costs then were plotted in Figures 4.10 to 4.13. The following must be noted with regard to these graphs:

- Only photovoltaic module costs are shown. BOS costs (e.g., mounting costs, storage costs) are not included but are discussed in the next section.
- In most cases, the year of the module cost quoted is from the source material. Where it is not, the publication date of the document is used, unless noted otherwise.
- Similarly, the year of the price quoted is usually stated. Where this is not so, the year of the quoted cost is taken as the year of the currency. Beyond 1992, the year of publication of the document is taken as the currency year.
- The size of the module system/order is different in each case, with prices for both 2.5 Wp orders as well as megawatt orders being shown.
- Figures for 1992 and earlier are actual; those after 1992 are projections.
- Both production costs as well as selling prices are shown. Prices may differ from production costs for several reasons; producers may have a higher implicit discount rate to provide for risks, taxes, recovery of R&D, and other factors. This adds to dispersion on the graphs.
- Type of module is rarely specified; thus, no differentiation was made in the graphs.
- The varying "quantities" (i.e., total peak wattage) of modules, as specified by the source, are shown in the graphs. In addition, Figure 4.11 shows only the module costs

where the total sale is less than 1,000 Wp, as well as those bought in "small quantities." Figure 4.12 shows the module cost when the quantity being purchased is 1,000 Wp or greater, or when "large quantities" are being purchased. Figure 4.13 shows the data (the largest data set) for those costs where the wattage is not specified.


Figure 4.10. Photovoltaic Module Costs by Size of Order

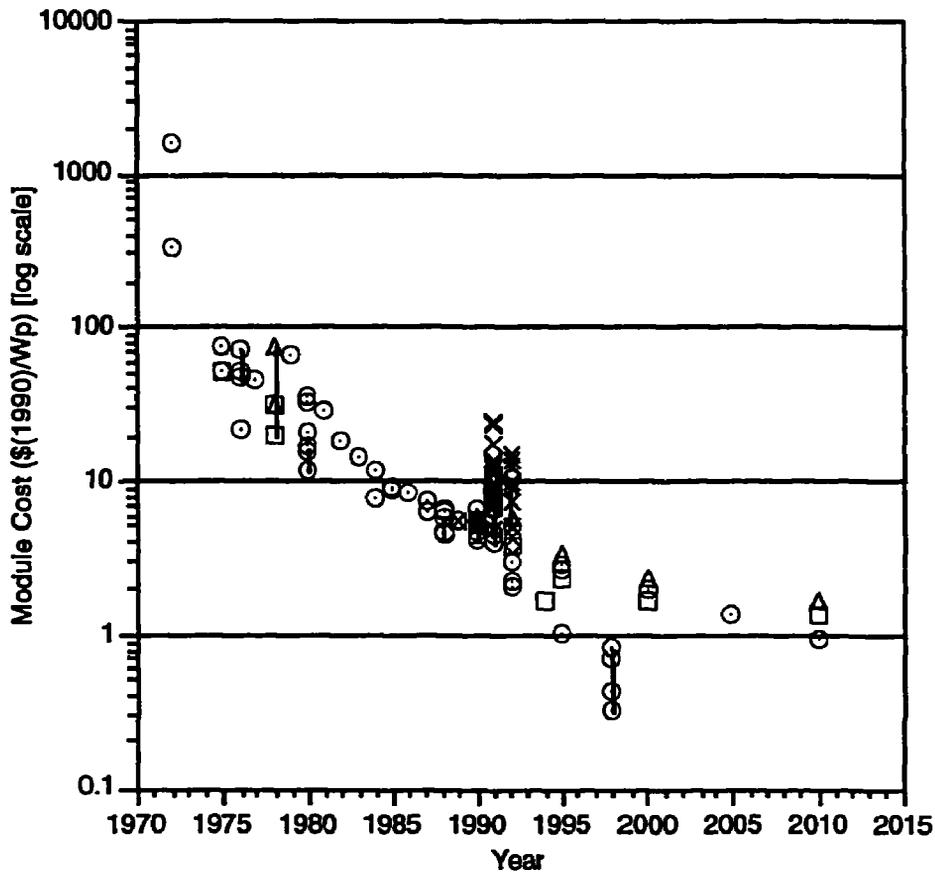

KEY Quantity: X < 1000 Wp
 O 1 kWp - 1 MWp
 \diamond > 1 MWp
 □ "large" quantity (unspecified)
 \triangle "small" quantity (unspecified)
 ○ unspecified

All costs through 1992 are actual; those after 1992 are projected.

Figure 4.11. Photovoltaic Module Costs for Small Orders

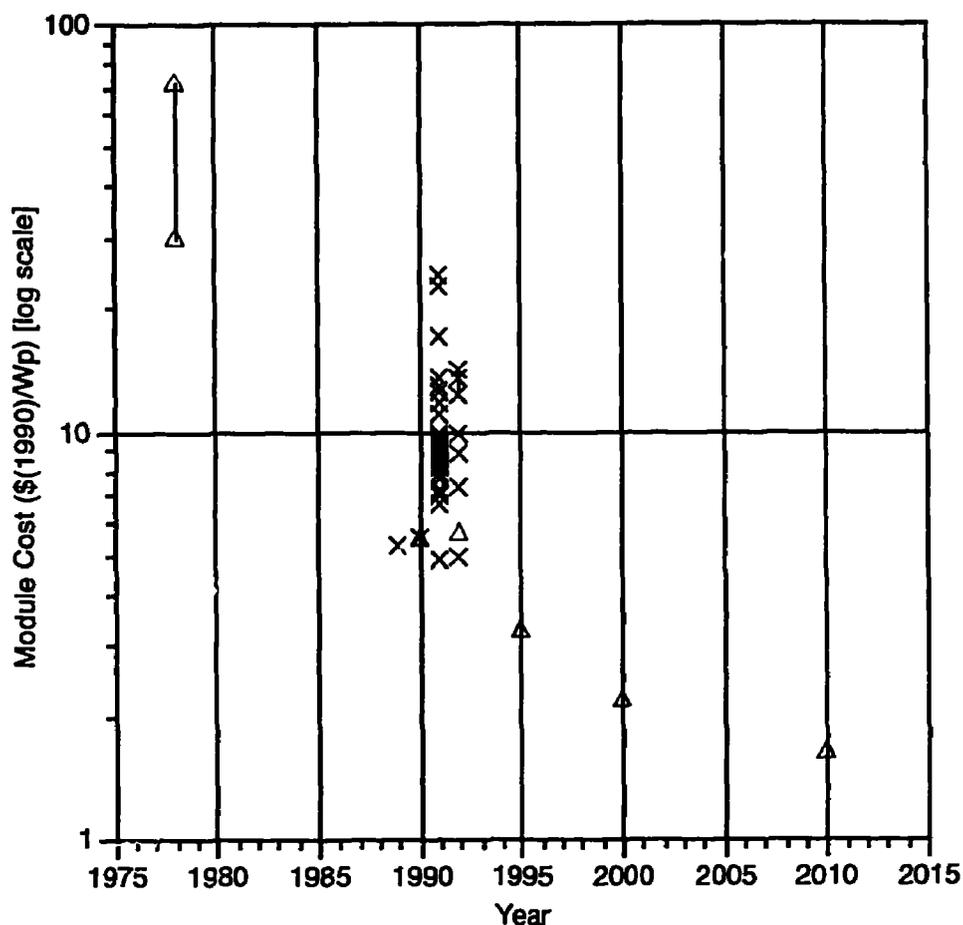

KEY Quantity: X < 1000 Wp
 Δ "small" quantity (unspecified)


All costs through 1992 are actual; those after 1992 are projected.

The following may be deduced from the graphs:

- The costs of photovoltaic modules have decreased from about \$300/Wp (1990 prices) in the early 1970s to \$4 to 11/Wp (1990 prices) in 1992. An outlier figure of over \$1,000/Wp (1990 prices) appears in the early 1970s, which may be due to the small scale of the application. There are also outlier figures of \$2 to 3/Wp (1990 prices) in 1992; these may be actual production costs.
- The costs vary with the total quantity (in terms of wattage) required, with larger quantities being cheaper.
- Projections for future cost reductions show that the cost is expected to drop to \$1 to 2/Wp (1990 prices) by the beginning of the next century. The outliers for 1998 are based on projections made in the 1980s (Items 114 and 116) and appear optimistic.

- The costs are spread over a range for both 1991 and 1992. This probably stems from the range of data collected. This includes both actual module prices in a developing country, Zimbabwe, as well as actual module prices in the United States (from *Real Goods*, a commercial publication). On the other hand, the costs quoted by Zweibel and Barnett (1993; items 264-66) appear to be actual manufacturing costs. Furthermore, the latter are for thin-film PV modules, whereas the former are for crystalline silicon PV modules (except for item 42), which have a higher manufacturing cost.

Figure 4.12. Photovoltaic Module Costs for Large Orders

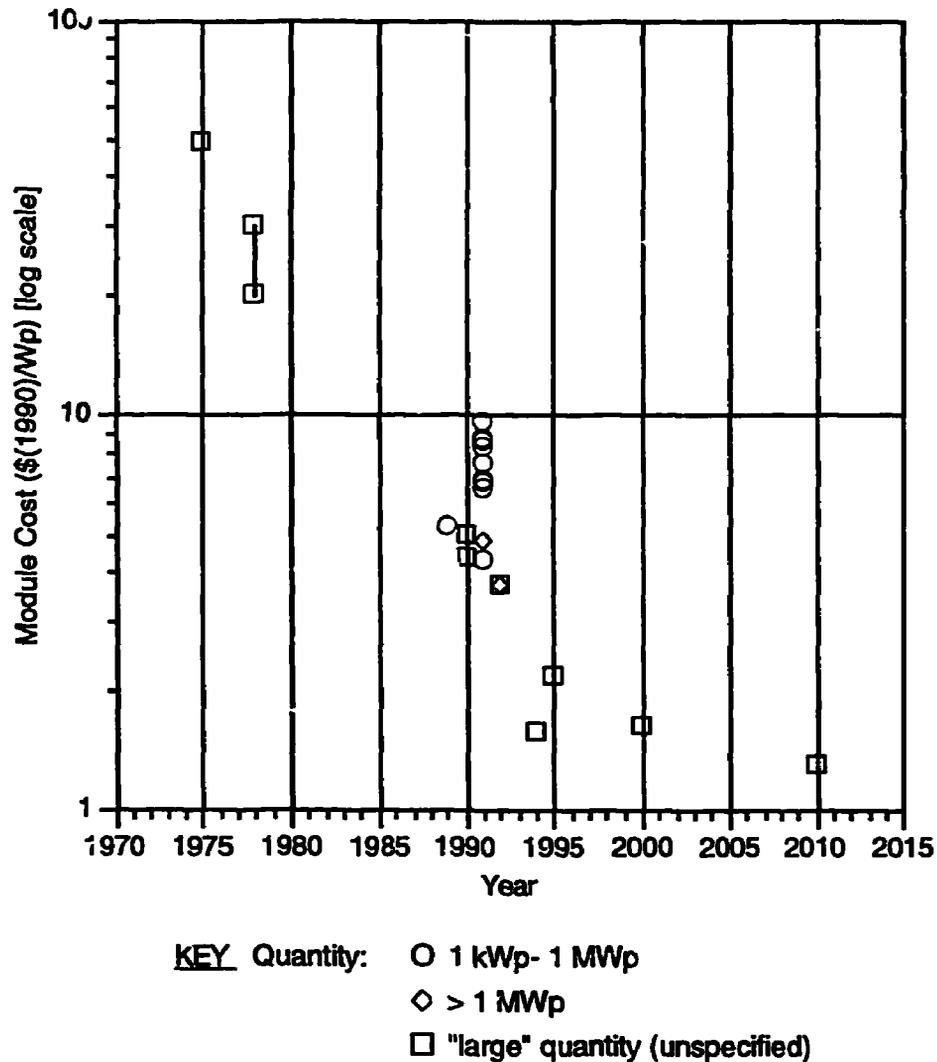

All costs through 1992 are actual; those after 1992 are projected.

From this equation, a doubling in the accumulated production leads to a reduction in the unit cost by a factor, called the progress ratio, which is usually expressed as a percentage.

Cody and Tiedje (1992) found their data to yield a "77 percent learning curve" for "silicon solar cells" between 1976 and 1988; that is, that a doubling of production resulted in costs decreasing to 77 percent of their initial level.²⁵ Cody and Tiedje (1992) also report Maycock as identifying a learning curve parameter as 90 percent for silicon solar cells up to 1965 and 80 percent between 1965 and 1973. Interestingly, Tsuchiya (1992) found a similar result for Japanese photovoltaic production between 1979 and 1988 (i.e., a nearly "80 percent learning curve"), although he does not specify the type of photovoltaic module.²⁶

These reductions in costs may be attributed to several factors:

- The steady progress in the efficiency of cells and modules as noted earlier. For example, efficiencies of crystalline silicon modules have increased by 50 percent from 1976 to 1992; that is, from 7 to 8 percent to 10 to 13 percent. Furthermore, as discussed earlier, further gains in efficiency are still possible and likely.
- Increases in the scale of manufacturing, and with this changes in cell design and manufacturing technologies. The 60-fold increase in the market from 1976, albeit from very small levels has permitted manufacturers to introduce methods more amenable to large-scale, low-cost production. Examples are the introduction of thin-film modules that are amenable to automated manufacturing processes, and the innovative methods being used for the production of single-crystal silicon wafers, such as the dendritic web approach which minimize silicon waste.

Balance-of-System Costs

As described earlier, the term *balance-of-system* can include supporting structure, power conditioners (to convert the DC power to AC current); control devices; electrical wiring; batteries for storage; site preparation; installation; and the secondary system, such as lights or a water pump. Sources differ in their definition of what exactly constitutes the balance-of-system, and these inconsistencies make it difficult to compare BOS costs directly, unless the costs of the individual components are given. These BOS costs can

25. Cody and Tiedje (1992) note that up to 1982 the market was dominated by single-crystal silicon solar panels, but by 1985 consisted of a mix of 48 percent single-crystalline silicon materials, 27 percent polycrystalline silicon materials, and 24 percent amorphous silicon materials. They also comment on significant performance differences between these. However, they include all the cells under a generic category of "silicon solar cells." They use the average selling price of solar modules in their calculations. Cumulative annual worldwide sales are used in place of cumulative production.

26. Tsuchiya (1992) does not clarify the approximations made by using the accumulated production values from 1979 as opposed to those from the first production in order to obtain the learning curve for the period: 1979-88. Furthermore, it is not clear whether the module cost is the actual selling price or the manufacturing cost, though it is more likely to be the latter.

account for approximately 40 to 60 percent of the total capital cost according to varying sources.²⁷ Annex 8 does give an indication of costs of certain BOS items. These are specified as either a percentage of the total cost, or a total area-related (\$/sq. m.) and a total power-related (\$/kW) cost, or as individual component costs. The following should be noted with regard to these costs:

- The BOS differs in different applications, from photovoltaics for water pumping to photovoltaics for generating electricity. Second, further variance is found between a grid-attached PV system and an individual unit for a house, both producing electricity. The situation can then become more complicated: Hankins (1993) gives a number of examples of PV power in developing country situations, where the system is only required to deliver DC electricity, unlike, say, for a home in the United States thus eliminating the need for power converters.
- The BOS component parts are usually made or obtained locally, and thus even further variation is found in the cost of individual components depending on the site of the PV scheme. See, for example, items 49 and 50 which compare costs between the Dominican Republic and the United States (U.S. Congress 1992). Battery cost is \$1,050/kW (lasts 3 to 5 years) in the former, and \$1,400/kW (lasts 3 to 5 years) in the latter. Similarly, the cost of electronic control equipment is \$1,000/kW in the Dominican Republic and \$1,800/kW in the United States. In addition, mounting hardware, with a cost of \$800/kW, is required in the latter, unlike the former.
- The cost of the land and the cost of labor for installation of the PV scheme are again very much dependent on the site.
- Batteries can make up a large part of the cost. Variation in cost will be found depending on whether these are needed for a particular application. An example of an application that may not require batteries is a utility-based, grid-attached PV plant supplying only peak power.

Significant reductions in future BOS costs are expected with increases in:

- Module efficiency; this is with regard to area-related BOS costs, which will decrease as the area requirement is reduced with increasing module efficiency.
- Market size, which lead to scale economies.

Table 4.2 shows U.S. DOE (1992c) and SERI (1989) assessments. The main reductions are expected to be in power conditioning, wiring and labor (installation) costs. Increases in inverter and battery life are also projected.

27 . BOS cost estimates as percentages of total capital cost vary from 40 to 60 percent according to Perlack, Jones, and Waddle (1990); 38 to 55 percent (system cost is 60 to 120 percent higher than module cost) according to Kimura (1992); 40 to 50 percent according to Kelly (1993) for flat plate systems; to 50 percent according to SERI (1989).

Table 4.2. Balance-of-System Costs for Photovoltaic Systems

<i>Item*</i>	<i>Reference</i>	<i>System size (W)</i>	<i>BOS costs \$/kW_p</i>	<i>Module cost \$/kW_p</i>	<i>System cost \$/kW_p</i>	<i>Year</i> <i>Notes</i>
187	U.S. DOE (1992c)	5,000	1,500 (controls/inverter); 150 (battery); 1,000 installation	5,000 (array)	7,650	1991 Remote power systems; assumptions incl. 3-day battery storage, 80% max. depth of discharge, 5 yr battery life, and 10 yr controls/ inverter life
188	U.S. DOE (1992c)	5,000	1,000 (controls/inverter); 125 (battery); 500 installation	2,500 (array)	4,125	2000 Remote power systems; assumptions incl. 3-day battery storage, 80% max. depth of discharge, 8 yr battery life, and 15 yr controls/ inverter life
278	SERI (1989)	-	2,000 battery (storage for 5 days); 100 wiring controls; 1,500 labor	7,000 (module incl. racks)	-	1987 All costs in 1987\$/kWp (DC). Actual cost, remote stand-alone (1kW) system.
279	SERI (1989)	-	1,500 battery (storage for 5 days); 50 wiring controls; 1,000 labor	5,000 (module incl. racks)	-	1990 All costs in 1987\$/kWp (DC). Predicted cost, remote stand-alone (1kW) system.
280	SERI (1989)	-	1,500 battery (storage for 5 days); 50 wiring controls; 800 labor	3,000 (module incl. racks)	-	1995 All costs in 1987\$/kWp (DC). Predicted cost, remote stand-alone (1kW) system.
281	SERI (1989)	-	1,500 battery (storage for 5 days); 50 wiring controls; 500 labor	2,000 (module incl. racks)	-	2000 All costs in 1987\$/kWp (DC). Predicted cost, remote stand-alone (1kW) system.
282	SERI (1989)	-	500 power conditioning; 500 wiring; 1,000 labor	5,000 (module incl. racks or tracker)	-	1987 All costs in 1987 \$/kWp (AC). Actual cost of large, installed, grid-tied system.
283	SERI (1989)	-	400 power conditioning; 300 wiring; 800 labor	4,000 (module incl. racks or tracker)	-	1990 All costs in 1987 \$/kWp (AC). Predicted cost of large, installed, grid-tied system.
284	SERI (1989)	-	200 power conditioning; 200 wiring; 500 labor	2,000 (module incl. racks or tracker)	-	1995 All costs in 1987 \$/kWp (AC). Predicted cost of large, installed, grid-tied system.
285	SERI (1989)	-	150 power conditioning; 150 wiring ;300 labor	1,500 (module incl. racks or tracker)	-	2000 All costs in 1987 \$/kWp (AC). Predicted cost of large, installed, grid-tied system.

Note: *Item from Annex 8

Cost of Photovoltaic Electricity

Figures 4.14 and 4.15 show the cost of photovoltaic electricity as calculated by a variety of different sources taken from the table in Annex 8. The costs have all been converted to 1990 dollars per kilowatt hour using the procedure described in Annex 1. Figure 4.14 distinguishes between cases where the details are given in the reference on the calculative assumptions made; and Figure 4.15 shows the same data but distinguishes between on-grid and off-grid generation, as specified by the reference. It is assumed that costs quoted up to and including 1992 are based on actual component prices, lifetimes, and efficiencies; though this is not always specified in the text. Costs beyond 1992 are based on projected component costs, lifetimes, and so on, and in some cases the basis for these projected values is given in the text.

The graphs show that the cost of electricity is decreasing. However, it is difficult to arrive at conclusions about the rate of decrease, because different assumptions have been made by different sources for their calculations. These range from different insolation values, to different interest rates, to different types and size of schemes; furthermore, because scale economies are significant, projected costs are particularly dependent on the scale of the markets assumed. Nevertheless, some trends can be seen. The figures below compare the cost of photovoltaic electricity (in the same units) as quoted by different authorities. Current estimates for PV electricity generation range from 25 to 300 cents(1990)/kWh. Figure 4.15 illustrates the lower cost of on-grid PV electricity generation compared with remote systems. This is partly because of economies of scale (as illustrated earlier by the lower cost of modules for large quantities) and may also be because storage costs (i.e., batteries) were not included for on-grid generation. Current cost estimates for off-grid generation are in the range 25 to 250 cents (1990)/kWh, whereas those for on-grid generation (where specified as such) are in the range 30 to 40 cents (1990)/kWh.

In the case of photovoltaics, the fuel cost is zero. The term (AC/E) can be written as the sum of three terms: MOD (PV module component) + BOS(A) (area-related balance-of-system component) + BOS(P) (power-related balance-of-system component), where

$$\text{MOD} = \frac{A(r, n_M) \times C_M (\$/kW) \times 1 \text{ (kW/m}^2, \text{ peak solar power incident on system)} \times \text{Eff}_M}{\text{Eff}_S \times \text{Insol.}}$$

$$\text{BOS(A)} = \frac{A(r, n_A) \times C_A (\$/\text{m}^2)}{\text{Eff}_S \times \text{Insol.}}$$

$$\text{BOS(P)} = \frac{A(r, n_P) \times C_P (\$/kW) \times 1 \text{ (kW/m}^2, \text{ peak solar power incident on system)}}{\text{Insol.}}$$

where

n_M = module life (years)

n_A = life of area-related balance of system components (years)

n_P = life of power-related balance of system components (years)

C_M = module cost (\$/kW)

C_A = cost of area-related balance of system components (\$/m²)

C_P = cost of power-related balance of system components (\$/kW)

Eff_M = module efficiency (%)

Eff_S = system efficiency (%) = $\text{Eff}_{\text{BOS}} \times \text{Eff}_M$

Eff_{BOS} = balance-of-system efficiency (%)

Insol. = Annual solar insolation at site (kWh/m²).

As can be seen, longer component lifetimes, higher insolation, and lower component costs all result in lowering the cost of electricity generation. It is interesting to see the part played by the module efficiency. As discussed earlier, the system efficiency is about 70 to 85 percent of the module efficiency. Thus, in the module component term, MOD, it is only the ratio of the two ($\text{Eff}_M/\text{Eff}_S$) that is of importance as the quoted module cost in \$/Wp already accounts for the module efficiency. The power-related balance-of-system components, BOS(P), are a function of capacity requirements and being "downstream" of the system are not affected by module efficiency. However, the area-related balance-of-system, BOS(A), is affected by both module efficiency, Eff_M , and system efficiency, Eff_S . First, the system efficiency is of importance in determining the electricity generated. Second, the area-related balance of system costs are linked to the module area and therefore the module efficiency for a required peak wattage.

The Future of Photovoltaics

There is no doubt that costs of photovoltaic modules have decreased by a factor of 10 over the past 15 years or so and a factor of over 50 since the early 1970s. This decrease has been as a result of both technological progress and gain in PV production experience. There has also been an increase in PV module efficiencies. The "bottom line" is the cost of electricity. This too has decreased, as a result of lower module costs and higher module efficiencies. Indeed, it is already competitive with the cost of electricity from conventional technologies in certain instances. Remote sitings are the main example of this, particularly for small loads, due to the high costs of grid extension. For example, Waddle and Perlack (1991) found that in Guatemala, PV systems were less expensive than grid extension when loads were less than 15 to 25 kWh/day and the distance to the nearest tie-point was 6 to 10 km.

The extent of interest and technological research in the field of photovoltaics appears to offer prospects for further cost reductions, in particular with the large-scale commercialization of heterojunctional thin-film modules and multijunctional PV modules, as well as with advances in PV concentrator technology. Increases in the PV market will also play an important part in cost reduction because of scale economies and in the creation of incentives for further technical innovation in manufacturing. The incentive to PV manufacturers to decrease costs substantially will occur only if the market increases are large enough to enable the industry to recoup its investment in PV research and development. Other future issues of importance in the photovoltaic industry are the supply of raw materials, as the crystalline silicon PV market expands beyond the "waste" silicon available from the semiconductor industry.

The emphasis to date, however, has been on photovoltaic modules, when the balance-of-system components form 40 to 60 percent of the total cost. Economies of scale and extensions in component lifetimes are expected to be the main two factors in reducing these costs further. Batteries, especially, are mentioned as being a particularly expensive component because of their short lifetime (3 to 5 years) and consequent need for regular replacement. This, however, is mainly an issue for remote systems; grid-attached PV systems for the provision of peak power (if peak insolation and peak demand match) or PV schemes used in conjunction with an existing hydro scheme have less need for storage.

Bibliography

- Anderson, Dennis. 1992. *The Energy Industry and Global Warming*. London: Overseas Development Institute.
- Anderson, Dennis, and Catherine D. Bird. 1992. "Carbon Accumulations and Technical Progress: A Simulation Study of Costs." *Oxford Bulletin of Economics and Statistics* 54(1): 1-29.
- Anderson, Dennis, and Robert Williams. 1993. *Cost-Effectiveness and the Investments of the Global Environment Facility*. GEF Working Paper 6. United Nations Development Programme/United Nations Environment Programme/World Bank, Washington, D.C.
- Annan, R. H. 1992. "Photovoltaic Energy, Economics and the Environment." In B. Abeles, A. J. Jacobson, and P. Sheng, eds., *Energy and the Environment*. Singapore: World Scientific.
- Boes, Eldon C., and Antonio Luque. 1993. "Photovoltaic Concentrator Technology." In Thomas B. Johansson and others, eds., *Renewable Energy: Sources for Fuel and Electricity*. Washington, D.C.: Island Press.
- BTG (Biomass Technology Group, Netherlands). 1992a. "Case Study: Bergmann Mobil-und Holzgestellfabrik GmbH, Germany." In *Private Electricity Generation: Case Studies of Wood Processing Industries in Germany Prepared for PEICCE* (Proyecto Energetico Istmo Centroamericano, San Jose, Costa Rica). Enschede, Netherlands.
- . 1992b. "Case Study: Pfleiderer Industrie GmbH & Co. KG, Germany." In *Private Electricity Generation: Case Studies of Wood Processing Industries in Germany Prepared for PEICCE* (Proyecto Energetico Istmo Centroamericano, San Jose, Costa Rica). Enschede, Netherlands.
- Carlson, D. E. 1990. "Photovoltaic Technologies for Commercial Power Generation." *Annual Review of Energy* 15: 85-98.
- . 1992. "The Merits and Advantages of Photovoltaic Systems for Electric Utility Applications." In *Photovoltaic Systems for Electric Utility Applications: Opportunities, Critical Issues and Development Perspectives*, Proceedings of the executive conference held on 2-5 December 1990, International Energy Agency and Italian Electricity Authority (sponsors). Paris: OECD (Organization for Economic Cooperation and Development).
- Carlson, D. E., and Sigurd Wagner. 1993. "Amorphous Silicon Photovoltaic Systems." In Thomas B. Johansson and others, eds., *Renewable Energy: Sources for Fuel and Electricity*. Washington, D.C.: Island Press.
- Cavallo, Alfred J., Susan M. Hock, and Don R. Smith. 1993. "Wind Energy: Technology and Economics." In Thomas B. Johansson and others, eds., *Renewable Energy: Sources for Fuel and Electricity*. Washington, D.C.: Island Press.
- CENAL (National Executive Commission on Alcohol). 1988. *The National Alcohol Program (PROALCOOL)*. Brasilia: Ministerio da Industria e do Comércio.

- Charters, W. W. S. 1987. "Solar Thermal Conversion Technologies, Trends in Research, Development and Commercialization." United Nations Industrial Development Organization.
- . 1991. "Solar Energy: Current Status and Future Prospects." *Energy Policy* 19: 738-41.
- Cody, G. D., and T. Tiedje. 1992. "The Potential for Utility Scale Photovoltaic Technology in the Developed World 1990-2010." In B. Abeles, A. J. Jacobson, and P. Sheng, eds., *Energy and the Environment*. Singapore: World Scientific.
- Costello, D., and P. Rappaport. 1980. "The Technological and Economic Development of Photovoltaics." *Annual Review of Energy* 5: 335-56.
- De Laquil, Pascal III, David Kearney, Michael Geyer, and Richard Diver. 1993. "Solar-Thermal Electric Technology." In Thomas B. Johansson and others, eds., *Renewable Energy: Sources for Fuel and Electricity*. Washington, D.C.: Island Press.
- Development Sciences, Inc. 1981. "The Economic Costs of Renewable Energy." Report DS 135.12. Report prepared for the Agency for International Development, Washington D.C. Processed.
- Dunn, P. D. 1986. *Renewable Energies: Sources, Conversion and Application*. London: Peter Peregrinus Ltd.
- Elliott, P., and R. Booth. 1990. "Sustainable Biomass Energy." Shell Selected Papers, London.
- ESMAP (Energy Sector Management Assistance Programme). 1987. "Côte d'Ivoire: Improved Biomass Utilization." Activity Completion Report 069/87. United Nations Development Programme/World Bank, Washington, D.C. Processed.
- . 1988. "Ghana: Sawmill Residues Utilization Study." Activity Completion Report 074/87. United Nations Development Programme/World Bank, Washington D.C. Processed.
- . 1989. "Pakistan: Assessment of Photovoltaic Programs, Applications, and Markets." Activity Completion Report 103/89. United Nations Development Programme/World Bank, Washington D.C. Processed.
- . 1991a. "India: Maharashtra Bagasse Energy Efficiency Project." Activity Completion Report 120/91. United Nations Development Programme/World Bank, Washington D.C. Processed.
- . 1991b. "Yemen: Household Energy Strategy Study Phase 1." Activity Completion Report 126/91. United Nations Development Programme/World Bank, Washington D.C. Processed.
- Firor, Kay, Roberto Vigotti, and Joseph J. Ianucci. 1993. "Utility Field Experience with Photovoltaic Systems." In Thomas B. Johansson and others, eds., *Renewable Energy Sources for Fuels and Electricity*. Washington, D.C.: Island Press.
- Flaim, S., and D. Hertzmark. 1981. "Ethanol Fuel from Sugar Cane in Brazil." *Annual Review of Energy* 6: 89-121.

- Geller, H. S. 1985. "Agricultural Policies and Biomass Fuels." *Annual Review of Energy* 10: 135-64.
- GEF (Global Environment Facility). Various dates. *Report of the Chairman*. United Nations Development Programme/United Nations Environment Programme/World Bank, Washington, D.C. Processed.
- Goldemberg, José, Lourial C. Monaco, and Isaias C. Macedo. 1993. "The Brazilian Fuel-Alcohol Program." In Thomas B. Johansson and others, eds., *Renewable Energy Sources for Fuels and Electricity*. Washington, D.C.: Island Press.
- Grasse, Wilfried. 1992. "PHOEBUS International 30 MW_e Solar Tower Plant." In W. Grasse, ed., *Solar Power and Chemical Energy Systems: International Energy Agency SSPS/SolarPACES Program, Report on Activity and Results 1989-91*, Deutsche Forschungsanstalt für Luft- und Raumfahrt (DLR), Apartado 649, E-04080, Almería, Spain.
- Grassi, G. 1992. "R&D Biomass Programme of the C.E.C." *Second World Renewable Energy Congress* 3: 1238-55.
- Green, Martin A. 1993. "Crystalline- and Polycrystalline-Silicon Solar Cells." In Thomas B. Johansson and others, eds., *Renewable Energy Sources for Fuels and Electricity*. Washington, D.C.: Island Press.
- Hagen, D. L., and S. Kaneff. 1991. *Applications of Solar Thermal Technologies in Reducing Greenhouse Gas Emissions: Opportunities and Benefits for the Australian Industry*, Report to the Department of Arts, Sport, the Environment, Tourism and Territories. Canberra: Commonwealth of Australia.
- Hall, D. C. 1990. "Preliminary Estimates of Cumulative Private and External Costs of Energy." *Contemporary Policy Issues (U. S.)* 8: 283-307.
- Hall, D. O. 1991. "Biomass Energy." *Energy Policy* 19: 711-37.
- Hall, D. O., and R. P. Overend, eds. 1987. *Biomass: Regenerable Energy*. New York: Wiley.
- Hall, D. O., Frank Rosillo-Calle, Robert H. Williams, and Jeremy Woods. 1993. "Biomass for Energy: Supply Prospects." In Thomas B. Johansson and others, eds., *Renewable Energy Sources for Fuels and Electricity*. Washington, D.C.: Island Press.
- Hankins, Mark. 1993. *Solar Rural Electrification in the Developing World*. Washington D.C.: Solar Electric Light Fund.
- Hislop, D. 1992. *Energy Options*. London: Intermediate Technology Publications.
- Hohmeyer, O. 1988. *Social Costs of Energy Consumption*. Berlin: Springer-Verlag.
- Hohmeyer, O. 1990. "Social Costs of Electricity Generation." *Contemporary Policy Issues (U.S.)* 8: 255-82.
- Hohmeyer, O. 1992. "Renewables and the Full Costs of Energy." *Energy Policy* 20: 365-75.
- Holdren, J. P., G. Morris, and I. Mintzer. 1980. "Environmental Aspects of Renewable Energy Sources." *Annual Review of Energy* 5: 241-91.

- International Energy Agency. 1987. *Renewable Sources of Energy*. Paris: OECD (Organization for Economic Cooperation and Development).
- . 1991. *Guidelines for the Economic Analysis of Renewable Energy Technology Applications*. Paris: OECD (Organization for Economic Cooperation and Development).
- . 1992. *Oil and Gas Information 1989-1991*. Paris: OECD (Organization for Economic Cooperation and Development).
- International Energy Agency and Italian Electricity Authority. 1992. *Photovoltaic Systems for Electric Utility Applications: Opportunities, Critical Issues and Development Perspectives*. Proceedings of the executive conference held on 2-5 December 1990. Paris: OECD (Organization for Economic Cooperation and Development).
- International Monetary Fund. Various years. *International Financial Statistics*. Washington, D.C.
- Johansson, T. B., H. Kelly, A.K.N. Reddy, and R. H. Williams, eds. 1993. *Renewable Energy: Sources for Fuel and Electricity*. Washington, D.C.: Island Press.
- Kearney, D. W., and H. W. Price. 1992. "Solar Thermal Plants: Luz Concept (Current Status of the SEGS Plants)." *Second World Renewable Energy Congress 2*: 582-88.
- Kelly, Henry. 1991. "Introduction to Photovoltaic Technology." In Thomas B. Johansson and others, eds., *Renewable Energy Sources for Fuels and Electricity*. Washington, D.C.: Island Press.
- Kimura, K. 1992. "Present and Future Capabilities of Photovoltaic Systems to Meet the Utilities Economic Requirements." In *Photovoltaic Systems for Electric Utility Applications: Opportunities, Critical Issues and Development Perspectives*. Proceedings of the executive conference held on 2-5 December 1990, International Energy Agency and Italian Electricity Authority (sponsors). Paris: OECD (Organization for Economic Cooperation and Development).
- Lotker, Michael. 1991. "Barriers to Commercialization of Large-Scale Solar Electricity: Lessons Learned from the LUZ Experience." Sandia National Laboratories, Albuquerque.
- Mahin, D. B. 1989. "Economic Analysis of a Husk-Fueled Gasifier Power Plant at a Rice Mill in Africa." *Biomass* 19: 57-60.
- Maycock, P. 1985. *PV News* 4 (2). Published by PV Energy Systems, Inc., P.O. Box 290, Casanova, VA 22017.
- Maycock, P. 1986. *PV News* 5 (2). Published by PV Energy Systems, Inc., P.O. Box 290, Casanova, VA 22017.
- Maycock, P. 1991. *Photovoltaic Technology: Performance, Cost and Market Forecast to 2000*. Casanova, VA: Photovoltaic Energy Systems, Inc.
- Maycock, P. 1993. *PV News* 12 (2). Published by PV Energy Systems, Inc., P.O. Box 290, Casanova, VA 22017.

- Meridian Corporation. 1992. "Photovoltaic Technology and Market Review." Draft document (November). 4300 King Street, Alexandria, VA 22302. Processed.
- Monaco, Lourival Carmo. 1989. "Alcohol as Alternative Fuel." Presentation given to conference in Guatemala, April 4. Brazilian Energy Commission, Brasilia.
- Moreira, José Roberto, and Alan Douglas Poole. 1993. "Hydropower and its Constraints." In Thomas B. Johansson and others, eds., *Renewable Energy Sources for Fuels and Electricity*. Washington, D.C.: Island Press.
- National Renewable Energy Laboratory (NREL). 1992a. *Photovoltaic Energy Program Overview, Fiscal Year 1991*. DOE/CH10093-129. NREL, 1617 Cole Boulevard, Golden, Colorado 80401-3393.
- . 1992b. "The Photovoltaic Manufacturing Technology Project: Phase 1 Subcontractors." Report NREL/MK-411-4973, Golden, Colorado.
- . 1992c. *Photovoltaics Program Plan, FY 1991 - FY 1995*. DOE/CH10093-92. NREL, 1617 Cole Boulevard, Golden, Colorado 80401-3393.
- . 1992d. "PV MaT (Photovoltaic Manufacturing Technology Project): A Government/Industry Partnership for U.S. Competitiveness." Report NREL/MK-410-4464, Golden, Colorado.
- National Research Council. 1976. *Energy for Rural Development*. Washington, D.C.: National Academy Press.
- . 1981. *Energy for Rural Development (Supplement)*. Washington, D.C.: National Academy Press.
- Palz, Wolfgang. 1978. *Solar Electricity, An Economic Approach to Solar Energy*. Paris and London: UNESCO (United Nations Educational, Scientific and Cultural Organization) and Butterworths.
- Perlack, R. D., G. H. Jones, and D. B. Waddle. 1990. "A Survey of Renewable Energy Technologies for Rural Applications." *Energy: The International Journal* 15: 1119-27.
- Perlack, R. D., J.W. Ranney, and M. Russell. 1991. "Biomass Energy Development in Yunnan Province, China (Preliminary Evaluation)." ORNL (Oak Ridge National Laboratory). Report ORNL/TM-11791. Oak Ridge, Tennessee.
- Pistella, F. 1992. "Present and Future Prospects of Photovoltaics: A Critical Assessment." In *Photovoltaic Systems for Electric Utility Applications: Opportunities, Critical Issues and Development Perspectives*, Proceedings of the executive conference held on 2-5 December 1990, International Energy Agency and Italian Electricity Authority (sponsors). Paris: OECD (Organization for Economic Co-operation and Development).
- Rajabapaiah, P., S. Jayakumar, and Amulya K.N. Reddy. 1993. "Biogas Electricity—The Pura Village Case Study." In Thomas B. Johansson and others, eds., *Renewable Energy Sources for Fuels and Electricity*. Washington, D.C.: Island Press.

- Real Goods. 1991. *Alternative Energy Sourcebook 1991*. Ukiah, California: Real Goods Trading Corporation.
- Remy, C., and Durand, H., 1992. "The Present Capabilities of Photovoltaic Industry to meet the Utilities Requirements." In *Photovoltaic Systems for Electric Utility Applications: Opportunities, Critical Issues and Development Perspectives*. Proceedings of the executive conference held on 2-5 December 1990, International Energy Agency and Italian Electricity Authority (sponsors). Paris: OECD (Organization for Economic Cooperation and Development).
- Seroa da Motta, R., and L. da Rocha Ferreira. 1988. "The Brazilian National Alcohol Programme." *Energy Economics* (July): 229-34.
- SERI (Solar Energy Research Institute; now National Renewable Energy Laboratory). 1989. "Photovoltaics: Entering the 1990s." Report SERI/SP-220-3461, Golden, Colorado.
- . 1991. *Photovoltaics: New Opportunities for Utilities*. DOE/CH10093-113. Solar Energy Research Institute, 1617 Cole Boulevard, Golden, Colorado 80401-3393.
- Stevens, J. W., M. G. Thomas, H. N. Post, and A. Van Arsdall. 1990. "Photovoltaic Systems for Utilities." Report SAND90-1378. Sandia National Laboratories, Albuquerque.
- Terrado, E., 1985. "Technical and Cost Characteristics of Dendrothermal Power Systems." Industry and Energy Department Energy Series Paper 31, World Bank, Washington D.C. Processed.
- Terrado, E., M. Mendis, and K. Fitzgerald. 1988. "Impact of Lower Oil Prices on Renewable Energy Technologies." Industry and Energy Department Energy Series Paper 5. World Bank, Washington D.C. Processed.
- Thomas, M. G., H. N. Post, and A. V. Poore. 1989. "Photovoltaic Systems for Government Agencies." Report SAND88-3149. Sandia National Laboratories, Albuquerque.
- Thornton, J., and L. Brown. 1992. "The Promise and Payoff of Photovoltaics." *The Electricity Journal* 5 (3): 34-41.
- Tsuchiya, Haruki. 1992. "Photovoltaics Cost Analysis Based on the Learning Curve." Research Institute for Systems Technology, 4F., Daisan Narishima Building, 2-8-11, Higashi Nihonbashi, Chuo-ku, Tokyo, Japan.
- UNDP (United Nations Development Programme). 1992. "Photovoltaics for Household and Community Use in Zimbabwe." Paper ZIM/92/G31, New York.
- U.S. Congress. 1992. *Fueling Development: Energy Technologies for Developing Countries*. Office of Technology Assessment, Washington, D.C.
- U.S. DOE (United States Department of Energy). 1990a. "The Potential of Renewable Energy: An Interlaboratory White Paper." Paper DE90000322, Washington, D.C.
- . 1990b. "Solar Thermal Electric Technology Rationale." Office of Solar Energy Conversion, Solar Thermal and Biomass Power Division, Washington, D.C.
- . 1991. *Photovoltaic Fundamentals*. Prepared by the Solar Energy Research Institute, Golden, Colorado, for the U.S. DOE. DOE/CH10093-117. National Technical Information Service, Springfield, Virginia.

- . 1992a. "Electricity from Biomass: A Development Strategy." Office of Solar Energy Conversion, Washington, D.C.
- . 1992b. *Programs in Utility Technologies (Fiscal Years 1990-1991): Solar Thermal Electric and Biomass Power, Program Overviews*. NREL (National Renewable Energy Laboratory), Golden, Colorado.
- . 1992c. *Solar 2000: A Collaborative Strategy*. (2 vols). Office of Solar Energy Conversion, U.S. Department of Energy, 1000 Independence Avenue, S.W., Washington D.C. 20585.
- . 1992d. "Solar Thermal Electric Five-Year Plan." Draft second revision. Solar Thermal and Biomass Division, U.S. Department of Energy.
- Waddle, D. B., and Perlack, R. D. 1991. "Financing and Disseminating Small Energy Systems in Rural Areas." Manuscript, Energy Division, Oak Ridge National Laboratory, Oak Ridge, Tennessee.
- Walton, A. L., and Hall, D. O. 1990. "Solar Power." *Contemporary Policy Issues (U.S.)* 8: 240-54.
- Weiss, Charles. 1986. "Fuel Ethanol in Brazil: Technology and Economics." Paper delivered to the First Conference on Macroengineering, Crystal City, Virginia.
- Williams, Robert H., and Eric D. Larson. 1993. "Advanced Gasification-Based Biomass Power Generation." In Thomas B. Johansson and others, eds., *Renewable Energy Sources for Fuels and Electricity*. Washington, D.C.: Island Press.
- World Bank. 1980. *Alcohol Production from Biomass in the Developing Countries*. Washington D.C.
- World Bank. 1992. *World Development Report 1992: Development and the Environment*. New York: Oxford University Press.
- World Energy Council (WEC). Forthcoming. "Renewable Energy Resources: Opportunities and constraints 1990-2020." Draft of report of 1992 WEC Study Committee on Renewable Energy Resources, London.
- Wyman, Charles E., Richard L. Bain, Norman D. Hinnian, and Don J. Stevens. 1993. "Ethanol and Methanol from Cellulosic Biomass." In Thomas B. Johansson and others, eds., *Renewable Energy: Sources for Fuel and Electricity*. Washington, D.C.: Island Press.
- Zweibel, Ken, and Allen M. Barnett. 1993. "Polycrystalline Thin-Film Photovoltaic Systems." In Thomas B. Johansson and others, eds., *Renewable Energy: Sources for Fuel and Electricity*. Washington, D.C.: Island Press.

Annexes

Annex 1. Cost Calculations and Currency Adjustments

The costs quoted in this paper are drawn from a variety of sources. Some are actual costs, whereas others are results of tabletop and engineering studies. Frequently, the sources quoted do not specify the details of their calculations and the assumptions made therein, such as discount rates and tax credits. Where these assumptions have been specified, I have attempted to note them. However, it is worth bearing in mind that this does cause difficulties in making direct cost comparisons.

Where data is available, the levelized cost of electricity has been calculated using the following standard formula:

$$\text{Cost of electricity (levelized)} = \frac{AC + (O\&M) + F}{E} \quad (\text{in } \$/\text{kWh})$$

where

AC = Annualized capital cost (\$/yr)

C = Total capital cost (\$)

A = The annuity rate = $\frac{r(1+r)^n}{(1+r)^n - 1}$, where $r = 0.10$, i.e., a discount rate of 10%, and $n =$ life of plant (yr)

(O&M) = Annual operating and maintenance cost (\$/yr)

F = Annual fuel cost for plant (\$/yr.)

E = Number of kilowatt hours produced annually (kWh/yr).

All currency values have been converted to 1990 currency figures using the Consumer Price Index (line 64) quoted in the IMF's *International Financial Statistics*. They have then been converted to U.S. dollars (1990) using the period average of the market exchange rate (rf) taken from the same document. For 1992 dollars, an average of the first three quarters of the market exchange rate (rf) has been used for conversion to 1990 dollars. Any variations from the methods given above are noted in the relevant section of the text.

The reader is referred to the International Energy Agency's *Guidelines for the Economic Analysis of Renewable Energy Technology Applications* or to the Electric Power Research Institute's *Technical Assessment Guide* (EPRI TAG) for more detailed cost analyses of these technologies.

Annex 2. Costs of Ethanol Production

Table A2.1. Costs of Ethanol Production

	Reference	Raw material	Production cost (as quoted)	Production cost (1990 US \$/GJ)	Year	Notes
1	U.S. Congress (1992)	sugarcane	10-11.80 \$/GJ (1990)	10 - 11.8	1992	Based on operating experience-average production cost in Brazil.
2	U.S. Congress (1992)	sugarcane	9.0 \$/GJ (1990)	9	1992	Based on operating experience of most efficient distilleries in Brazil.
3	U.S. Congress (1992)	sugarcane	8.5 \$/GJ (1990)	8.5	2000	Technology could be available by 2000 with concerted R,D&D effort; assumes biomass gasifier/gas turbine cogeneration; sale of surplus electricity, revenues credited against cost of ethanol.
4	U.S. Congress (1992)	cellulosic material	19-21 \$/GJ (1990)	19 - 21	1992	Utilizing acid hydrolysis; technology commercially ready but not yet implemented commercially.
5	U.S. Congress (1992)	cellulosic material	15 \$/GJ (1990)	15	2000	Technology could be available by 2000 with concerted R,D&D effort.
6	U.S. Congress (1992)	cellulosic material	9-11 \$/GJ (1990)	9 - 11	1992	Enzymatic process; technology near-commercial.
7	U.S. Congress (1992)	cellulosic material	6-6.5 \$/GJ (1990)	6 - 6.5	2000	Enzymatic process; technology could be available by 2000 with concerted R,D&D effort.
8	U.S. DOE (1990a)	corn	\$1.28/gallon	16	1990	Assuming cost in 1990 \$; corn feedstock represents half this cost; revenues from animal feed co-products include about half the total costs.
9	U.S. DOE (1990a)	cellulosic material	\$1.35/gallon	17	1990	Assuming costs are in 1990 \$; Cost based on technology of the time.
10	U.S. DOE (1990a)	cellulosic material	\$0.60/gallon	7.5	1998	Assuming costs are in 1990 \$; for enzymatic hydrolysis technology.
11	U.S. DOE (1990a)	not specified	17.4 \$/MilBtu	16.6	1990	Assuming costs in 1990 \$; leveled cost; states "approach to fuels is consistent with EPRI's required revenues (Fixed Charge Rate) methodology; Science Applications International Corp. (SAIC) model used for economic analysis."
12	U.S. DOE (1990a)	not specified	7.2 \$/MilBtu	6.9	2000	Assuming costs in 1990 \$; leveled cost assumes intensified R,D&D; states "approach to fuels is consistent with EPRI's required revenues (Fixed Charge Rate) methodology; SAIC model used for economic analysis."

(continued on next page)

Reference	Raw material	Production cost (as quoted)	Production cost (1990 US \$/GJ)	Year	Notes
13 U.S. DOE (1990a)	not specified	13.0 \$/MiiBtu	12.4	2000	Assuming costs in 1990 \$; levelized cost assumes Business-as-usual; states "approach to fuels is consistent with EPRI's required revenues (Fixed Charge Rate) methodology; SAIC model used for economic analysis."
14 U.S. DOE (1990a)	not specified	7.2 \$/MiiBtu	6.9	2010	Assuming costs in 1990 \$; levelized cost assumes intensified R,D&D; states "approach to fuels is consistent with EPRI's required revenues (Fixed Charge Rate) methodology; SAIC model used for economic analysis."
15 U.S. DOE (1990a)	not specified	10.0 \$/MiiBtu	9.5	2010	Assuming costs in 1990 \$; levelized cost assumes business-as-usual; states "approach to fuels is consistent with EPRI's required revenues (Fixed Charge Rate) methodology; SAIC model used for economic analysis."
16 U.S. DOE (1990a)	not specified	7.2 \$/MiiBtu	6.9	2020	Assuming costs are in 1990 \$; levelized cost; "approach to fuels is consistent with EPRI's required revenues (fixed charge rate) methodology; SAIC model used for economic analysis."
17 Hall and Overend (1987)	sugarcane	\$0.264-0.295/liter (1983 \$)	16.5-18.4	1983	Quoting Geller (1985).
18 Weiss (1986)	sugarcane	\$0.13-0.23/liter (1983)	8.1-14.4	1983	Direct production cost incl. "carrying charges" for majority of Brazilian installations.
19 Weiss (1986)	sugarcane	\$0.30/liter (1983)	18.7	1983	Higher estimate of direct production cost (including "carrying charges") for new autonomous installations in Northeast of Brazil.
20 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.167/l (1983)	10.4	1983	Brazil: Sao Paulo (annexed distillery, sugarcane from market and self-supplied) including capital costs.
21 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.143/l (1983)	8.9	1983	Brazil: Sao Paulo (annexed distillery, sugarcane from market and self-supplied) excl. capital costs, assuming continuation of production with existing installed capacity.
22 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.206/l (1983)	12.9	1983	Brazil: Sao Paulo (autonomous distillery, self-supplied sugarcane) including capital costs.
23 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.160/l (1983)	10	1983	Brazil: Sao Paulo (autonomous distillery, self-supplied sugarcane) excluding capital costs, assuming continuation of production with existing installed capacity.

<i>Reference</i>	<i>Raw material</i>	<i>Production cost (as quoted)</i>	<i>Production cost (1990 US \$/GJ)</i>	<i>Year</i>	<i>Notes</i>
24 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.209/l (1983)	13	1983	Brazil: Center/South (annexed distillery, sugarcane from market, and self-supplied) incl. cap. costs.
25 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.169/l (1983)	10.5	1983	Brazil: Center/South (annexed distillery, sugarcane from market and self-supplied) excluding capital costs, assuming continuation of production with existing installed capacity.
26 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.264/l (1983)	16.5	1983	Brazil: Centre/South (autonomous distillery, self-supplied sugarcane) incl. capital costs.
27 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.179/l (1983)	11.2	1983	Brazil: Centre/South (autonomous distillery, self-supplied sugarcane) excl. capital costs, assuming continuation of production with current capacity.
28 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.240/l (1984)	14.4	1984	Brazil: North/Northeast (annexed distillery, sugarcane from mkt. and self-supplied) incl. capital costs.
29 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.191/l (1984)	11.4	1984	Brazil: North/Northeast (annexed distillery, sugarcane from market, and self-supplied) excl. capital costs, assuming continuation of production with existing installed capacity.
30 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.261/l (1984)	15.6	1984	Brazil: North/Northeast (autonomous distillery, self-supplied sugarcane) including capital costs.
31 Seroa da Motta and da Rocha Ferreira (1988)	sugarcane	\$0.194/l (1984)	11.6	1984	Brazil: North/Northeast (autonomous distillery, self-supplied sugarcane) excluding capital costs, assuming continuation of production with existing installed capacity.
32 CENAL (1988)	sugarcane	\$0.233-0.295/l (1986)	13.2-16.7	?	From World Bank Staff Appraisal Report, 1985; "entrepreneurial total" including opportunity cost of capital at 11% for "new areas."
33 CENAL (1988)	sugarcane	\$0.201-0.255/l (1986)	11.4-14.5	?	From World Bank Staff Appraisal Report, 1985; "economic total" including opportunity cost of capital at 11% for new areas.
34 CENAL (1988)	sugarcane	\$0.258/l (1986)	14.6	?	Data from FGV; "entrepreneurial total" including opportunity cost of capital at 11%.
35 CENAL (1988)	sugarcane	\$0.173/l (1986)	9.8	?	Data from FGV; "economic total" including opportunity cost of capital at 11%.
36 CENAL (1988)	sugarcane	\$0.264/l (1986)	15	?	Data from SOPRAL; "entrepreneurial total" including opportunity cost of capital at 11%.

(continued on next page)

<i>Reference</i>	<i>Raw material</i>	<i>Production cost (as quoted)</i>	<i>Production cost (1990 US \$/GJ)</i>	<i>Year</i>	<i>Notes</i>
37 CENAL (1988)	sugarcane	\$0.175/l (1986)	9.9	?	Data from SOPRAL; "economic total" including opportunity cost of capital at 11%.
38 World Bank Performance Audit, 1990	sugarcane	\$0.27-0.28/l (1988)	14.2-14.7	1978	Refers to SAR; Lower estimate of economic production costs of anhydrous ethanol in late 1970s in Southeast Brazil.
39 World Bank Performance Audit, 1990	sugarcane	\$0.19/l (1988)	10	1988	Refers to PCR estimates, under average conditions, in late 1980s for economic production cost of hydrous ethanol, assuming 12% cost of capital.
40 World Bank Performance Audit, 1990	sugarcane	\$0.27/l (1988)	14.2	1980	Estimated hydrous alcohol economic cost (ex-distillery) in 1980.
41 World Bank Performance Audit, 1990	sugarcane	\$0.21/l (1988)	11	1984	Estimated hydrous alcohol economic cost (ex-distillery) in 1984.
42 World Bank Subsector Review, 1989	sugarcane	\$0.179-0.193/l (1984)	10.7-11.5	1984	Refers to CENAL; WB Appraisal Report, 1985; World Bank financial cost data for Brazil: Sao Paulo (trad. areas) incl. standard conversion factor on local costs of 0.83 and return to capital of 11%/yr.
43 World Bank Subsector Review, 1989	sugarcane	\$0.145-0.159/l (1984)	8.7-9.5	1984	Refers to CENAL; WB Appraisal Report, 1985; World Bank econ. cost data for Brazil: Sao Paulo (trad. areas) incl. standard conversion factor on local costs of 0.83.
44 World Bank Subsector Review, 1989	sugarcane	\$0.20-0.252/l (1984)	12-15.1	1984	Refers to CENAL; WB Appraisal Report, 1985; World Bank financial cost data for Brazil: New areas incl. standard conversion factor on local costs of 0.83 and return to capital of 11%/yr.
45 World Bank Subsector Review, 1989	sugarcane	\$0.16-0.212/l (1984)	9.6-12.7	1984	Refers to CENAL; WB Appraisal Report, 1985; World Bank economic cost data for Brazil: New areas incl. standard conversion factor on local costs of 0.83.
46 World Bank Subsector Review, 1989	sugarcane	\$0.202-0.293/l (1984)	12.1-17.5	1984	Refers to CENAL; WB Appraisal, 1985; World Bank financial cost data for Brazil: Northeast incl. standard conversion factor on local costs of 0.83 and return to capital of 11%/yr.
47 World Bank Subsector Review, 1989	sugarcane	\$0.169-0.246/l (1984)	10.1-14.7	1984	Refers to CENAL; WB Appraisal, 1985; World Bank economic cost data for Brazil: Northeast incl. standard conversion factor on local costs of 0.83.

Reference	Raw material	Production cost (as quoted)	Production cost (1990 US \$/GJ)	Year	Notes
48 World Bank Subsector Review, 1989	sugarcane	\$0.258/l (1985)	14.9	1985	Refers to CENAL; WB Appraisal, 1985; FGV financial cost data for Brazil incl. standard conversion factor on local costs of 0.83 and return to capital of 11%/yr.
49 World Bank Subsector Review, 1989	sugarcane	\$0.173/l (1985)	10	1985	Refers to CENAL; WB Appraisal, 1985; FGV economic cost data for Brazil incl. standard conversion factor on local costs of 0.83.
50 World Bank Subsector Review, 1989	sugarcane	\$0.264/l (1985)	15.3	1985	Refers to CENAL; WB Appraisal, 1985; SOPRAL financial cost data for Brazil incl. standard conversion factor on local costs of 0.83 and return to capital of 11%/yr.
51 World Bank Subsector Review, 1989	sugarcane	\$0.175/l (1985)	10.1	1985	Refers to CENAL; WB Appraisal, 1985; SOPRAL econ. cost data for Brazil incl. standard conversion factor on local costs of 0.83.
52 Flaim and Hertzmark (1981)	corn	\$1.34-1.76/gallon (1980)	26.8-35.1	1980	"Beverage" process; includes credits from sale of co-products.
53 Flaim and Hertzmark (1981)	corn	\$1.30-1.39/gallon (1980)	26.0-27.8	1980	"Wet milling" process; includes credits from sale of co-products.
54 Geller (1985)	sugarcane	\$0.28-0.33/l (1982)	18.0-21.3	1982	Data from Copersucar for Sao Paulo, Brazil, with compensation for overvaluation of cruzeiro (increased official exchange rate by factor of 1.25 to 1.5); according to author, can be viewed as approximation of unsubsidized production cost without profit.
55 Geller (1985)	sugarcane	\$0.264-0.295/liter (1983 \$)	16.5-18.4	1983	No calculation assumptions given.
56 Goldemberg and others (1993)	sugarcane	\$ 0.20/l (1984)	12	1984	Refers to World Bank study, figure is weighted average taking into account different regions in Brazil, type of ethanol, annexed and autonomous distilleries, and incl. correction factor of 0.83 over official exchange rate for cruzeiro.
57 Goldemberg and others (1993)	sugarcane	Averaged \$0.185/l, with range of \$0.17-0.23/l	?	?	Quotes a 1985 and 1989 report with no further details, except that the figures are for "outside Brazil's Northeast region."
58 Goldemberg and others (1993)	sugarcane	\$0.229/l (1989)	11.5	1990	Anhydrous ethanol production cost in 1990; based on data from Copersucar for 50 mills, sample average given; capital cost data based on a 25 year lifecycle with 10% residual value; calculations based on a 12% real discount rate with taxes not included.

(continued on next page)

<i>Reference</i>	<i>Raw material</i>	<i>Production cost (as quoted)</i>	<i>Production cost (1990 US \$/GJ)</i>	<i>Year</i>	<i>Notes</i>
59 Goldemberg and others (1993)	sugarcane	\$0.251/l (1989)	12.6	1990	As above, except average for mills operating at above average cost.
60 Wyman and others (1993)	corn	\$9.9-19.5/GJ (1969)	10.4-20.5	?	Estimates (based on references dating from 1984-87) for wet milling operation, pretax, based on 12% discount rate. Range corresponds to corn cost.
61 Wyman and others (1993)	corn	\$15.0-24.0/GJ (1989)	15.8-25.3	?	Estimates (based on references dating from 1984-87) for dry milling operation, pretax, based on 12% discount rate. Range corresponds to corn cost.
62 Wyman and others (1993)	corn	\$45/GJ	42	1982	Assuming costs are in 1992 \$. Pretax cost of production, assuming a 12% discount rate.
63 Wyman and others (1993)	corn	\$13/GJ	12	1992	Assuming costs are in 1992 \$. Pretax cost of production, assuming a 12% discount rate.
64 Wyman and others (1993)	cellulosic material	\$15.4/GJ (1989)	16.2	1990	Estimates (based on 1990 engineering study) for the pretax cost of production of ethanol from cellulosic biomass, assuming a 12% discount rate.
65 Wyman and others (1993)	cellulosic material	\$12.6/GJ (1989)	13.3	1990	As above, but on a larger scale.
66 Wyman and others (1993)	cellulosic material	\$7.5/GJ (1989)	7.9	?	Engineering study estimate based on improved technology to that above, but with no time frame; assuming 12% discount rate.
67 World Bank Staff Appraisal, 1985	sugarcane	14.5-15.9 US ¢/l (1984)	8.7-9.5	1983	Direct economic production cost, not including interest for Sao Paulo, Brazil (traditional areas), incl. standard conversion factor.
68 World Bank Staff Appraisal, 1985	sugarcane	16.9-24.6 US ¢/l (1984)	10.1-14.7	1983	Direct economic production cost, not incl. interest for Northeast, Brazil, incl. standard conversion factor.
69 World Bank Staff Appraisal, 1985	sugarcane	15.7-21.7 US ¢/l (1984)	9.4-13.0	1983	Direct economic production cost, not including interest for Northeast, Brazil (labor shadow priced), incl. standard conversion factor.
70 World Bank Staff Appraisal, 1985	sugarcane	16.0-21.2 US ¢/l (1984)	9.6-12.7	1983	Direct economic production cost, not incl. interest for new areas, Brazil, incl. standard conversion factor.
71 World Bank Staff Appraisal, 1985	sugarcane	17.9-19.3 US ¢/l (1984)	10.7-11.5	1983	Cost of ethanol prod'n for Sao Paulo, Brazil (trad'l areas), incl. 11% return and standard conversion factor.
72 World Bank Staff Appraisal, 1985	sugarcane	20.2-29.3 US ¢/l (1984)	12.1-17.5	1983	Cost of ethanol production for Northeast, Brazil, incl. 11% return and standard conversion factor.
73 World Bank Staff Appraisal, 1985	sugarcane	19.0-26.3 US ¢/l (1984)	11.4-15.7	1983	Cost of ethanol production for Northeast, Brazil (labor shadow priced), incl. 11% return and standard conversion factor.

<i>Reference</i>	<i>Raw material</i>	<i>Production cost (as quoted)</i>	<i>Production cost (1990 US \$/GJ)</i>	<i>Year</i>	<i>Notes</i>
74 World Bank Staff Appraisal, 1985	sugarcane	20.0-25.2 US ¢/l (1984)	12-15.1	1983	Cost of ethanol production for New areas, Brazil, incl. 11% return and standard conversion factor.

Annex 3. Costs of Electricity from Biomass

Table A3.1. Costs of Electricity from Biomass

Reference	Plant size in MW _p	Capital cost	Interest rate (%)	Annualized		Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity			Notes
				capital cost	Lifetime (years)					Units quoted	1990 prices	US¢/kWh (1990)	
1 Elliott and Booth (1990)	37	1600-1700 \$/kW	nq	nq	nq	2.8 \$/ GJ LCV	42 (fuel)	nq	1990	6.0-7.0 US ¢/ kWh (1990)	6.0-7.0 US ¢/ kWh	6.0-7.0	Tabletop study for biomass gasifier plant.
2 Elliott and Booth (1990)	37	1200-1300 \$/ kW	nq	nq	nq	1.00 - 4.00 \$/ GJ LCV	>42 (fuel)	nq	>1990 (Assume 2000)	4.0-6.0 US ¢/ kWh (1990)	4.0-6.0 US ¢/ kWh	4.0-6.0	Predicted costs on basis of tabletop study, for biomass gasifier plant.
3 Perlack, Ranney, and Russell (1991)	20	8000 yuan/ kW	10	0.215 (con- version plant) + 0.001 (road construc- tion) yuan/ kWh	20	45 yuan/ dry Mg (\$9.60/ dry Mg)	25 (overall)	120 yuan/ kW fixed mainte- nance, 6,000 yuan/ yr labor, 0.010 yuan/ kWh variable maintenance	1990	0.311 yuan/ kWh (1990)	0.311 yuan/ kWh	6.6	Cost esti- mates for ORNL China project using steam turbines.
4 Perlack, Ranney, and Russell (1991)	20	5850 yuan/ kW	10	0.157 (con- version plant) + 0.001 (road construc- tion) yuan/ kWh	20	45 yuan/ dry Mg (\$9.60/ dry Mg)	35 (overall)	120 yuan/ kW fixed mainte- nance, 4,000 yuan/ yr la- bor, 0.010 yuan/ kWh variable maintenance	1990	0.236 yuan/ kWh or 5 US ¢/ kWh (1990)	0.236 yuan/ kWh	5	Cost esti- mates for ORNL China project using gas turbines.
5 Mahin (1989)	160 kW	DM 780,000 (installed gasifier power plant)	11.73 (over 13 yrs in case of plant)	DM 85,877	nq	na	nq	DM 146,877 (total annual operating cost)	1987	0.26 DM/ kWh (1987)	0.28 DM/ kWh	17.2	Compares gasifier plant with diesel plant, which has total cost of power as 0.48 DM/ kWh.

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

(continued on next page)

(Table A3.1 continued)

Reference	Plant size in MW _p	Capital cost	Interest rate (%)	Annualized capital cost	Lifetime (years)	Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity		Notes		
										Units quoted	1990 prices		US\$/kWh (1990)	
6	Grassi (1992)	2 to 30	2000 ECU/ kW	10	nq	25	50 ECU/ dry tonne/ 120 ECU/ TOE in table	20 (power gen.)	0.009 ECU/ kWh	1992	0.092-0.11 ECU/ kWh (assuming 1992)	-	11.8-14.1 (converted to US\$ at Sept 1992 ECU ex- change rate, and then to US\$1990)	Existing systems.
7	Grassi (1992)	large	1200-1300 ECU/ kW	10	nq	30	50 ECU/ dry tonne biomass and 170-176 ECU/ TOE biocrude oil prod.	35-38 (power gen.)	0.006 ECU/ kWh	1995	0.06-0.066 ECU/ kWh (assuming 1992)	-	7.7-8.4 (converted to US\$ at Sept 1992 ECU ex- change rate, and then to US\$1990)	Projected costs for thermal power station fueled by biocrude oil or water charcoal slurry.
8	Grassi (1992)	100 to 500 kW	330 ECU/ kW	10	nq	20	50 ECU/ dry tonne biomass and 150 ECU/ TOE fuel	33-40 (power gen.)	0.008 ECU/ kWh	1997	0.05 ECU/ kWh (assuming 1992)	-	6.4 (converted to US\$ at Sept 1992 ECU exchange rate, and ten to US\$1990)	Projected costs for decentralized electricity pro- duction by firing small biomass pow- der in ceramic gas turbines.
9	Grassi (1992)	<500 kW	900- 1200 ECU/ kW	10	nq	20	300 ECU/ TOE up- graded biocrude oil	55- 60 (power gen.)	0.01 ECU/ kWh	1997	0.068 ECU/ kWh (assuming 1992)	-	8.7 (converted to US \$ at Sept 1992 ECU ex- change rate, and then to US \$1990)	Advanced concept of the above.
10	Grassi (1992)	0.3- 50	930 ECU/ kW	10	nq	20	50 ECU/ dry tonne biomass and 300 ECU/ TOE up- graded biofuel	50	0.004 (base) and 0.007 (peak) ECU/ kWh	1996	0.072 (base) and 0.085 (peak) ECU/ kWh (assuming 1992)	-	9.2 (base) and 10.9 (peak) (converted to US \$ at Sept 1992 ECU exchange rate, and then to US \$1990)	Projected costs for elec- tricity produc- tion by aero- engine- derived gas turbine-steam turbine com- bined cycles fueled by upgraded biocrude oil.

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

Reference	Plant size in MW _p	Capital cost	Interest rate (%)	Annualized capital cost	Lifetime (years)	Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity			Notes	
										Units quoted	1990 prices	US¢/kWh (1990)		
11	Grassl (1992)	1 to 30	2000 ECU/ kW	10	nq	20	50 ECU/ dry tonne/ 120 ECU/ TOE	40	0.009 ECU/ kWh	1996	0.067- 0.068 ECU/ kWh (assuming 1992)	-	8.6-8.7 (converted to US \$ at Sept 1992 ECU ex- change rate, and then to US \$1990)	Projected costs for electricity pro- duction by gasification of biomass and use of aero- engine- derived gas turbine/ steam turbine combined cycle.
12	Grassl (1992)	nq	930 ECU/ kW	10	nq	20	500 ECU/ TOE	50	0.007 ECU/ kWh	1992	0.119 ECU/ kWh (assuming 1992)	-	15.2 (converted to US \$ at Sept 1992 ECU ex- change rate, and then to US \$1990)	Projected costs for bio- ethanol system.
13	Grassl (1992)	nq	600 ECU/ kW	10	nq	20	150 ECU/ TOE	30	0.008 ECU/ kWh	1997	0.071 ECU/ kWh (assuming 1992)	-	9.1 (converted to US \$ at Sept 1992 ECU ex- change rate, and then to US \$1990)	Projected cost for biomass powder system.
14	BTG (1992a)	880 kW gen- erator	estimated at ECU 490,000 (DM 1 mln at 1980 prices)	nq	nq	nq	na	85% (gene- rator)	nq	1992	Sold to grid for 0.04 (peak) and 0.03 (base) ECU/ kWh (1992)	-	Sold at 3.5 (base) and 4.6 (peak) (converted to US \$ at March 1992 ECU ex- change rate, and then to US \$1990)	Wood-waste fired co- generation plant installed in 1980 (1 ECU = DM 2.05 in March 1992).

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

(continued on next page)

(Table A3.1 continued)

Reference	Plant size in MWP	Capital cost	Interest rate (%)	Annualized capital cost	Lifetime (years)	Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity			Notes
										Units quoted	1990 prices	US¢/kWh (1990)	
15 BTG (1992b)	3.5 (gen- era- tor)	ECU 6.6 mln (DM 13.5 mln) for boiler and ECU 1.7 mln (DM 3.5 mln) for turbine and generator	nq	nq	nq	na	96% (gene- rator)	nq	1992	Est. at 0.02 ECU/kWh (0.05 DM/ kWh)/ Sold to grid for 0.06 (peak) and 0.04 (base) ECU/ kWh (1992)	-	2.3 (0.02 ECU/kWh converted to US \$ at March 1992 ECU ex- change rate, and then to US \$1990)	Wood-waste fired cogen- eration plant. Cost calcula- tion does not include invest- ment for boiler and man- power costs (required in any case).
16 World Energy Council (1992)	na	na	na	na	na	1.9- 3.9 \$/ GJ (1987) quot- ing Hall (1992); up to 4.9 \$/ GJ in US in 1992 and est. 2.0\$/ GJ by 2000	na	na	1992	Quotes 5-6 US ¢/ kWh (1989) in USA (Hall and others, 1991 and Johansson and others, 1993) Rosillo-Calle and Hall (1992) sug- gest est. 4 ¢/ kWh for elec. in Brazil (no dates)	5.3-6.3 (USA) and approx 4 (Brazil) US ¢/ kWh.	5.3-6.3 (USA) and approx. 4 (Brazil)	
17 Terrado (1985)	3	2116 \$/ kW (1984 \$) (base in- stalled cost)	12	-	29	na	-	Detailed in ref- erence. Costs are for planta- tion and power plant.	1985	12.08 US ¢/ kWh (1984)	15.2 US ¢/ kWh	15.2	Cost estimate for direct combustion/ steam turbine 3 MW plant.
18 Terrado (1985)	10	1705 \$/ kW (1984 \$) (base in- stalled cost)	12	-	29	na	-	Detailed in ref- erence. Costs are for planta- tion and power plant.	1985	8.41 US ¢/ kWh (1984)	10.6 US ¢/ kWh	10.6	Cost estimate for direct combustion/ steam turbine 10 MW plant.
19 Terrado (1985)	50	1272 \$/ kW (1984 \$) (base in- stalled cost)	12	-	29	na	-	Detailed in ref- erence. Costs are for planta- tion and power plant.	1985	6.63 US ¢/ kWh (1984)	8.3 US ¢/ kWh	8.3	Cost estimate for direct combustion/ steam turbine 50 MW plant.

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

Reference	Plant size in MWp	Capital cost	Interest rate (%)	Annualized capital cost	Lifetime (years)	Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity			Notes
										Units quoted	1990 prices	US¢/kWh (1990)	
20 U.S. Congress (1992)	5-50,000 kW	1,900 \$/kW	7	nq	nq	\$2/ GJ (1990)	nq	nq	1992	5-7 US ¢/ kWh (1990)	5-7 US ¢/ kWh	5 to 7	Electricity from biomass using steam turbine; numbers based on operating experience.
21 U.S. Congress (1992)	5 kW	1,200 \$/kW	7	nq	nq	\$2/ GJ (1990)	nq	nq	1992	10 US ¢/ kWh (1990)	10 US ¢/ kWh	10	Electricity from biomass using biogas internal combustion engine; numbers based on operating experience.
22 U.S. Congress (1992)	5-100 kW	680-420 \$/kW	7	nq	nq	\$2/ GJ (1990)	nq	nq	1992	24-15 US ¢/ kWh (1990)	24-15 US ¢/ kWh	24-15	Electricity from biomass using producer gas internal combustion engine; numbers based on operating experience.
23 U.S. Congress (1992)	50	1,150 \$/kW	7	nq	nq	\$2/ GJ (1990)	nq	nq	1992	4-5 US ¢/ kWh (1990)	4-5 US ¢/ kWh	4 to 5	Electricity from biomass using producer gas-gas turbines; technology near commercialization.
24 U.S. Congress (1992)	100	890 \$/kW	7	nq	nq	\$2/ GJ (1990)	nq	nq	2000	3-4 US ¢/ kWh (1990)	3-4 US ¢/ kWh	3 to 4	Electricity from biomass using producer gas-gas turbines; technology possible by 2000 with concerted R,D&D effort.
25 U.S. DOE (1990a)	50	\$1,500/ kW; 2.5 ¢/ kWh levelized (constant 1988 \$)	nq	nq	nq	1.00-2.00 \$/ MMBtu; 1.2-2.4 ¢/ kWh levelized (constant 1988 \$)	nq	0.5 ¢/ kWh levelized (constant 1988 \$)	1990	4.2-5.4 ¢/ kWh levelized (constant 1988 \$)	4.6-6.0 US ¢/ kWh	4.6-6.0	Depends on fuel cost being approximately \$2/ MMBtu.

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

(continued on next page)

(Table A3.1 continued)

Reference	Plant size in MWp	Capital cost	Interest rate (%)	Annualized capital cost	Lifetime (years)	Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity			Notes
										Units quoted	1990 prices	US¢/kWh (1990)	
26 ESMAP (1987)	-	-	10% (real dis- count rate)	\$246,790 (1985)	12 (diesel)/ 15 (steam)	\$96,000/ yr	nq	\$167,100/ yr	1985	19.2 US ¢/ kWh (1985) av. elec. cost	23.3 US ¢/ kWh	23.3	Financial analysis of Ehania palm oil processing facility (Côte d'Ivoire).
27 ESMAP (1987)	-	-	10% (real dis- count rate)	\$327,450 (1985)	15 (steam)	0	nq	\$470,980/ yr	1985	6.8 US ¢/ kWh (1985) average electricity cost	8.3 US ¢/ kWh	8.3	Financial cost esti- mate for Ehania palm oil process- ing facility. Use of additional equip- ment to maximize electricity produc- tion is assumed. Total proposed electricity produc- tion = 11.8 GWh/ yr.
28 ESMAP (1987)	1.3	-	10% (real discount rate)	\$259,332 / yr	-	0	nq	\$181,100/ yr	1985	6.6 ¢/ kWh (1985)	8.0 US ¢/ kWh	8	Estimate of energy potential from wood residues for large-scale semi- integrated mills. Analysis of case study, assumes use of additional equipment for existing plant. Total proposed electricity produc- tion = 6.7 GWh/ yr.
29 ESMAP (1987)	0.275	-	10% (real discount rate)	\$76,904/ yr	-	0	nq	\$34,800/ yr	1985	20.3 ¢/ kWh (1985)	24.6 US ¢/ kWh	24.6	Estimate of energy potential from wood residues for small-scale sawmills. Financial analysis of steam plant for Sinfra Sawmill, assuming use of additional equipment for existing plant. Total proposed electricity produc- tion = 0.55 GWh/ yr.

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

Reference	Plant size		Interest rate (%)	Annualized capital cost	Lifetime (years)	Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity			Notes
	In MW _p	Capital cost								Units quoted	1990 prices	US¢/kWh (1990)	
30 ESMAP (1987)	-	-	10% (real discount rate)	\$152,341 / yr	-	0	nq	\$82,399/ yr	1985	3.7 ¢/ kWh (1985)	4.5 US ¢/ kWh	4.5	Estimate of energy potential from coffee residues. Cost per total electricity production (6.38 GWh/ yr) for Abolisso Coffee Decortication Plant. Scenario assumes additional equipment to convert all residues to process heat and electricity.
31 ESMAP (1987)	-	-	10% (real discount rate)	\$304,560 / yr	15	0	nq	\$102,610/ yr	1985	17.4 ¢/ kWh (1985)	21.1 US ¢/ kWh	21.1	Estimate of energy potential from rice residues. Financial analysis of large Ivorian Rice Mill. Scenario assumes maximum electricity production (2.34 GWh/ yr).
32 ESMAP (1987)	-	-	10% (real discount rate)	\$50,430/ yr	15	0	nq	\$26,220/ yr	1985	21.9 ¢/ kWh (1985)	26.6 US ¢/ kWh	26.6	Estimate of energy potential from rice residues (medium-scale mill). Financial analysis of model; installation of gasifier plant for proposed electricity production of 350 MWh/ yr.

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

(continued on next page)

(Table A3.1 continued)

Reference	Plant size in MW _p	Capital cost	Interest rate (%)	Annualized capital cost	Lifetime (years)	Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity			Notes
										Units quoted	1990 prices	US¢/kWh (1990)	
33 ESMAP (1987)	-	-	10% (real discount rate)	\$13,150/ yr	15	0	nq	\$4,230/ yr	1985	38.6 ¢/ kWh (1985)	46.9 US ¢/ kWh	46.9	Estimate of energy potential from rice residues (small-scale mill). Financial analysis of model; installation of locomobile plant. Proposed electricity production = 45 MWh/yr.
34 ESMAP (1991a)	-	Rs. 85.4 million	Assume 10%	Rs. 11.2 million	Assume 15 years	Assume nil		Rs. 1.1 mil- lion	1991	Rs. 0.37/ kWh (1991)	-	Approx. 2.2	Calculations carried out based on capital and O&M costs quoted to generate maximum possible electricity (sale of excess electricity not included) for 2500 TCD sugar mill. Expected total electricity production = 29,587 MWh/yr.
35 ESMAP (1991a)	-	Rs. 110.9 million	Assume 10%	Rs. 14.6 million	Assume 15 years	Assume nil		Rs. 1.5 mil- lion	1991	Rs. 0.39/ kWh (1991)	-	Approx. 2.3	Calculations carried out based on capital and O&M costs quoted to generate maximum possible electricity (sale of excess electricity not included) for 3500 TCD sugar mill. Expected total electricity production = 41,423 MWh/yr.

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

Reference	Plant size in MWp	Capital cost	Interest rate (%)	Annualized			Fuel cost	Efficiency (%)	O&M cost	Year	Cost of electricity			Notes
				capital cost	Lifetime (years)	Year					Units quoted	1990 prices	US¢/kWh (1990)	
36 ESMAP (1991a)	-	Rs. 142.8 million	Assume 10%	Rs. 18.8 million	Assume 15 years	Assume nil	-	Rs. 1.9 mil- lion	1991	Rs. 0.35/ kWh (1991)	-	Approx. 2.1	Calculations carried out based on capital and O&M costs quoted to generate maximum possible electricity (sale of excess electricity not included) for 5000 TCD sugar mill. Expected total electricity production= 59,172 MWh/yr.	
37 ESMAP (1988)	-	Details in ref.	10% (real discount rate)	Details in ref.	15 yrs	-	-	Details in ref.	1988	5.6 to 7.1 US ¢/ kWh (assuming 1988)	6.2-7.8 US ¢/ kWh	6.2-7.8	Estimated marginal financial costs for residue fueled cogenerated electricity at large sawmill in Ghana.	
38 Rajabapalah and others (1993)	5 kW	\$1,207/ kW (1990)	nq	nq	25	nil?	nq	nq	1992	>25 US ¢/ kWh (assuming 1992)	>23.4 US ¢/ kWh	>23.4	Cost of biogas electricity generation for existing 4.2 hours/ day of operation (the Pura village case study).	
39 Rajabapalah and others (1993)	5 kW	\$1,207/ kW (1990)	nq	nq	25	nil?	nq	nq	1992	12 US ¢/ kWh (assuming 1992)	11.2 US ¢/ kWh	11.2	Estimated cost of biogas electricity generation for approximately 15 hours/ day operation (the Pura village case study).	
40 International Energy Agency (1987)	5	\$7,687,500 (not includ- ing cost of boiler)	5	-	20	-	-	\$122,917	1987	4.1 US ¢/ kWh (assuming 1987)	4.7 US ¢/ kWh	4.7	Estimate for urban garbage-fueled power station in Japan.	

Note: na = not applicable; nq = not quoted; MW_p = peak megawatt

Annex 4. Land Requirements for Power Stations

Table A4.1. Land Requirements for Power Stations

<i>Item no.</i>	<i>Reference</i>	<i>Type</i>	<i>Size MW</i>	<i>Area (sq. km)</i>	<i>Ratio sq. km / MW</i>	<i>Notes</i>
1	Terrado (1985)	Dendrothermal plantation	50	300	6	Land requirement for plantation under assumptions made in analysis.
2	IFC back-to-office report, 1991	Luz parabolic trough solar thermal system	80	483,960 sq. m. (0.48 sq. km.) of reflector covering approx. 1 sq. mile (2.59 sq. km.) area (text). Total land 416 acres (1.68 sq. km.) (annexure)	0.021	Ratio calculated on the basis of 416 acres.
3	De Laquil and others (1993)	Solar One solar-thermal central receiver plant	10	Collector area 71,084 sq. m.	0.007	
4	De Laquil and others (1993)	CESA-1 solar-thermal central receiver plant	1	Collector area 11,880 sq. m.	0.01	
5	De Laquil and others (1993)	Eurelios solar-thermal central receiver plant	1	Collector area 6,216 sq. m.	0.006	
6	Boes and Luque (1993)	PV concentrator power system	0.3	Total array area 3,806 sq. m.	0.013	Soleras, Saudi Arabia. Average annual DC efficiencies ~ 9%.
7	Boes and Luque (1993)	PV concentrator power system	0.225	Total array area 2,022 sq. m.	0.009	Sky Harbor, Phoenix, Arizona. Average annual DC efficiencies ~ 6.5%.
8	Boes and Luque (1993)	PV concentrator power system	0.025	Total aperture area 245 sq. m.	0.01	DFW, Dallas-Fort Worth, Texas. Electric and thermal efficiencies, 7% and 39%, respectively.
9	Moreira and Poole (1993)	Jaguari hydroplant	24	—	0.004	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 2400 kW/ha
10	Moreira and Poole (1993)	Sapucaia hydroplant	300	—	0.014	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 714 kW/ha
11	Moreira and Poole (1993)	Xingo hydroplant	5,000	—	0.017	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 588.2 kW/ha
12	Moreira and Poole (1993)	Segredo hydroplant	1,260	—	0.065	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 152.7 kW/ha

(continued on next page)

112 Renewable Energy Technologies

(Table A4.1 continued)

Item no.	Reference	Type	Size MW	Area (sq. km).	Ratio sq. km./ MW	Notes
13	Moreira and Poole (1993)	Ita hydroplant	1,620	—	0.086	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 116.7 kW/ha
14	Moreira and Poole (1993)	Itaipu hydroplant	12,600	—	0.11	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 93.6 kW/ha
15	Moreira and Poole (1993)	Belo Monte hydroplant	11,000	—	0.11	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 89.8 kW/ha
16	Moreira and Poole (1993)	Machadinho hydroplant	1,200	—	0.22	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 45.8 kW/ha
17	Moreira and Poole (1993)	Garabi hydroplant	1,800	—	0.44	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 22.5 kW/ha
18	Moreira and Poole (1993)	Itaparica hydroplant	1,500	—	0.56	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 18 kW/ha
19	Moreira and Poole (1993)	Tucurui hydroplant	3,900	—	0.72	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 13.9 kW/ha
20	Moreira and Poole (1993)	Tres Irmaos hydroplant	640	—	1.1	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 9.0 kW/ha
21	Moreira and Poole (1993)	Porto Primavera hydroplant	1,800	—	1.2	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 8.4 kW/ha
22	Moreira and Poole (1993)	Serra da Mesa hydroplant	1,200	—	1.5	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 6.7 kW/ha
23	Moreira and Poole (1993)	Camargos hydroplant	45	—	1.6	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 6.1 kW/ha
24	Moreira and Poole (1993)	Manso hydroplant	210	—	1.9	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 5.4 kW/ha
25	Moreira and Poole (1993)	Samuel hydroplant	217	—	3	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 3.3 kW/ha
26	Moreira and Poole (1993)	Sobradinho hydroplant	1,050	—	4	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 2.5 kW/ha
27	Moreira and Poole (1993)	Balbina hydroplant	250	—	9.1	Selected existing and planned hydroplants, Brazil. Power output to inundated area = 1.1 kW/ha

Annex 5. The Luz Experience

The bankruptcy of Luz International Limited (Luz), the company responsible for setting up and running the Luz SEGS power plants in California, has raised many questions about the future of the technology. It should be noted, however, that the plants are still operating under new companies formed by groups of the SEGS plants' owners/investors (which include some U.S. utilities), and they continue to provide much information on technical performance and costs. A synopsis of the difficulties encountered by the Luz Corporation, along with comments, is presented below (see Lotker 1991, De Laquil and others 1993, and Kearney and Price 1992 for further information).

Each SEGS project was set up with private financing from investors, who benefited by receiving a return on their investment from revenues generated from electricity production; investors also benefited from certain financial incentives, such as Californian and U. S. Federal tax credits, that were in place at the time. The internal rate of return to investors was about 15 percent.


In 1991, Luz was unable to finance a tenth plant (SEGS X) because of financial and regulatory constraints. In the same year, the company was forced into bankruptcy. This business failure had a number of causes:

- a. The revenues generated from the sale of electricity were expected to cover the cash flow requirements of the plants, including operating and maintenance expenses. However, this sale price was linked to the price of natural gas, which progressively decreased from 1981 to 1991 (see figure), in real terms, by 78 percent. This resulted in reduced electricity revenues.
- b. Financial incentives, such as Californian and U.S. federal tax credits, although still available, had decreased by about half over the period 1981-91 (see figure). The incentives could also change unpredictably. For example, tax credits were renewed annually; however, in 1989 these were only renewed for nine months, forcing Luz to reduce the construction period for the SEGS IX plant from a planned ten months to seven months. This was achieved, but it weakened the company financially, as investors demanded a higher rate of return on their investments because of the increased risk, while vendors of goods and services charged a higher risk premium for their services from the company. Ironically, the tax credits were later extended in late 1990 until December 1991.
- c. The state of California recognized the greater land requirement of these solar plants compared with, say, a natural gas plant, and therefore exempted the solar field part of the plant from a state property tax. This exemption expired at the end of 1990 and was not reenacted until May 15, 1991; the delay meant that the tenth SEGS plant was also required to be constructed in about seven months (to get in under the December 31, 1991, expiration of the energy credits). Hence, Luz was further "squeezed" after the shortened construction period of the SEGS IX plant.

(continued on next page)

A number of important lessons can be learned from the Luz experience. First, consistency and durability of policies is essential. It is a prerequisite at the early stage of any new technology—particularly one that is highly capital-intensive. The unpredictable changes in this particular case not only squeezed Luz financially by causing it to accelerate construction of the SEGS IX plant from 10 to 7 months but also raised risks and deterred investors. Second, the wisdom of basing the price of electricity from a renewable energy technology on a mature fossil fuel price, such as natural gas, which is linked to other factors, must surely be questioned. Thus, not only were the positive environmental features of the technology not recognized in the price obtained for the electricity generated but investors were deterred, because any investment was tantamount to “gambling” on future fossil fuel prices.

Figure A5.1. Energy Prices and Policy Support for Solar Energy, 1980-1991

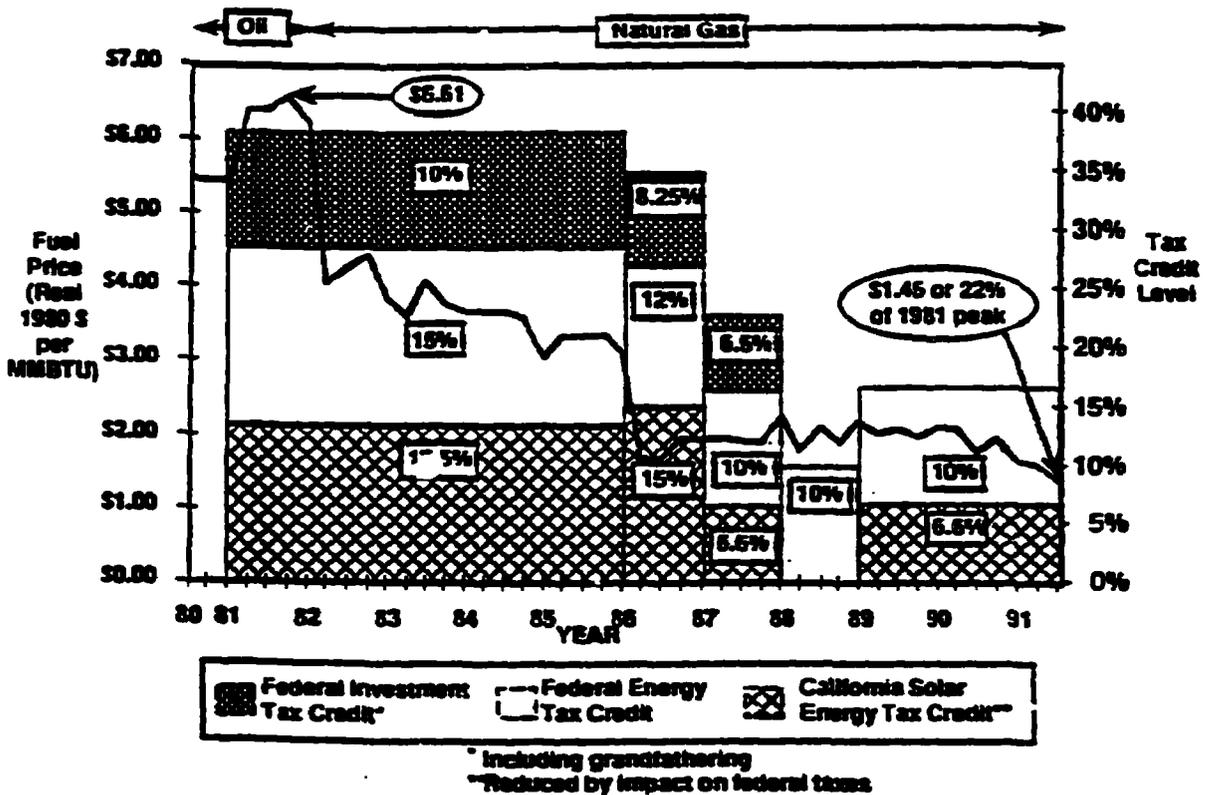

Source: Lotker (1991).

Annex 6. Calculated Cost of Electricity from Solar-Thermal Technologies

Table A6.1. Calculated Cost of Electricity from Solar-Thermal Technologies

<i>Reference</i>	<i>System</i>	<i>Size</i>	<i>Capital costs (\$/kW_p)</i>	<i>O&M costs</i>	<i>Lifetime of plant (years)</i>	<i>Capacity factor (%)</i>	<i>Calculated cost US¢/kWh (1990)</i>	<i>Quoted cost</i>	<i>Year</i>	<i>Notes</i>
PARABOLIC TROUGH TECHNOLOGY										
1 U.S. Congress (1992)	Parabolic trough/ natural gas hybrid	80 MW	3000	1.5 ¢/kWh	30	40	11.5	9.30 ¢/kWh (1990)	1990	Quoted cost assumes 7% discount rate and 0.90 ¢/kWh fuel costs.
2 U.S. DOE (1992c)	Parabolic trough/ natural gas hybrid	80 MW	3100	2.2 ¢/kWh	30	40	12.5	—	1991	All costs in 1990 \$. Net electricity output = 281,000 MWh/yr and fuel cost of \$2,505,800/yr.
3 U.S. DOE (1992c)	Parabolic trough/ natural gas hybrid	80 MW	2675	1.26 ¢/kWh	30	40	10.1	—	1998	All costs in 1990 \$. Net electricity output = 287,710 MWh/yr and fuel cost of \$2,829,120/yr.
4 U.S. DOE (1992c)	Parabolic trough/ natural gas hybrid	Assume 80 MW	nq	15-20% of total levelized costs	nq	nq	—	8.5 ¢/kWh (1990)	1992	Assume 1992. Levelized cost "according to Luz."
5 De Laquil and others (1993)	Parabolic trough	80 MW	2800-3500	1.8-2.5 ¢/kWh	Assume 30	25-22 (solar only)	14-20	11.8-16.7 ¢/kWh (solar); 13.0-9.3 ¢/kWh (hybrid, 25% natural gas)	1992	Assume costs are in 1992 \$.
6 De Laquil and others (1993)	Parabolic trough	80 MW	2400-3000	1.6-2.4 ¢/kWh	Assume 30	26-18 (solar only)	12 to 21	9.8-17.2 ¢/kWh (solar); 13.5-7.9 ¢/kWh (hybrid, 25% natural gas)	1995-2000	Assume costs are in 1992 \$.
7 De Laquil and others (1993)	Parabolic trough	80 MW	2000-2400	1.3-2.0 ¢/kWh	Assume 30	27-22 (solar only)	10 to 14	7.9-11.7 ¢/kWh (solar); 9.3-6.5 ¢/kWh (hybrid, 25% natural gas)	2000-2005	Assume costs are in 1992 \$.

Note: na = not applicable; nq = not quoted; kW_p = peak kilowatts; Tech. = technology.

(continued on next page)

(Table A6.1 continued)

Reference	System	Size	Capital costs (\$/kW _p)	O&M costs	Lifetime of plant (years)	Capacity factor (%)	Calculated cost US¢ /kWh (1990)	Quoted cost	Year	Notes
8 IFC back-to-office report, 1991	Parabolic trough/ 50% natural gas hybrid	80 MW	2813	1.30 ¢/kWh	Assume 30	53	7.4	6.80 ¢/kWh	1991	Luz data. Assume costs in 1991 \$.
9 IFC back-to-office report, 1991	Parabolic trough/ 30% natural gas hybrid	80 MW	3708	2.22 ¢/kWh	Assume 30	37	13.8	14.67 ¢/kWh	1991	Author's calculations based on info. on Luz plants. Assume costs in 1991 \$.
10 IFC back-to-office report, 1991	Parabolic trough	80 MW	3575	3.17 ¢/kWh	Assume 30	26	19	18.93 ¢/kWh	1991	Author's calculations based on info. on Luz plants. Assume costs in 1991 \$.
11 IFC back-to-office report, 1991	Parabolic trough/ 50% natural gas hybrid	200 MW	2000	0.80 ¢/kWh	Assume 30	53	5.2	5.10 ¢/kWh	1991	Luz data. Assume costs in 1991 \$.
12 IFC back-to-office report, 1991	Parabolic trough/ 50% natural gas hybrid	200 MW	2638	1.07 ¢/kWh	Assume 30	53	6.8	8.30 ¢/kWh	1991	Author's calculations based on info. on Luz plants. Assume costs in 1991 \$.
13 IFC back-to-office report, 1991	Parabolic trough	200 MW	2500	2.15 ¢/kWh	Assume 30	26	13.2	13.62 ¢/kWh	1991	Author's calculations based on info. on Luz plants. Assume costs in 1991 \$.
14 Keamey and Price (1992)	Parabolic trough/ natural gas hybrid	80 MW	3000	25% of total elec. cost	Assume 30	35	12.1	-	1992	Assume costs in 1992 \$. Data based on Luz plants.
15 Keamey and Price (1992)	Parabolic trough	80 MW	3000	25% of total elec. cost	Assume 30	25	17	-	1992	Assume costs are in 1992 \$. Data based on Luz plants.
16 Walton and Hall (1990)	Parabolic trough	nq, but based on Luz data	2100	1.21 US ¢/kWh (1990)	Assume 30	26	11	nq	1990	Based on Luz plant data. Construction costs include allowance for gas boiler, but capacity factor altered by authors to exclude natural gas from analysis.
17 U.S. DOE (1990b)	Parabolic trough/ natural gas hybrid	80 MW	nq	nq	nq	nq	-	13 ¢/kWh	1990	Assume 1990 \$. Calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."
18 U.S. DOE (1990b)	Parabolic trough/ natural gas hybrid	80 MW	nq	nq	nq	nq	-	12.2 ¢/kWh		5th plant to above. Assume 1990 \$. Cost calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."

Note: na = not applicable; nq = not quoted; kW_p = peak kilowatts; Tech. = technology.

Reference	System	Size	Capital costs (\$/kW _p)	O&M costs	Lifetime of plant (years)	Capacity factor (%)	Calculated cost US¢ /kWh (1990)	Quoted cost	Year	Notes	
19	U.S. DOE (1990b)	Parabolic trough/ natural gas hybrid	160 MW	nq	nq	nq	nq	—	9.9 ¢/kWh	1991	5th 160 MW plant. Assume 1990 \$. Cost calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."
20	Keamey (1991) Data from Meridian Corp.	Parabolic trough/ natural gas hybrid	80 MW	nq	nq	nq	nq	—	10 ¢/kWh (1990)	1991	For SEGS IX.
PARABOLIC DISH TECHNOLOGY											
21	U.S. DOE (1992c)	Parabolic dish (distributed)	0.5	780-2780	1.66-3.45 ¢/kWh	20	27-23	5.8-20.3	—	1998	All costs in 1990 \$. Net electricity output = 1,115 to 969 MWh/yr.
22	U.S. DOE (1992c)	Parabolic dish (modular)	30	1328	0.7 ¢/kWh	20	40	6.5	—	1998	All costs in 1990 \$. Net electricity output = 105000 MWh/yr and fuel cost of \$1,391,040/yr.
23	De Laquil and others (1993)	Parabolic dish/ Stirling engine	3 MW/yr	3000-5000	2.5-5.0 ¢/kWh	Assume 20	22-16	19-44	14.6-32.8 ¢/kWh	1995-2000.	Assume 2000 on graph. Assume costs are in 1992 \$.
24	De Laquil and others (1993)	Parabolic dish/ Stirling engine	30 MW/yr	2000-3500	2.0-3.0 ¢/kWh	Assume 20	26-20	12 to 25	8.8-18.6 ¢/kWh	2000-2005.	Assume 2005 on graph. Assume costs are in 1992 \$.
25	De Laquil and others (1993)	Parabolic dish/ Stirling engine	300 MW/yr	1250-2000	1.5-2.5 ¢/kWh	Assume 20	28-22	7 to 14	5.5-10.6 ¢/kWh	2005-2010.	Assume 2010 on graph. Assume costs are in 1992 \$.
26	U.S. DOE (1990b)	Parabolic dish	25 kW	nq	nq	nq	nq	—	20 ¢/kWh	1985 tech.	Assume 1990 \$. Calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."
27	U.S. DOE (1990b)	Parabolic dish	5-25 kW	nq	nq	nq	nq	—	12.1¢/kWh (solar) and 10.5 ¢/kWh (20% gas, hybrid mode)		5-25kW stand-alone modules Assume 1990 \$. Calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."
28	U.S. DOE (1990b)	Parabolic dish	25kW modules for utility scale plant	nq	nq	nq	nq	—	5.4¢/kWh (solar) and 5.5 ¢/kWh (20% gas, hybrid mode)		25kW modules mass-produced for utility Assume 1990 \$. Calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."

Note: na = not applicable; nq = not quoted; kW_p = peak kilowatts; Tech. = technology.

(continued on next page)

(Table A6.1 continued)

Reference	System	Size	Capital costs (\$/kW _p)	O&M costs	Lifetime of plant (years)	Capacity factor (%)	Calculated cost US¢/kWh (1990)	Quoted cost	Year	Notes	
CENTRAL RECEIVER TECHNOLOGY											
29	International Energy Agency (1987)	Central receiver	100 MW	2900	6,000,000 \$/yr	30	nq	43 (see note)	23¢/kWh (1984) assuming 5% discount rate; 13¢/kWh (1984) assuming 3.15% discount rate + favorable tax credits	1936	1986 U.S. DOE 5-Yr. R&D Plan. Electricity production = 108 GWh/yr. Note that calculated cost is 34 ¢ (1984)/kWh or 43 ¢ (1990)/kWh with 10% discount rate and 19.5 ¢ (1984)/kWh with 3.15% discount rate, with no tax credits.
30	International Energy Agency (1987)	Central receiver	100 MW	2200	3,000,000 \$/yr	30	nq	23 (see note)	11.5¢/kWh (1984) assuming 5% discount rate	1995	1986 U.S. DOE 5-Yr. R&D Plan; decrease reflects increase in efficiency, availability, and decrease in O&M. Electricity production = 148 GWh/yr. Note that calculated cost is 17.8 ¢ (1984)/kWh or 23 ¢ (1990)/kWh with 10% discount rate.
31	U.S. DOE (1992c)	Central receiver	200 MW	2951	0.51 ¢/kWh	30	70	5.6	-	1998	All costs in 1990 \$. Net electricity output = 1,226,561 MWh/yr.
32	International Energy Agency (1987)	Central receiver	50MW	nq	nq	nq	nq	-	\$0.16/kWh	1984	Feasibility study by Zurich municipal utility and SOTEL (Swiss consortium) for favorable Swiss site and 4,000 hours operation/yr under peak conditions.
33	De Laquil and others (1993)	Central receiver	100 MW	3000-4000	1.3-1.9 ¢/kWh	Assume 30	40-25	10 to 20	8.0-16.1 ¢/kWh	1995	Assume costs are in 1992 \$.
34	De Laquil and others (1993)	Central receiver	200 MW	2225-3000	0.8-1.2 ¢/kWh	Assume 30	40-30	7 to 12	5.8-10.1 ¢/kWh	2005	Assume costs are in 1992 \$.
35	De Laquil and others (1993)	Central receiver	200 MW	2900-3500	0.5-0.8 ¢/kWh	Assume 30	63-55	6 to 8	4.6-6.5 ¢/kWh	2005-2010.	Assume 2010 on graph Baseload. Assume costs are in 1992 \$.
36	De Laquil and others (1993)	Central receiver	200 MW	1800-2500	0.5-0.8 ¢/kWh	Assume 30	43-32	5 to 10	4.5-8.2 ¢/kWh	2005-2010.	Assume 2010 on graph Advanced receiver. Assume costs are in 1992 \$.
37	U.S. DOE (1990b)	Central receiver	100 MW	nq	nq	nq	nq	-	14.2 ¢/kWh	1986 tech. (study)	Assume costs are in 1990 \$. Cost calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."

Note: na = not applicable; nq = not quoted; kW_p = peak kilowatts; Tech. = technology.



<i>Reference</i>	<i>System</i>	<i>Size</i>	<i>Capital costs \$/kW_p</i>	<i>O&M costs</i>	<i>Lifetime of plant yrs</i>	<i>Capacity factor %</i>	<i>Calc. cost US¢ /kWh (1990)</i>	<i>Quoted cost</i>	<i>Year</i>	<i>Notes</i>
38 U.S. DOE (1990b)	Central receiver	100 MW	nq	nq	nq	nq	-	10.8 ¢/kWh (solar) and 10.3 ¢/kWh (23% gas, hybrid mode)		1st 100 MW plant. Assume costs are in 1990 \$. Cost calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."
39 U.S. DOE (1990b)	Central receiver	200 MW	nq	nq	nq	nq	-	7.9 ¢/kWh		1st 200 MW plant (5th CR plant) Assume 1990 \$. Calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."
40 U.S. DOE (1990b)	Central receiver	200 MW	nq	nq	nq	nq	-	5.7 ¢/kWh		1st 200 MW direct absorption receiver plant (6th CR plant) Assume 1990 \$. Cost calculated "utilizing common economic assumptions (i.e., fixed charge rate = 10.2%). Value of capacity credits is not included."

Note: na = not applicable; nq = not quoted; kW_p = peak kilowatts.

Annex 7. The Photovoltaic Effect


Excellent descriptions of the photovoltaic effect may be found in the U.S. Department of Energy's *Photovoltaic Fundamentals* (U.S. DOE 1991), Kelly (1993), and other texts. This description is for the reader's convenience (diagrams are from U.S. DOE 1991).

- A silicon atom has 14 electrons with 4 electrons in its outermost orbit.
- These 4 valence electrons are shared by 4 other silicon atoms in a crystal.
- So silicon atoms form a lattice.

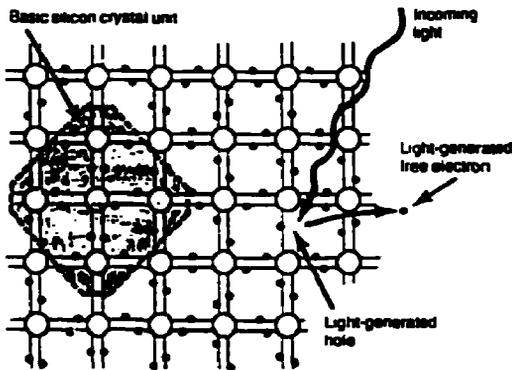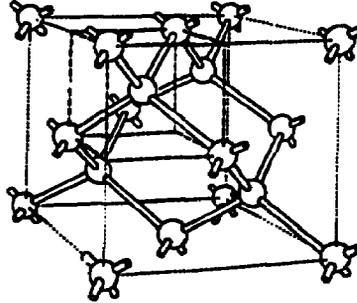


- Light of a *specific* energy can dislodge a negative electron from a bond, creating a positive hole.
- These negative and positive charges, which can move around freely, are the constituents of electricity.

• Silicon can be "doped" with atoms of other elements to alter the crystal's electrical properties.


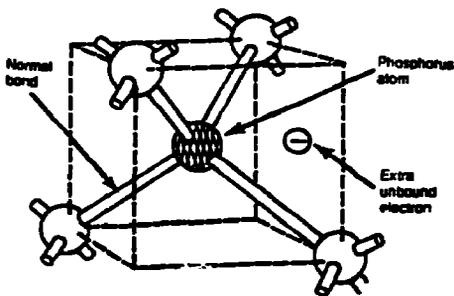


- n-type material (e.g., phosphorus atom with 5 valence electrons) is "dopant."
 - Results in the presence of an extra unbound electron in crystal.
 - Electrons are the majority charge carriers.

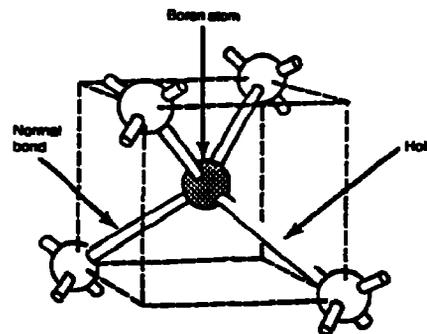



- p-type material (e.g., boron atom with 3 valence electrons) is "dopant."
 - Results in a hole in the crystal.
 - Holes are the majority charge carriers.

- When a p-type material is placed in contact with an n-type material, an electric field forms at the junction.
- This is caused by two effects:
 - a. Diffusion of the charge carriers from areas of high concentration to areas of low concentration.
 - b. Electric attraction by the opposite charge of the majority carriers across the junction.

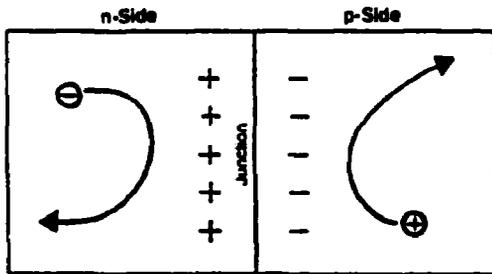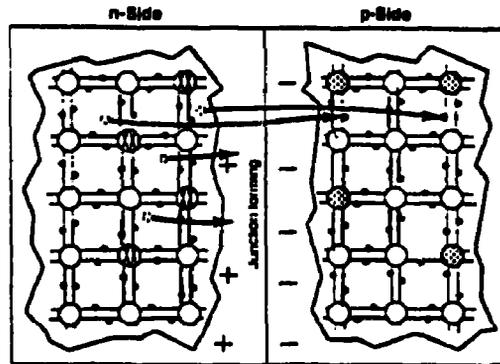

- Eventually equilibrium is reached when any additional crossover is repelled.
- The strength of the field depends on the amount of dopant in the silicon.

- When sunlight of a specific energy (called the "band gap") strikes the cell, charge carriers are created.
- These carriers would normally recombine in a fraction of a second, however the cell is so designed that the electric field across the junction pushes electrons to one side and holes to the other.

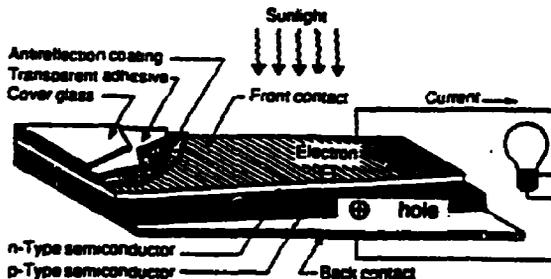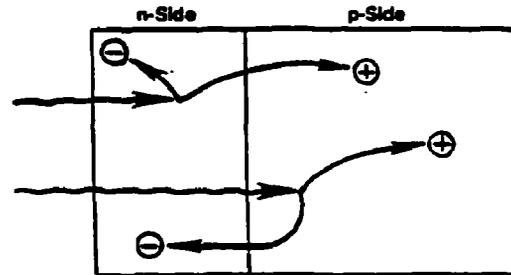

- If an external circuit is connected, current flows.
- Electrons from the n-layer can flow through the circuit to the p-layer and recombine with the holes.

Annex 8. Cost of Electricity from Photovoltaic Systems

Table A8.1. Cost of Electricity from Photovoltaic Systems

Reference	Module			Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes	
	Size (W)	life (yrs)	Efficiency (%)	O&M	BOS	Module	System				Electricity
1 Costello and Rappaport (1980)	-	-	-	-	-	< \$10/ W _p (assume 1980 \$)	-	- \$1-2/ kWh	158-317	1980	No details given.
2 Costello and Rappaport (1980)	-	-	-	-	-	~ \$20/ W _p (assume 1975 \$)	-	-	-	1975	1st large US federal purchase for terrestrial use
3 Costello and Rappaport (1980)	-	-	-	-	-	~ \$15-36/ W _p (assume 1978 \$)	-	-	-	1978	Result of SERI survey of commercial module prices in 1978, sold in small quantities
4 Costello and Rappaport (1980)	-	-	-	-	-	~ \$10-15/ W _p (assume 1978 \$)	-	-	-	1978	Result of SERI survey of commercial module prices in 1978, sold in large quantities
5 Costello and Rappaport (1980)	-	-	-	-	-	-	\$20-40/ W _p (assume 1979 \$)	-	-	1978-79	
6 Carlson (1990)	-	-	7 to 8 (module)	-	-	-	-	-	-	1976	Crystalline Si: average commercial module efficiency (source: Solarex Corporation)
7 Carlson (1990)	-	-	9 to 10 (module)	-	-	-	-	-	-	1980	Crystalline Si: average commercial module efficiency (source: Solarex Corporation)
8 Carlson (1990)	-	-	11 to 12 (module)	-	-	-	-	-	-	1985	Crystalline Si: average commercial module efficiency (source: Solarex Corporation)
9 Carlson (1990)	-	-	12 to 13 (module)	-	-	-	-	-	-		Assume Crystalline Si 1990
10 Carlson (1990)	-	-	14.5-23.2 (cell)	-	-	-	-	-	-		Assume Crystalline Si (higher values 1990 for single crystal)
11 Carlson (1990)	-	-	4 to 5 (module)	-	-	-	-	-	-		Assume Amorphous Si commercial 1990 modules (after several months of operation)

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
12	Carlson (1990)	-	-	11 to 12 (cell)	-	-	-	-	-	-	Assume Amorphous Si (in laboratory) 1990
13	Carlson (1990)	-	-	11 to 17 (cell)	-	-	-	-	-	-	Assume Amorphous Si (multijunctional) 1990
14	Carlson (1990)	-	-	11 to 14 (cell)	-	-	-	-	-	-	Assume Polycrystalline thin film CIS-1990 based solar cells
15	Carlson (1990)	-	-	20-27 (cell)	-	-	-	-	-	-	Assume Concentrators (Single crystal 1990 Si)
16	Carlson (1990)	-	-	29 (cell)	-	-	-	-	-	-	Assume Concentrators (GaAs) 1990
17	Carlson (1990)	-	-	37 (cell)	-	-	-	-	-	-	Assume Concentrators (GaAs/ GaSb) 1990
18	Carlson (1990)	-	-	-	-	-	\$4/ W _p (1987 \$)	-	-	-	1988 Called solar cell cost in text, but factory module price in graph.
19	Carlson (1990)	-	-	-	-	-	\$100/ W _p (assume 1972 \$)	-	-	-	Early 1970s Called solar cell cost in text, but factory module price in Assume graph. 1972.
20	Carlson (1990)	-	-	-	-	-	\$13/ W _p (1987 \$)	-	-	-	1980 Factory price for module.
21	Real Goods (1991)	48	-	-	-	-	\$6.85-7.27/ W _p (1991)	-	-	-	1991 Mfr.: Hoxan (helipower); H-4810; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
22	Real Goods (1991)	96	-	-	-	-	\$4.47-4.99/ W _p (1991)	-	-	-	1991 Mfr.: Siemens; recycled Arco modules (6-7 yrs old); single crystal. Higher price is for 1-3 modules; lower for >20.
23	Real Goods (1991)	48	-	-	-	-	\$8.73-9.35/ W _p (1991)	-	-	-	1991 Mfr.: Siemens; M-75; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
24	Real Goods (1991)	53	-	-	-	-	\$9.04-9.42/ W _p (1991)	-	-	-	1991 Mfr.: Siemens; M-55; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
25 Real Goods (1991)	40	-	-	-	-	\$8.98-9.73/ W _p (1991)	-	-	-	1991	Mfr.: Siemens; M-40; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
26 Real Goods (1991)	43	-	-	-	-	\$9.51-10.21/ W _p (1991)	-	-	-	1991	Mfr.: Siemens; M-65; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
27 Real Goods (1991)	22	-	-	-	-	\$11.32/ W _p (1991)	-	-	-	1991	Mfr.: Siemens; M-20; single crystal; self-regulating module; actual sale price of module.
28 Real Goods (1991)	37	-	-	-	-	\$9.16-9.97/ W _p (1991)	-	-	-	1991	Mfr.: Siemens; M-35; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
29 Real Goods (1991)	48	-	-	-	-	\$8.94-9.56/ W _p (1991)	-	-	-	1991	Mfr.: Siemens; M-50; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
30 Real Goods (1991)	5	-	-	-	-	\$17.80/ W _p (1991)	-	-	-	1991	Mfr.: Siemens; T-5; single crystal; useful for small applications; actual sale price of module.
31 Real Goods (1991)	2.5	-	-	-	-	\$23.60/ W _p (1991)	-	-	-	1991	Mfr.: Siemens; G-50; single crystal; useful for very small applications; actual sale price of module.
32 Real Goods (1991)	51	-	-	-	-	\$7.82-8.22/ W _p (1991)	-	-	-	1991	Mfr.: Kyocera; K-51; multicrystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
33 Real Goods (1991)	45.3	-	-	-	-	\$7.92-8.59/ W _p (1991)	-	-	-	1991	Mfr.: Kyocera; K-45; multicrystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
34 Real Goods (1991)	62.7	-	-	-	-	\$8.60-8.92/ W _p (1991)	-	-	-	1991	Mfr.: Kyocera; K-63; multicrystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
35 Real Goods (1991)	30	-	-	-	-	\$13.30/W _p (1991)	-	-	-	1991	Mfr.: Solarex; MSX30 Unbreakable Module; multicrystal; Thin, lightweight, portable; actual sale price of module.
36 Real Goods (1991)	18.6	-	-	-	-	\$12.85/W _p (1991)	-	-	-	1991	Mfr.: Solarex; MSX18 Unbreakable Module; multicrystal; Thin, lightweight, portable; actual sale price of module.
37 Real Goods (1991)	10	-	-	-	-	\$13.90/W _p (1991)	-	-	-	1991	Mfr.: Solarex; MSX10 Unbreakable Module; multicrystal; Thin, lightweight, portable; actual sale price of module.
38 Real Goods (1991)	60	-	-	-	-	\$6.99-7.32/W _p (1991)	-	-	-	1991	Mfr.: Solarex; MSX60; multicryst. Higher price is for 1-3 modules; lower for >20.
39 Real Goods (1991)	56	-	-	-	-	\$7.13-7.48/W _p (1991)	-	-	-	1991	Mfr.: Solarex; MSX56; multicrystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
40 Real Goods (1991)	53	-	-	-	-	\$6.77-7.34/W _p (1991)	-	-	-	1991	Mfr.: Solarex; MSX53; multicrystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
41 Real Goods (1991)	40	-	-	-	-	\$7.98-8.48/W _p (1991)	-	-	-	1991	Mfr.: Solarex; MSX40; multicrystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
42 Real Goods (1991)	10	-	-	-	-	\$6.90/W _p (1991)	-	-	-	1991	Mfr.: Chronar; amorphous; originally rated 12W, but seller rating them as 10W to allow for 20% degradation in first year; actual sale price of module.
43 U.S. Congress (1992)	70	-	-	-	-	-	\$11,200/kWp	-	-	1990	Actual retail prices in the United States in 1990
44 U.S. Congress (1992)	190	-	-	-	-	-	\$8,400/kWp	-	-	1990	Actual retail prices in the United States in 1990

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
45 U.S. Congress (1992)	-	-	-	0.5 ¢/ kWh	-	-	-	-	-	Assume 1992	
46 U.S. Congress (1992)	-	20-30	-	-	-	-	-	-	-	Assume 1992	
47 U.S. Congress (1992)	-	30	10	0.7 ¢/ kWh	-	-	\$6,000/ kWp	37.50 ¢/ kWh (based on 7% discount rate and 20% capacity factor)	35	Assume 1992 On-grid generation; 20% capacity factor used. From the calculations, it appears that there is a misprint in the text and that the system costs should read \$8,000/ kWp as opposed to \$6,000/ kWp.	
48 U.S. Congress (1992)	-	30	-	0.5 ¢/ kWh	-	-	\$10,000/ kW	51 ¢/ kWh	47.7	Assume 1992 Off-grid generation. Taking capacity factor as 20% and system losses as 10%.	
49 U.S. Congress (1992)	38	-	-	-	-	-	Battery: \$1,050/ kW (lasts 3-5 yrs); Electronic control equipment: \$1,000/ kW	-	-	Assume 1992 Small residential system in the Dominican Republic	
50 U.S. Congress (1992)	200	-	-	-	-	-	Battery: \$1,400/ kW (lasts 3-5 yrs); Mounting hardware: \$800/ kW; Electronic control equipment: \$1,800/ kW	-	-	Assume 1992 Residential mixed use system in the United States	
51 U.S. Congress (1992)	-	-	-	-	-	-	\$4,000-6,000/ kWp (Assume 1992 \$)	-	-	Assume 1992 UN Committee on Development & Utilization of New & Renewable Sources of Energy: \$4,000/ kWp price for crystalline Si large orders (excluding taxes and delivery); US retailer: \$6,000 for small orders; Dominican Republic: \$6,000/ kWp for 38W panel.	

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride;
O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
52 U.S. Congress (1992)	-	-	-	-	-	\$1,000/ kW _p (Assume 1990 \$)	-	-	-	1995	PV industry reps. forecast for 1995, according to SERI in 1990.
53 U.S. Congress (1992)	-	-	-	-	-	\$1,500/ kW _p (Assume 1989 \$)	-	-	-	1994	Electric Power Research Institute estimate in 1989 for large flat-plate system in 1994.
54 U.S. Congress (1992)	-	-	-	0.5 ¢/ kWh	-	-	-	-	-	Assume 1986	For small PV systems according to 1986 estimate.
55 U.S. Congress (1992)	-	-	-	0.39-1.44 ¢/ kWh	-	-	-	-	-	Assume 1989	For utility scale flat plate PV systems acc. to EPRI. (Also see items 239 and 268, same reference quoted but different values cited for O&M costs as others refer to both flat plate and concentrator systems).
56 U.S. DOE (1990a)	-	30	-	0.5 ¢/ kWh	-	-	\$7,000/ kW (1988 \$)	32 ¢/ kWh* (assume 1988 \$)	35	1988	*Levelized cost of electricity, over 30 years at 6.1% discount rate (EPRI TAG [Technical Assessment Guide]), using 25% capacity factor.
57 U.S. DOE (1990a)	-	30	-	0.2 ¢/ kWh	-	-	\$3,500/ kW (BAU) and \$2,325/ kW (R,D&D) (1988 \$)	15 (BAU) and 10 (R,D&D) ¢/ kWh* (assume 1988 \$)	17 (BAU) and 11 (R,D&D)	2000	BAU= Business-as-usual scenario and R,D&D= intensified R,D&D scenario. *Levelized cost of electricity, over 30 years at 6.1% discount rate (EPRI TAG), using 27.5% capacity factor.
58 U.S. DOE (1990a)	-	30	-	0.2 ¢/ kWh	-	-	\$2,100/ kW (BAU) and \$1,625/ kW (R,D&D) (1988 \$)	9 (BAU) and 7 (R,D&D) ¢/ kWh* (assume 1988 \$)	10 (BAU) and 8 (R,D&D)	2010	BAU= Business-as-usual scenario and R,D&D= intensified R,D&D scenario. *Levelized cost of electricity, over 30 years at 6.1% discount rate (EPRI TAG), using 27.5% capacity factor.
59 U.S. DOE (1990a)	-	30	-	0.2 ¢/ kWh	-	-	\$1,400/ kW (BAU) and \$1,150/ kW (R,D&D) (1988 \$)	6 (BAU) and 5 (R,D&D) ¢/ kWh* (assume 1988 \$)	7 (BAU) and 6 (R,D&D)	2020	BAU= Business-as-usual scenario and R,D&D= intensified R,D&D scenario. *Levelized cost of electricity, over 30 years at 6.1% discount rate (EPRI TAG), using 27.5% capacity factor.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride;
O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
60 U.S. DOE (1990a)	-	30	-	0.1 ¢/ kWh	-	-	\$1,175/ kW (BAU) and \$930/ kW (R,D&D) (1988 \$)	5 (BAU) and 4 (R,D&D) ¢/ kWh* (assume 1988 \$)	6 (BAU) and 4 (R,D&D)	2030	BAU= Business-as-usual scenario and R,D&D= Intensified R,D&D scenario. *Levelized cost of electricity, over 30 years at 6.1% discount rate (EPRI TAG), using 27.5% capacity factor.
61 National Research Council (1976)	-	-	10	-	-	\$20-30/ W _p	-	-	-	1976	
62 National Research Council (1976)	-	-	-	-	-	\$30,000-70,000/ kW _p (array)	-	-	-	1976	Si solar cells
63 National Research Council (1981)	-	-	-	-	-	\$22/ W _p (Assume 1976 \$)	-	-	-	1976	In the US
64 National Research Council (1981)	-	-	-	-	-	\$7-10/ W _p (Assume 1980 \$)	-	-	-	1980	In the US with 2 MW production.
65 Hislop (1992)	-	-	-	-	-	\$5/ W _p (MW _p orders), \$10/ W _p (>1 kW _p orders), \$25/ W _p (<100 W _p orders).	-	-	-	1991	
66 Palz (1978)	-	-	-	-	-	\$20/ W _p (Assume 1975 \$)	-	-	-	1975	Terrestrial PV yearly production volume of 100 kW in 1975.
67 SERI (1989)	-	-	-	-	-	\$600/ W	-	-	-	1950s	Cost of "silicon solar cells."
68 SERI (1989)	-	-	-	-	-	\$100-200/ W	-	-	-	1970	Not clear from the text whether cost is of modules or cells; probably the latter.
69 SERI (1989)	-	-	-	-	-	\$20/ W (Assume 1977 \$)	-	-	-	1977	
70 SERI (1989)	-	-	-	-	-	\$4-5/ W (Assume 1988 \$)	\$8-10/ W	-	-	1988	

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module		Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
	Size (W)	life (yrs)		O&M	BOS	Module	System	Electricity			
71 NREL (1992c)	-	-	-	-	-	\$500/W (Assume 1972 \$)	-	-	-	1972	
72 NREL (1992c)	-	-	-	-	-	\$4.00-4.50/W	-	-	-	1991	
73 NREL (1992c)	-	-	11 to 17 (mod.)	-	-	-	-	-	-	1991	Efficiencies of 11 to 17% are for commercially available modules; experimental cells in the laboratory have demonstrated efficiencies as high as 34%
74 NREL (1992c)	-	10 to 15	5 to 15	-	-	-	-	25-50 ¢/kWh (1990)	25 to 50	1991	Installed capacity < 50 MW; utility power systems 10-15 MW; typical electricity price: consumer; remote, standalone.
75 NREL (1992c)	-	20	10 to 20	-	-	-	-	12-20 ¢/kWh (1990)	12 to 20	1995	Mid-term goals for United States; utility power systems 50-100 MW; typical electricity price: distributed; high value utility applications.
76 NREL (1992c)	-	30	15 to 25	-	-	-	-	5-8 ¢/kWh (1990)	5 to 6	2010-2030	Long term goals for U.S.; utility power systems 10,000-50,000 MW; typical electricity price: central utility power.
77 NREL (1992c)	-	-	17 (cell)	-	-	-	-	-	-	Early 1980s	Assume 1983. Crystalline Si cells.
78 NREL (1992c)	-	-	23 (cell)	-	-	-	-	-	-	1991	Crystalline Si laboratory cells.
79 NREL (1992c)	-	-	1 (cell)	-	-	-	-	-	-	1974	Amorphous Si single-junction cell.
80 NREL (1992c)	-	-	12 (cell)	-	-	-	-	-	-	1991	Amorphous Si single-junction cell; initial efficiency.
81 NREL (1992c)	-	-	>13 (cell)	-	-	-	-	-	-	1991	Amorphous Si multijunction cell; initial efficiency.
82 NREL (1992c)	-	-	10 (sub-module)	-	-	-	-	-	-	1991	Amorphous Si submodules
83 NREL (1992c)	-	-	4 to 5 (module)	-	-	-	-	-	-	1991	Amorphous Si; very large modules (10 sq. feet or larger)

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
84 NREL (1992c)	-	-	14 (cell)	-	-	-	-	-	-	1991	CIS polycrystalline thin film cells
85 NREL (1992c)	-	-	11 (sub-module)	-	-	-	-	-	-	1991	CIS polycrystalline thin film submodules
86 NREL (1992c)	-	-	14.6 (cell)	-	-	-	-	-	-	1991	Experimental cells combining CIS and amorphous Si.
87 NREL (1992c)	-	-	12 (cell)	-	-	-	-	-	-	1991	CdTe polycrystalline thin film cells
88 NREL (1992c)	-	-	7 (sub-module)	-	-	-	-	-	-	1991	CdTe polycrystalline thin film submodules
89 NREL (1992c)	-	-	15 (cell)	-	-	-	-	-	-	1991	Thin film crystalline Si cells.
90 NREL (1992c)	-	-	25 (cell)	-	-	-	-	-	-	1991	GaAs cells "under one-sun conditions." Assumed to be under regular light.
91 NREL (1992c)	-	-	30 (cell)	-	-	-	-	-	-	1991	GaAs cells under concentrated light.
92 NREL (1992c)	-	-	25 (cell)	-	-	-	-	-	-	1991	Single crystal GaAs cells on a GaAs substrate.
93 NREL (1992c)	-	-	20 (cell)	-	-	-	-	-	-	1991	Single crystal GaAs cells on a germanium or Si substrate.
94 NREL (1992c)	-	-	22 (cell)	-	-	-	-	-	-	1991	Single crystal GaAs cells made on a GaAs substrate, but removed after fabrication.
95 NREL (1992c)	-	-	>25 (cell); 30 (expected practical limit)	-	-	-	-	-	-	1991	Advanced Si concentrator cells from university laboratories incorporated into modules; expected practical limit, 30%.
96 NREL (1992c)	-	-	>34 (cell); 40 (expected practical limit)	-	-	-	-	-	-	1991	Multijunction solar cells under concentrated light in laboratory research; expected practical limit, 40%.
97 NREL (1992c)	-	-	11-13 (22-23)	-	-	-	-	-	-	1991	Flat plate crystalline Si commercial modules; laboratory cell efficiencies in parentheses.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System			
98 NREL (1992c)	-	-	14-15 (25)	-	-	-	-	-	1995	Flat plate crystalline Si commercial modules; laboratory cell efficiencies in parentheses.
99 NREL (1992c)	-	-	>18 (>26)	-	-	-	-	-	2010-2030	Flat plate crystalline Si commercial modules; laboratory cell efficiencies in parentheses.
100 NREL (1992c)	-	-	4-6 (12-14)	-	-	-	-	-	1991	Flat plate thin film commercial modules; laboratory cell efficiencies in parentheses.
101 NREL (1992c)	-	-	8-10 (15-18)	-	-	-	-	-	1995	Flat plate thin film commercial modules; laboratory cell efficiencies in parentheses.
102 NREL (1992c)	-	-	>15 (>20)	-	-	-	-	-	2010-2030	Flat plate thin film commercial modules; laboratory cell efficiencies in parentheses.
103 NREL (1992c)	-	-	14-17 (27-32)	-	-	-	-	-	1991	Concentrators; commercial module efficiencies; laboratory cell efficiencies in parentheses.
104 NREL (1992c)	-	-	18-20 (35)	-	-	-	-	-	1995	Concentrators; commercial module efficiencies; laboratory cell efficiencies in parentheses.
105 NREL (1992c)	-	-	>25 (>40)	-	-	-	-	-	2010-2030	Concentrators; commercial module efficiencies; laboratory cell efficiencies in parentheses.
106 NREL (1992c)	-	5-15, mods	-	-	-	-	-	-	1991	BOS component reliability: 5 yrs.
107 NREL (1992c)	-	15-20, mods	-	-	-	-	-	-	1995	BOS component reliability: >15 yrs.
108 NREL (1992c)	-	>30, mods	-	-	-	-	-	-	2010-2030	
109 Thornton and Brown (1992)	-	-	-	-	-	\$4.00-8.00/W	-	25-40 ¢/ kWh	24-38	1991

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module			Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes	
	Size (W)	life (yrs)	Efficiency (%)	O&M	BOS	Module	System	Electricity				
110 International Energy Agency (1987)	-	-	-	-	-	-	-	-	\$0.50/kWh (1985)	61	Assume According to reports from U.S. DOE. No battery storage (this would result in increasing costs by as much as 50%).	
111 International Energy Agency (1987)	10 kW	20	8 (system)	\$50/kW/yr	-	-	\$11,145/kW	\$0.50/kWh (insolation of 6 kWh/sq. m/day); >\$0.80/kWh (insolation of < 4 kWh/sq. m/day) (1982 \$)	57 (insolation of 6 kWh/sq. m/day); >92 (insolation of < 4 kWh/sq. m/day)	1987	Assume Data from US, Japan, and Germany. Reference shows variation of generating cost with insolation. No battery storage.	
112 International Energy Agency (1987)	>500 kW	-	-	-	-	-	\$7,000-8,000/kW	\$0.30-0.35/kWh (1982 \$)	34-40	1987	Assume According to reports from U.S. DOE. No battery storage (this would result in increasing costs by as much as 50%).	
113 International Energy Agency (1987)	-	20	12 (module); 10 (system)	-	\$140/sq. m and \$530/kW	\$550/sq. m	\$1,115/sq. m or \$11,150/kW	\$0.450/kWh (discount rate 5%) (1982 \$)	61	1987	Assume Flat plate systems. All costs in 1982 \$. For area with solar insolation of 6 kWh/sq. m/day.	
114 International Energy Agency (1987)	-	30	13-17 (module); 11.7-15.3 (system)	-	\$50/sq. m and \$150/kW	\$40-75/sq. m	\$161-222/sq. m or \$1,379-1,451/kW	\$0.046-0.049/kWh (discount rate 5%) (1982 \$)	6 to 7	Late 1990s	Assume 1998. Flat plate systems. All costs in 1982 \$. For area with solar insolation of 6 kWh/sq. m/day.	
115 International Energy Agency (1987)	-	20	17 (module); 14.4 (system)	-	\$250/sq. m and \$530/kW	\$750/sq. m	\$1,615/sq. m or \$11,212/kW	\$0.452/kWh (discount rate 5%) (1982 \$)	61	1987	Assume Concentrator systems. All costs in 1982 \$. For area with solar insolation of 6 kWh/sq. m/day.	
116 International Energy Agency (1987)	-	30	23-29 (module); 20.7-26.1 (system)	-	\$100/sq. m and \$150/kW	\$90-100/sq. m	\$332-359/sq. m or \$1,374-1,602/kW	\$0.046-0.054/kWh (discount rate 5%) (1982 \$)	6 to 7	Late 1990s	Assume 1998. Concentrator systems. All costs in 1982 \$. For area with solar insolation of 6 kWh/sq. m/day.	
117 International Energy Agency (1991)	-	-	12-16 (production efficiency); 18-22 (laboratory goal)	-	-	-	-	-	-	-	1991	Assume Crystalline Si flat plate cell efficiencies.
118 International Energy Agency (1991)	-	-	25-28 (production efficiency); 28-30 (laboratory goal)	-	-	-	-	-	-	-	1991	Assume Crystalline Si concentrator cell efficiencies.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System			
119 International Energy Agency (1991)	-	-	10-15 (production efficiency); 15-18 (laboratory goal)	-	-	-	-	-	-	Assume Polycrystalline Si cell 1991 efficiencies.
120 International Energy Agency (1991)	-	-	11-14 (production efficiency); 14-16 (laboratory goal)	-	-	-	-	-	-	Assume Si ribbon cell efficiencies. 1991
121 International Energy Agency (1991)	-	-	5-8 (production efficiency); 8-10 (laboratory goal)	-	-	-	-	-	-	Assume Amorphous Si flat plate cell 1991 efficiencies.
122 International Energy Agency (1991)	-	-	13 (laboratory goal)	-	-	-	-	-	-	Assume Amorphous Si (aSi): thin film 1991 aSi/ aSi multijunction cell efficiency.
123 International Energy Agency (1991)	-	-	12-15 (laboratory goal)	-	-	-	-	-	-	Assume Amorphous Si (aSi): thin film 1991 aSi/ CIS multijunction cell efficiency.
124 International Energy Agency (1991)	-	-	24 (laboratory goal)	-	-	-	-	-	-	Assume GaAs: thin film cell efficiency. 1991
125 International Energy Agency (1991)	-	-	29 (laboratory goal)	-	-	-	-	-	-	Assume GaAs: concentrator cell 1991 efficiency.
126 International Energy Agency (1991)	-	-	30 (laboratory goal)	-	-	-	-	-	-	Assume GaAs: concentrator 1991 multijunction cell efficiency.
127 International Energy Agency (1991)	-	-	8-10 (laboratory goal)	-	-	-	-	-	-	Assume CIS cell efficiency. 1991
128 International Energy Agency (1991)	-	-	6 (laboratory goal)	-	-	-	-	-	-	Assume CdTe cell efficiency. 1991
129 Tsuchiya (1992)	-	-	-	-	-	7,000 yen/ Wp	-	-	-	1979 Assume cost is in 1979 currency.
130 Tsuchiya (1992)	-	-	-	-	-	4,000 yen/ Wp	-	-	-	1980 Assume cost is in 1980 currency.
131 Tsuchiya (1992)	-	-	-	-	-	3,500 yen/ Wp	-	-	-	1981 Assume cost is in 1981 currency.
132 Tsuchiya (1992)	-	-	-	-	-	2,200 yen/ Wp	-	-	-	1982 Assume cost is in 1982 currency.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride;
O&M = operation and maintenance; BOS = balance of system.

Reference	Module		Efficiency (%)	Costs in current prices					Electricity cost, 1990 US\$/kWh	Year	Notes
	Size (W)	life (yrs)		O&M	BOS	Module	System	Electricity			
133 Tsuchiya (1992)	-	-	-	-	-	1,800 yen/Wp	-	-	-	1983	Assume cost is in 1983 currency.
134 Tsuchiya (1992)	-	-	-	-	-	1,500 yen/Wp	-	-	-	1984	Assume cost is in 1984 currency.
135 Tsuchiya (1992)	-	-	-	-	-	1,200 yen/Wp	-	-	-	1985	Assume cost is in 1985 currency.
136 Tsuchiya (1992)	-	-	-	-	-	1,100 yen/Wp	-	-	-	1986	Assume cost is in 1986 currency.
137 Tsuchiya (1992)	-	-	-	-	-	1,000 yen/Wp	-	-	-	1987	Assume cost is in 1987 currency.
138 Tsuchiya (1992)	-	-	-	-	-	900 yen/Wp	-	-	-	1988	Assume cost is in 1988 currency.
139 ESMAP (1989)	103	15	11.5	Rs 100/yr	Rs 700/kWh (battery); Rs 1,300 (controller); Rs 400 (cable); Rs 200 (connection cost).	Rs. 104/W _p (assume 1989)	-	Rs 25.77/kWh (real levelized electricity cost) (assume 1989)	129 (Currency adjusted to 1990 Pakistan rupees, and then to 1990 \$ as described in Annex 1)	1989	Decentralized DC system; no land costs; assumptions including insolation = 3.5 kWh/sq. m/day (worst case), 2 day storage requirement, and certain battery and controller lifetimes (2 and 8, respectively).
140 ESMAP (1989)	3423	15	11.5	Rs 18,000/yr	Rs 2,200/kWh (battery); Rs 3,500 (controller); Rs 9,000 (cable); Rs 900/connection (connection cost; 30 connections); Rs 85,000 (site civil cost).	Rs. 104/W _p (assume 1989)	-	Rs 35.44/kWh (real levelized electricity cost) (assume 1989)	178 (Currency adjusted to 1990 Pakistan rupees, and then to 1990 \$ as described in Annex 1)	1989	Centralized DC system; 30 connections per unit; land costs; assumptions including insolation = 3.5 kWh/sq. m/day (worst case), 2 day storage requirement, and certain battery, inverter and controller lifetimes (2, 8, and 8 respectively).

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US\$/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
141 ESMAP (1989)	114	15	11.5	Rs 100/yr	Rs 700/kWh (battery); Rs 1,300 (controller); Rs 400 (cable); Rs 200 (connection cost); Rs 5,200 (inverter).	Rs. 104/W _p (assume 1989)	-	Rs 38.75/kWh (real levelized electricity cost) (assume 1989)	195 (Currency adjusted to 1990 Pakistan rupees, and then to 1990 \$ as described in Annex 1)	1989	Decentralized AC system; no land costs; assumptions including insolation = 3.5 kWh/sq. m/day (worst case), 2 day storage requirement, and certain battery and controller lifetimes (5 and 8 respectively).
142 ESMAP (1989)	3423	15	11.5	Rs 18,000/yr	Rs 2,200/kWh (battery); Rs 3,500 (controller); Rs 9,000 (cable); Rs 900/conn. (connection cost; 30 connections); Rs 85,000 (site civil cost); Rs 200,000 (inverter).	Rs. 104/W _p (assume 1989)	-	Rs 49.60/kWh (real levelized electricity cost) (assume 1989)	249 (Currency adjusted to 1990 Pakistan rupees, and then to 1990 \$ as described in Annex 1)	1989	Centralized AC system; 30 connections per unit; land costs; assumptions including insolation = 3.5 kWh/sq. m/day (worst case), 2 day storage requirement, and certain battery, inverter and controller lifetimes (5, 8, and 8 respectively).
143 Cody and Tiedje (1992)	-	-	7.2 (peak system conversion efficiency)	-	-	-	-	\$0.40/kWh (1988)	44	1988	Assumptions such as 30 year life and 7.5% rate of return; insolation for general southwest location in the United States (Cap fac. 0.27); etc.
144 Cody and Tiedje (1992)	-	-	15 (system)	-	-	-	-	\$0.06-0.10/kWh (1988)	7 to 12	2010	Predictions for cost of electricity from PVs in the case of 40% and 20% annual growth in sales between 1988 and 2010.
145 Cody and Tiedje (1992)	-	-	12 (single cell); 22 (fundamental limit)	-	-	-	-	-	-	1987	Amorphous Si.
146 Cody and Tiedje (1992)	-	-	24 (single cell); 33 (fundamental limit)	-	-	-	-	-	-	1990	Crystalline Si.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
147 Cody and Tiedje (1992)	-	-	25 (single cell); 33 (fundamental limit)	-	-	-	-	-	-	1990	Crystalline GaAs.
148 Cody and Tiedje (1992)	-	-	14 (single cell); 29 (fundamental limit)	-	-	-	-	-	-	1988	Tandem cell with two amorphous layers.
149 Cody and Tiedje (1992)	-	-	21 (single cell); 47 (fundamental limit)	-	-	-	-	-	-	1982	Tandem cell with two crystalline layers.
150 Perlack, Jones and Waddle (1990)	-	-	-	-	-	\$4-5/ Wp	-	-	-	1990	Costs of larger systems are lower.
151 UNDP (1992)	-	-	-	-	-	\$4/ W (cell cost)	-	-	-		Assume imported cells by 1992 SOLARCOMM into Zimbabwe.
152 UNDP (1992)	-	-	-	-	-	\$4/ W (module cost for large consignments, 50 MW)	-	-	-		Assume international price for modules 1992 per container load.
153 UNDP (1992)	-	-	12-13 (module)	-	-	-	-	-	-		Assume Module efficiency of 1992 SOLARCOMM modules.
154 UNDP (1992)	-	-	-	-	-	\$ 12.17/ W (1991)	-	-	-	1991	Schematic module price.
155 UNDP (1992)	-	-	-	-	-	\$ 9.22/ W (1991)	-	-	-	1991	Battery World module price.
156 UNDP (1992)	-	-	-	-	-	\$ 9.27/ W (1991)	-	-	-	1991	Solarcomm module price.
157 ESMAP back-to-office report, 1992	50 W	-	-	-	-	\$5.21/ Wp (total \$260.69)	-	-	-		Assume 1992
158 ESMAP (1991b)	90 Wp	15	11.5 (module), 8 (overall system)	\$5/ yr fixed	\$265 (Battery: \$70/ kWh; Controller: \$75; cables: \$30; 3 fluorescent lamps and fixtures: \$90)	\$5.5/ Wp (total \$495)	\$760	\$1.44/ kWh	144	1990	Assumptions including 1 kWh storage requirement; 10% discount rate; 4 kWh/ sq. m/ day insolation (worst case); 80% battery energy efficiency; 70% max. depth of discharge; 2 yr battery lifetime; 8 yr controller lifetime; 0.25 kWh/ day system load; etc.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module			Costs in current prices					Electricity cost, 1990 US\$/kWh	Year	Notes	
	Size (W)	life (yrs)	Efficiency (%)	O&M	BOS	Module	System	Electricity				
159	Terrado, Mendis and Fitzgerald (1989)	-	-	-	-	-	\$12/ W _p (installed array)	-	-	-	1989	
160	Meridian Corporation (1992)	-	-	-	-	-	\$30/ W (currency yr not specified; assume 1975 \$)	-	-	-	1975	From Maycock (1991).
161	Meridian Corporation (1992)	-	-	-	-	-	\$13/ W (currency yr not specified; assume 1980 \$)	-	-	-	1980	From Maycock (1991).
162	Meridian Corporation (1992)	-	-	-	-	-	\$7/ W (currency yr not specified; assume 1985 \$)	-	-	-	1985	From Maycock (1991).
163	Meridian Corporation (1992)	-	-	-	-	-	\$4/ W (currency yr not specified; assume 1990 \$)	-	-	-	1990	From Maycock (1991).
164	Meridian Corporation (1992)	-	-	-	-	-	\$3/ W (currency yr not specified; assume 1992 \$)	-	-	-	1995	Projected values from Maycock (1991).
165	Meridian Corporation (1992)	-	-	-	-	-	\$2/ W (currency yr not specified; assume 1992 \$)	-	-	-	2000	Projected values from Maycock (1991).
166	Meridian Corporation (1992)	-	-	-	-	-	\$1.4/ W (currency yr not specified; assume 1992 \$)	-	-	-	2005	Projected values from Maycock (1991).
167	Meridian Corporation (1992)	-	-	-	-	-	\$1/ W (currency yr not specified; assume 1992 \$)	-	-	-	2010	Projected values from Maycock (1991).
168	Meridian Corporation (1992)	nq	nq	nq	3% (PV & pump), 2% (PV & domestic) and 2% (PV & street lighting) of total cost	Rs 20 (1988)/ W _p (domestic system) and Rs 10 (1988)/ W _p (street lighting); Rs 20 (1988)/ W _p (PV motor & pump)	Rs 80 (1988)/ W _p (no import duty); Rs 155/ W _p with duty)	-	-	-		Assume Costs for subcomponents of 1988 PV systems in India (Rs. 1988). Also storage cost of Rs 2/ kWh.
169	Meridian Corporation (1992)	-	-	11-13 (commercial cell efficiencies)	-	-	-	-	-	-		Assume Single-cell (monocrystalline) Si 1992

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride;
O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
170 Meridian Corporation (1992)	-	-	10-12 (commercial cell efficiencies)	-	-	-	-	-	-	-	Assume Polycrystalline Si 1992
171 Meridian Corporation (1992)	-	-	4-7 (commercial cell efficiencies)	-	-	-	-	-	-	-	Assume Thin film amorphous Si 1992
172 Meridian Corporation (1992)	-	-	14-17 (commercial cell efficiencies)	-	-	-	-	-	-	-	Assume Concentrators 1992
173 Meridian Corporation (1992)	250 kW	-	-	-	-	-	-	12.5-21.3 (1990 ¢/ kWh)	12.5-21.3	-	Assume Costs are based on 1998 1998 projections.
174 Meridian Corporation (1992)	-	-	-	-	-	\$5.30-10.50/W	\$8.00 - 25.00/W	-	-	-	Assume Estimate for stand-alone 1992 systems.
175 Meridian Corporation (1992)	-	20	-	-	\$1,756/kW (batteries); \$59/kW (wiring/ controls); \$1,171/kW (labor, profit).	\$5,854/kW (1992 \$)	-	\$0.96/kW (1992 \$)	90	1990	Levelized cost of grid independent system; 10% discount rate; assumptions including 5 yr battery life and 10 year controls life.
176 Meridian Corporation (1992)	-	20	-	-	\$1,756/kW (batteries); \$59/kW (wiring/ controls); \$937/kW (labor, profit).	\$3,512/kW (1992 \$)	-	\$0.81/kWh (1992 \$)	76	1995	Levelized cost of grid independent system; 10% discount rate; assumptions including 5 yr battery life and 10 yr controls life.
177 Meridian Corporation (1992)	-	30	-	-	\$1,756/kW (batteries); \$59/kW (wiring/ controls); \$585/kW (labor, profit).	\$2,342/kW (1992 \$)	-	\$0.47/kWh (1992 \$)	44	2000	Levelized cost of grid independent system; 10% discount rate; assumptions including 8 yr battery life and 15 year controls life.
178 Meridian Corporation (1992)	-	30	-	-	\$1,756/kW (batteries); \$59/kW (wiring/ controls); \$585/kW (labor, profit).	\$1,756/kW (1992 \$)	-	\$0.44/kWh (1992 \$)	41	2010	Levelized cost of grid independent system; 10% discount rate; assumptions including 8 yr battery life and 15 year controls life.
179 Meridian Corporation (1992)	-	20	-	-	\$820/kW (wiring/ controls); \$937/kW (labor, profit).	\$4,683/kW (1992 \$)	-	\$0.46/kWh (1992 \$)	43	1990	Levelized cost of grid connected system; 10% discount rate; assumptions including 5 year battery life and 10 yr controls life.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes	
				O&M	BOS	Module	System				Electricity
180 Meridian Corporation (1992)	-	20	-	-	\$468/ kW (wiring / controls); \$585/ kW (labor, profit).	\$2,342/ kW (1992 \$)	-	\$0.25/ kWh (1992 \$)	23	1995	Levelized cost of grid connected system; 10% discount rate; assumptions including 5 yr battery life and 10 yr controls life.
181 Meridian Corporation (1992)	-	30	-	-	\$351/ kW (wiring / controls); \$351/ kW (labor, profit).	\$1,756/ kW (1992 \$)	-	\$0.16/ kWh (1992 \$)	15	2000	Levelized cost of grid connected system; 10% discount rate; assumptions including 8 yr battery life and 15 yr controls life.
182 Meridian Corporation (1992)	-	30	-	-	\$351/ kW (wiring / controls); \$351/ kW (labor, profit).	\$1,405/ kW (1992 \$)	-	\$0.14/ kWh (1992 \$)	13	2010	Levelized cost of grid connected system; 10% discount rate; assumptions including 8 yr battery life and 15 yr controls life.
183 U.S. DOE (1992c)	250 kW	30 (system)	-	0.585 ¢/ kWh	-	-	1,080,000 (\$4.32/ Wp)	-	-	1998	Daggett, demand side management; 31% capacity factor; net electricity output = 690 MWh/ yr.
184 U.S. DOE (1992c)	500 kW	30 (system)	-	0.216-0.613 ¢/ kWh	-	-	\$1,660,000-2,600,000 (\$3.32-5.2/ Wp)	-	-	1998	Daggett, distributed system; 28-31% capacity factor; net electricity output = 1240-1380 MWh/ yr.
185 U.S. DOE (1992c)	10 MW	30 (system)	-	0.613 ¢/ kWh	-	-	42,260,000 (\$4.2/ Wp)	-	-	1998	Daggett, modular system; 28% capacity factor; net electricity output = 24840 MWh/ yr.
186 U.S. DOE (1992c)	10 MW	30 (system)	-	0.585 ¢/ kWh	-	-	41,760,000 (\$4.2/ Wp)	-	-	1998	Denver, modular system; 28% capacity factor; net electricity output = 24832 MWh/ yr.
187 U.S. DOE (1992c)	5,000	20	-	\$0.02/ kWp	\$1,500/ kW _p (controls/ inverter); \$150/ kW _p (battery); \$1,000/ kW _p (installation).	\$5,000/ kW _p (array)	\$7,650/ kWp	-	-	1991	Remote power systems; assumptions including 3 day battery storage, 80% max. depth of discharge, 5 years battery life and 10 years controls/ inverter life.
188 U.S. DOE (1992c)	5,000	30	-	\$0.01/ kWp	\$1,000/ kW _p (controls/ inverter); \$125/ kW _p (battery); \$500/ kW _p (installation).	\$2,500/ kW _p (array)	\$4,125/ kWp	-	-	2000	Remote power systems; assumptions including 3 day battery storage, 80% max. depth of discharge, 8 years battery life and 15 years controls/ inverter life.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
189 Carlson (1992)	-	-	-	-	-	\$5/ W _p (for large quantities)	-	\$0.35-0.45/ kWh	35-45	1990	
190 Carlson (1992)	-	-	-	-	-	about \$20/ W _p (Assume 1980 \$)	-	-	-	1980	
191 Remy and Durand (1992)	-	-	-	-	-	\$5.3/ W _p (selling price), \$8.3/ W _p (installed price—no storage, but inverter included)	-	-	-	1990	1990 (current) prices.
192 Remy and Durand (1992)	-	-	-	-	-	\$2.6/ W _p (selling price), \$4.1/ W _p (installed price—no storage, but inverter included)	-	-	-	1995	Projected price assuming absence of large (utility-based) markets but expecting a "natural" doubling of sales every 5 years.
193 Kimura (1992)	-	-	-	-	-	Yen 600-700/ W _p (\$4.60-5.40/ W _p)	-	-	-	1990	Production level of 3-5 MW/ yr.
194 Kimura (1992)	-	-	-	-	-	Yen 500/ W _p (\$3.8/ W _p)	-	-	-	1990	Cost prediction in 1990 if production level was 10 MW/ yr.
195 Kimura (1992)	-	-	-	-	-	Yen 200/ W _p (\$1.5/ W _p on basis of currency conversions above)	-	-	-	2000	Prediction by Japanese Photovoltaic Specialists and government staff in 1988; production level of 100 MW/ yr.
196 Kimura (1992)	-	-	-	-	-	-	60-120% higher than module cost.	-	-	-	-
197 Kimura (1992)	-	-	-	-	-	-	-	Yen 150/ kWh (\$1.2/ kWh)	120	1990	Prediction for first half of 1990 decade, making PV systems practical as auxiliary power supply sources in islands.
198 Kimura (1992)	-	-	-	-	-	-	-	Yen 70-120/ kWh (- \$0.6-1.0/ kWh on basis of currency conversion above)	60-100	1995	Prediction for 1995 or thereabouts, making PV systems directly competitive against diesel power generation.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes	
				O&M	BOS	Module	System				
199 Kimura (1992)	-	-	-	-	-	-	-	Yen 20-30/ kWh (- \$0.2-0.3/ kWh on basis of currency conversion above)	20-30	2000	Prediction for 2000, assuming large scale grid connected systems, with PV modules mounted on roofs of private houses.
200 Hankins (1993)	18	-	-	-	-	-	\$350	-	-	1992	Assume Cost for 18 W _p two lamp system in Sri Lanka; operating at 12 V (DC).
201 Hankins (1993)	35	-	-	-	10.15% (battery), 2.89% (controller), 7.65% (wiring and switches), 17.33% (lights), 4.53% (installation) of total cost.	57.46% (module and support) of total cost.	\$600	-	-	1992	Assume Suntec data for typical PV home system in Sri Lanka.
202 Hankins (1993)	47	-	-	-	-	-	\$1,000	-	-	1992	Assume Cost for 47 W _p four lamp system in Zimbabwe; operating at 12 V (DC).
203 Hankins (1993)	50	-	-	-	-	-	US\$1,500 (including labor, excluding transport)	-	-	1992	Assume Solarcomm home lighting system with a 100 Ah battery, a 50 W _p module, four fluorescent lamps, a charge controller, and associated wiring and switches in Zimbabwe.
204 Hankins (1993)	50?	-	-	-	-	-	US\$700-2,000	-	-	1992	Assume PV systems in Zimbabwe.
205 Hankins (1993)	-	-	-	-	-	-	US\$13-15/W _p	-	-	1992	Assume PV module price to customer in Zimbabwe.
206 Hankins (1993)	-	-	-	-	8.21% (battery), 5.22% (controller), 1.82% (wiring and switches), 11.94% (lights), 4.97% (installation) of total cost.	67.84% (module and support) of total cost.	-	-	-	1992	Assume Component cost of representative home system in Zimbabwe; data from Zimbabwe Min. Energy.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
207 Hankins (1993)	48	-	-	-	7.65% (battery), 5.22% (control/ junction box), 9.57% (lamps, wiring switches), 3.48% (installation, labor), 23.65% (dealer margin) of total cost.	50.43% (module and support) of total cost. (\$7.35-7.88/ Wp)	\$700-750	-	-	1992	Data from Enersol Associates; 48 W PV lighting system cost breakdown, Dominican Republic; operating at 12 V (DC).
208 Hankins (1993)	40	-	-	-	-	-	\$800-850	-	-	1992	Assume A typical 40 W _p solar electric system with four fluorescent tube lights, a locally made battery, a control, a module, and mounting equipment in Kenya.
209 Hankins (1993)	-	-	-	-	14.23% (battery), 11.14% (controller), 8.05% (wiring and switches), 15.70% (lights), 8.72% (installation) of total cost.	42.15% (module and support) of total cost.	-	-	-	1992	Assume Cost component data from Alpa Nguvu, Inc., Nairobi.
210 Hankins (1993)	-	-	-	-	-	\$9.38/ W _p (assume 1992 \$)	-	-	-	1992	Assume Typical price for standard module in Dominican Republic.
211 Hankins (1993)	-	-	-	-	-	\$7.80/ W _p (assume 1992 \$)	-	-	-	1992	Assume Typical price for standard module in Kenya.
212 Hankins (1993)	-	-	-	-	-	\$10.40/ W _p (assume 1992 \$)	-	-	-	1992	Assume Typical price for standard module in Sri Lanka.
213 Hankins (1993)	-	-	-	-	-	\$14.34/ W _p (assume 1992 \$)	-	-	-	1992	Assume Typical price for standard module in Zimbabwe.
214 Charters (1991)	-	-	-	-	-	-	-	\$30/ kWh (assume 1970 \$)	10100	1970	
215 Charters (1991)	-	-	-	-	-	-	-	\$0.30/ kWh (assume 1990 \$)	30	1990	

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes	
				O&M	BOS	Module	System				
216 Charters (1991)	-	-	-	-	-	-	-	\$0.10/ kWh (assume 1991 \$)	10	2000	Forecast by informal sources.
217 Charters (1991)	-	-	-	-	-	-	-	\$0.04/ kWh (assume 1991 \$)	4	2030	Forecast by informal sources.
218 Kelly (1993)	-	-	-	-	-	\$20/ W _p (1989 \$)	-	-	-	1976	The average selling price of flat-plate photovoltaic modules.
219 Kelly (1993)	-	-	-	-	-	\$7.1/ W _p (1989 \$)	-	-	-	1984	The average selling price of flat-plate photovoltaic modules.
220 Kelly (1993)	-	-	-	-	-	\$6.2/ W _p (1989 \$)	-	-	-	1990	The average selling price of flat-plate photovoltaic modules.
221 Kelly (1993)	-	-	-	-	-	-	\$10-15/ W _p	-	-	Assume 1992	Recently installed PV systems.
222 Kelly (1993)	-	-	10-12 (modules, field experience), 17.8 (prototype), 24.2 (experimental), 30-33 (theoretical limit).	-	-	-	-	-	-	Assume 1992	Flat plate crystalline Si photovoltaic cell.
223 Kelly (1993)	-	-	8-9 (modules, field experience), 18.2 (experimental)	-	-	-	-	-	-	Assume 1992	Flat plate polycrystalline Si photovoltaic cell.
224 Kelly (1993)	-	-	3-5 (modules, field experience), 5 (prototype), 6 (experimental), 27-28 (theoretical limit).	-	-	-	-	-	-	Assume 1992	Flat plate single-junction amorphous Si photovoltaic cell; stabilized efficiencies.
225 Kelly (1993)	-	-	15-20 (experimental)	-	-	-	-	-	-	-	Future projection. Flat plate single-junction amorphous Si photovoltaic cell; initial efficiency.
226 Kelly (1993)	-	-	6 (modules, field experience), 8 (prototype), 10 (experimental)	-	-	-	-	-	-	Assume 1992	Flat plate multijunction amorphous Si photovoltaic cell; stabilized efficiencies.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	life (yrs)	Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System			
227 Kelly (1993)	-	-	7-8 (modules, field experience)	-	-	-	-	-	Early 1990s	Assume 1993. Flat plate multi-junction amorphous Si photovoltaic cell; stabilized efficiencies.
228 Kelly (1993)	-	-	10 (modules, field experience)	-	-	-	-	-	Mid- 1990s	Assume 1995. Flat plate multi-junction amorphous Si photovoltaic cell; stabilized efficiencies.
229 Kelly (1993)	-	-	15.6 (experimental), 12.3 (prototype), 42 (theoretical)	-	-	-	-	-	Assume 1992	Flat plate mechanically stacked amorphous Si and CIS photovoltaic cell; initial, not stabilized, efficiencies.
230 Kelly (1993)	-	-	18 (modules, field experience)	-	-	-	-	-	After 2005	Amorphous Si/ CIS or amorphous Si-based multijunction cell; stabilized efficiency.
231 Kelly (1993)	-	-	11.1 (prototype), 14.8 (exper- imental), 23.5 (theoretical limit).	-	-	-	-	-	Assume 1992	Flat plate CIS photovoltaic cell.
232 Kelly (1993)	-	-	10 (prototype), 15.8 (exper- imental), 27-28 (theoretical limit).	-	-	-	-	-	Assume 1992	Flat plate CdTe photovoltaic cell.
233 Kelly (1993)	-	-	22 (prototype), 28 (experimental)	-	-	-	-	-	Assume 1992	GaAs concentrator photovoltaic cell.
234 Kelly (1993)	-	-	34 (experimental)	-	-	-	-	-	Assume 1992	GaAs on gallium antimony (GaSb) concentrator photovoltaic cell.
235 Kelly (1993)	-	-	-	-	-	\$500/ sq. m (\$4/ W _p at 12.5% efficiency)	-	-	Assume 1992	Approximate production cost of polycrystalline photovoltaic modules using current (conventional) methods.
236 Kelly (1993)	-	-	-	-	-	\$1.70-2.66 / W _p (7% efficient mod., 10 kW _p production/ yr)	-	-	Assume 1992	Production cost of thin-film modules (tabletop study).

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module		Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes
	Size (W)	life (yrs)		O&M	BOS	Module	System			
237 Kelly (1993)	-	-	-	-	-	\$1.19-1.86 / W _p (10% efficient mod., 100,000 sq. m production/ yr)	-	-	-	Assume Production cost of thin-film 1992 modules (tabletop study).
238 Kelly (1993)	-	-	-	-	\$400-500/ sq. m	-	-	-	-	Assume System costs exclusive of 1992 modules and power conditioners. Note area dependence.
239 Kelly (1993)	-	-	-	From table: 0.39-1.44 ¢/ kWh (flat plate) & 4.81-6.97 ¢/ kWh (concentrator). Values in text do not match table (11-15 and 2-3 ¢/ kWh respectively).	-	-	-	-	-	Assume Data from EPRI based on 1989 operating experience of large photovoltaic systems. Also see items 55 and 268.
240 Green (1993)	-	-	17 (cell)	-	-	-	-	-	-	1974 Terrestrial Si crystalline cell.
241 Green (1993)	-	-	18 (cell)	-	-	-	-	-	-	1983 Terrestrial Si crystalline cell.
242 Green (1993)	-	-	19 (cell)	-	-	-	-	-	-	1984 Terrestrial Si crystalline cell.
243 Green (1993)	-	-	20 (cell)	-	-	-	-	-	-	1985 Terrestrial Si crystalline cell.
244 Green (1993)	-	-	23-24 (cell)	-	-	-	-	-	-	1992 Terrestrial Si crystalline cell.
245 Green (1993)	-	-	-	-	-	\$5/W _p (1989 \$)	-	-	-	1989 Average module price.
246 Zweibel and Barnett (1993)	-	-	10 (experimental cell)	-	-	-	-	-	-	1980 CIS cells.
247 Zweibel and Barnett (1993)	-	-	9.6 (experimental cell)	-	-	-	-	-	-	1986 CIS cells.
248 Zweibel and Barnett (1993)	-	-	5 (prototype module)	-	-	-	-	-	-	1986 CIS.
249 Zweibel and Barnett (1993)	-	-	11.1 (prototype module)	-	-	-	-	-	-	1988 CIS.
250 Zweibel and Barnett (1993)	-	-	14 (cell)	-	-	-	-	-	-	1991 CdTe solar cells.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes	
				O&M	BOS	Module	System	Electricity				
251	Zweibel and Barnett (1993)	-	-	10 (1 sq. ft. prototype modules)	-	-	-	-	-	-	1991	CdTe.
252	Zweibel and Barnett (1993)	-	-	9 (cell)	-	-	-	-	-	-	1986	CdTe solar cells.
253	Zweibel and Barnett (1993)	-	-	5 (1 sq. ft. prototype module)	-	-	-	-	-	-	1986	CdTe.
254	Zweibel and Barnett (1993)	-	-	12.3 (cell)	-	-	-	-	-	-	1989	CdTe solar cells.
255	Zweibel and Barnett (1993)	-	-	7.3 (proto- type module)	-	-	-	-	-	-	1989	CdTe.
256	Zweibel and Barnett (1993)	-	-	12.7 (cell)	-	-	-	-	-	-	1991	CdTe solar cells.
257	Zweibel and Barnett (1993)	-	-	8.1 (1 sq. ft. module)	-	-	-	-	-	-	1991	CdTe.
258	Zweibel and Barnett (1993)	-	-	6.5 (4 sq. ft module)	-	-	-	-	-	-	1991	CdTe.
259	Zweibel and Barnett (1993)	-	-	6.9 (cell)	-	-	-	-	-	-	1985	Thin film Si on steel substrate solar cell.
260	Zweibel and Barnett (1993)	-	-	9.6 (cell)	-	-	-	-	-	-	1985	Thin film Si on steel substrate solar cell.
261	Zweibel and Barnett (1993)	-	-	10.2 (cell)	-	-	-	-	-	-	1987	Thin film Si on ceramic substrate solar cell.
262	Zweibel and Barnett (1993)	-	-	15.7 (cell)	-	-	-	-	-	-	1988	Thin film Si on ceramic substrate solar cell.
263	Zweibel and Barnett (1993)	-	-	16 (module)	-	-	-	-	-	-	Assume Thin film Si 1992	
264	Zweibel and Barnett (1993)	-	-	9.7 (module)	-	-	\$200/ sq. m (\$2.06/ W _p using quoted efficiency of 9.7%) (assume 1992 \$)	-	-	-	Assume CIS 1992	

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride;
O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes	
				O&M	BOS	Module	System				Electricity
265	Zweibel and Barnett (1993)	-	-	6.5 (module)	-	-	\$150/ sq. m (\$2.31/ W _p using quoted efficiency of 6.5%) (assume 1992 \$)	-	-	-	Assume CdTe 1992
266	Zweibel and Barnett (1993)	-	-	15 (module), 12 (system)	\$0.005/ kWh	\$80/ sq. m (fixed array), \$20/ sq. m (power conditioning), \$4/ sq. m (land), 33% of direct costs (Indirect costs)	\$400/ sq. m (\$3.08/ W _p using quoted efficiency of 13%) (assume 1992 \$)	-	\$0.40/ kWh (assume 1992 \$)	37	Assume Location assumes average US sunlight of 1,800 kWh/ sq. m/ year for a fixed flat plate.
267	Zweibel and Barnett (1993)	-	-	13 (module), 10 (system)	\$0.001/ kWh	\$50/ sq. m (fixed array), \$10/ sq. m (power conditioning), \$4/ sq. m (land), 25% of direct costs (Indirect costs)	\$50/ sq. m	-	\$0.06/ kWh	-	? Projected cost; location assumes average US sunlight of 1,800 kWh/ sq. m/ year for a fixed flat plate.
268	Firor, Vigotti, and Iannucci (1993)	-	-	-	\$0.004-0.07/ kWh (average \$0.023/ kWh)	-	-	-	-	-	Assume Results of EPRI commissioned 1989 study of 7 medium-scale US PV projects. Three of the systems produced more than 1 MW of power, and these had substantially lower O&M costs. Also see items 55 and 239.
269	Costello and Rappaport (1980)	-	-	16 (cell)	-	-	-	-	-	-	Assume Efficiencies achieved by 1980 experimental semicrystalline Si cells.
270	Costello and Rappaport (1980)	-	-	8-12 (cell)	-	-	-	-	-	-	Assume Efficiencies achieved by ribbon 1980 Si cells.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices				Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System			
271 Costello and Rappaport (1980)	-	-	19-28.5 (cell)	-	-	-	-	-	-	Assume 1980 Efficiencies achieved by concentrator cells (the former is for Si cells under 300 suns and the latter for gallium aluminum arsenide and Si cells illuminated through a beam splitter at 167 suns).
272 Costello and Rappaport (1980)	-	-	24.7 (cell)	-	-	-	-	-	-	Assume 1980 Best efficiency for a single junction device at 178 suns.
273 Carlson (1990)	-	-	11 to 13 (cell)	-	-	-	-	-	-	Assume 1990 Assume 1990. Polycrystalline thin film CdTe-based solar cells
274 Boes and Luque (1993)	300 kW	-	9 (average annual DC system efficiency)	-	-	-	-	-	-	Assume 1992 Soleras PV concentrator power system in Saudi Arabia, operational since 1981.
275 Boes and Luque (1993)	225 kW	-	6.5 (average annual DC system efficiency)	-	-	-	-	-	-	Assume 1982 Sky Harbor PV concentrator system in Phoenix, Arizona; set up in 1982. It was dismantled, as planned, after several years of operation. System experienced numerous inverter, module and array problems.
276 Boes and Luque (1993)	25 kW	-	7 (system electrical efficiency)	-	-	-	-	-	-	1982-1987 Assume 1985. DFW PV concentrator system in Dallas-Fort Worth, Texas; set up in 1982. Has not been operational for several years because of inverter problems.
277 Boes and Luque (1993)	-	-	15 (average peak module efficiency); 13 (array field operational efficiency).	-	-	-	-	-	-	Assume 1992 ENTECH-3M Austin system in Austin, Texas. Operational PV concentrator system, set up in 1989.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

(continued on next page)

(Table A8.1 continued)

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
278 SERI (1989)	-	-	-	-	2,000 battery (storage for 5 days); 100 wiring controls; 1,500 labor.	7,000 (module including racks)	-	-	-	1987	All costs in \$(1987)/ kWp(DC). Actual cost of remote stand-alone (1 kW) installed system.
279 SERI (1989)	-	-	-	-	1,500 battery (storage for 5 days); 50 wiring controls; 1,000 labor.	5,000 (module including racks)	-	-	-	1990	All costs in \$(1987)/ kWp(DC). Predicted cost of remote stand-alone (1 kW) installed system.
280 SERI (1989)	-	-	-	-	1,500 battery (storage for 5 days); 50 wiring controls; 800 labor.	3,000 (module including racks)	-	-	-	1995	All costs in \$(1987)/ kWp(DC). Predicted cost of remote stand-alone (1 kW) installed system.
281 SERI (1989)	-	-	-	-	1,500 battery (storage for 5 days); 50 wiring controls; 500 labor.	2,000 (module including racks)	-	-	-	2000	All costs in \$(1987)/ kWp(DC). Predicted cost of remote stand-alone (1 kW) installed system.
282 SERI (1989)	-	-	-	-	500 power conditioning; 500 wiring; 1,000 labor.	5,000 (module including racks or tracker)	-	-	-	1987	All costs in \$(1987)/ kWp(AC). Actual cost of large, installed, grid-tied system.
283 SERI (1989)	-	-	-	-	400 power conditioning; 300 wiring; 800 labor.	4,000 (module including racks or tracker)	-	-	-	1990	All costs in \$(1987)/ kWp(AC). Predicted cost of large, installed, grid-tied system.
284 SERI (1989)	-	-	-	-	200 power conditioning; 200 wiring; 500 labor.	2,000 (module including racks or tracker)	-	-	-	1995	All costs in \$(1987)/ kWp(AC). Predicted cost of large, installed, grid-tied system.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride; O&M = operation and maintenance; BOS = balance of system.

Reference	Module Size (W)	Module life (yrs)	Efficiency (%)	Costs in current prices					Electricity cost, 1990 US¢/kWh	Year	Notes
				O&M	BOS	Module	System	Electricity			
285 SERI (1989)	-	-	-	-	150 power conditioning; 150 wiring; 300 labor.	1,500 (module in- cluding racks or tracker)	-	-	-	2000	All costs in \$(1987)/ kWp(AC). Predicted cost of large, installed, grid-tied system.
286 U.S. DOE (1991)	-	-	31	-	-	-	-	-	-	1988	Mechanically stacked GaAs cell on single crystal Si cell, under concentrated light.
287 Meridian Corporation (1992)	-	-	28.2 (Si concentrator cell)	-	-	-	-	-	-	1992	Si concentrator cell at 140 suns.
288 Meridian Corporation (1992)	-	-	15-17 (commercial concentrator Si module)	-	-	-	-	-	-	1992	Commercial concentrator Si module at 20 suns.

Note: Si = Silicon; CIS = Copper Indium Diselenide; GaAs = Gallium Arsenide; CdTe = Cadmium Telluride;
O&M = operation and maintenance; BOS = balance of system.

Annex 9. Photovoltaic Efficiencies

Table A9.1. Photovoltaic Efficiencies

Year	Crystalline Silicon					Polycrystalline Silicon					
	Field module	Prototype module	Laboratory cell	Theoretical limit	Concentrator		Field module	Thin film			
					Laboratory cell	Theoretical limit		Laboratory cell	Field module	On steel lab. cell	On ceramic lab. cell
1974			17								
1976	7 to 8										
1980	9 to 10		8 to 12								
1980											
1982			17								
1983			18								
1984			19								
1985	11 to 12		20							6.9	
1985										9.6	
1986											
1987											10.2
1988											15.7
1989											
1990	12 to 13		14.5 to 23.2	33	20 to 27						
1990			24								
1991	11 to 13		22 to 23		>25	30		15			
1991			23								
1991											
1992	10 to 12	17.8	24.2	30 to 33	28.2		15-17		16		
1992			23 to 24								
1993											
1995	14 to 15		25								
1998											
2005											
2010											
2030	>18		>26								

Note: All values are from Annex 8 and are figures quoted by different sources in the literature reviewed. All figures are percentages. s-c = single crystal; ns = not specified; in = initial value; st = stabilized value.

(continued on next page)

(Table A9.1 continued)

Year	Polycrystalline Si		Copper Indium Diselenide (CIS)				CIS and Amorphous Silicon			
	Field module	Laboratory cell	Field module	Prototype module	Laboratory cell	Theoretical limit	Multi-junctional lab. cell	Multijunct. prototype module	Multijunct. theoretical limit	Multi-junctional field module
1974										
1976										
1980		16			10					
1980										
1982										
1983										
1984										
1985										
1985										
1986				5	9.6					
1987										
1988				11.1						
1989										
1990					11 to 14					
1990										
1991				11	14		14.6			
1991										
1991										
1992	8 to 9	18.2	9.7	11.1	14.8	23.5	15.6 (in)	12.3 (in)	42	
1992										
1993										
1995										
1998										
2005										18 (st)
2010										
2030										

Note: All values are from Annex 8 and are figures quoted by different sources in the literature reviewed.
 All figures are percentages. s-c = single crystal; ns = not specified; in = initial value; st = stabilized value.

Year	Cadmium Telluride (CdTe)				Amorphous Silicon						
	Field module	Prototype module	Laboratory cell	Theoretical limit	Field module	Prototype module	Laboratory cell	Theoretical limit	Multi-junctional lab. cell	Multi-junctional field module	Multijunct. prototype module
1974							1 (in)				
1976											
1980											
1980											
1982											
1983											
1984											
1985											
1985											
1986		5	9								
1987							12 (ns)	22			
1988											
1989		7.3	12.3								
1990			11 to 13		4 to 5 (st)		11 to 12 (ns)	11 to 17 (ns)			
1990											
1991	6.5	8.1	12		4 to 5 (ns)	10 (ns)	12 (in)				
1991		10	12.7				>13 (in)				
1991			14								
1992	6.5	10	15.8	27 to 28	3 to 5 (st)	5 (st)	6 (st)	27 to 28	10 (st)	6 (st)	8 (st)
1992											
1993										7 to 8 (st)	
1995										10 (st)	
1998											
2005											
2010											
2030											

Note: All values are from Annex 8 and are figures quoted by different sources in the literature reviewed.
All figures are percentages. s-c = single crystal; ns = not specified; in = initial value; st = stabilized value.

(continued on next page)

(Table A9.1 continued)

Year	Gallium Arsenide (GaAs)								Not specified		
	Concentrator			Grown on:		Crystalline GaAs			Commercial modules	Cells	Flat plate commercial modules
	Prototype module	Laboratory cell	On s-c Si multijunct. lab. cell	On GaSb multijunct. lab. cell	Si or Ge support (lab. cell)	GaAs support, then removed (lab. cell)	Laboratory cell	Theoretical limit			
1974											
1976									10		
1980											
1980											
1982											
1983											
1984											
1985											
1985											
1986											
1987											12
1988			31								
1989									11.5		
1990		29		37		22	25	33	10		
1990									11.5		
1991		30			20		25		11 to 17	34	
1991							25		5 to 15		
1991											
1992	22	28		34					12 to 13		
1992									15		
1993											
1995									10 to 20		
1998											13 to 17
2005											
2010											
2030									15 to 25		

Note: All values are from Annex 8 and are figures quoted by different sources in the literature reviewed. All figures are percentages. s-c = single crystal; ns = not specified; in = initial value; st = stabilized value.

Year	Multijunction concentrator		Flat plate thin film		Concentrators		Tandem cell			
	Lab. cells	Lab. cells; theor. limit	Comm'l modules	Lab. cells	Comm'l modules	Lab. cells	2 amorphous layers		2 crystalline layers	
							Lab. cells	Theoretical limit	Lab. cells	Theoretical limit
1974										
1976										
1980						19 to 28.5				
1980						24.7				
1982									21	47
1983										
1984										
1985										
1985										
1986										
1987					17					
1988							14	29		
1989										
1990										
1990										
1991	>34	40	4 to 6	12 to 14	14 to 17	27 to 32				
1991										
1991										
1992					15					
1992										
1993										
1995			8 to 10	15 to 18	18 to 20	35				
1998					23 to 29					
2005										
2010										
2030			>15	>20	>25	>40				

Note: All values are from Annex 8 and are figures quoted by different sources in the literature reviewed.
All figures are percentages. s-c = single crystal; ns = not specified; in = initial value; st = stabilized value.

(continued on next page)

(Table A9.1 continued)

Year	System		
	Flat plate	Con- centrator	Type not specified
1974			
1976			
1980			
1980			
1982		6.5	
1983			
1984			
1985		7	
1985			
1986			
1987	10	14.4	8
1988			7.2
1989			
1990	8		
1990			
1991			
1991			
1991			
1992		9	12
1992			
1993			
1995			
1998	11.7 to 15.3	20.7 to 26.1	
2005			
2010			15
2030			

Note: All values are from Annex 8 and are figures quoted by different sources in the literature reviewed.
All figures are percentages. s-c = single crystal; ns = not specified; in = initial value; st = stabilized value.

Annex 10. Photovoltaic Module Costs

Table A10.1. Photovoltaic Module Costs

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes	
			Size of order								
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity	Size not specified			
1	Costello and Rappaport (1980)	< \$10/W _p (assume 1980 \$)						15.85	-	1980	Module cost
2	Costello and Rappaport (1980)	~ \$20/W _p (assume 1975 \$)				48.53			-	1975	First large US federal purchase of modules for terrestrial use
3	Costello and Rappaport (1980)	~ \$15-36/W _p (assume 1978 \$)					30.01- 72.03		-	1978	Result of SERI survey of commercial module prices in 1978, sold in small quantities
4	Costello and Rappaport (1980)	~ \$10-15/W _p (assume 1978 \$)				20.01- 30.01			-	1978	Result of SERI survey of commercial module prices in 1978, sold in large quantities
18	Carlson (1990)	\$4/W _p (1987 \$)						4.59	-	1988	Called solar cell cost in text, but factory module price in graph.
19	Carlson (1990)	\$100/W _p (assume 1972 \$)						312.28	-	Early 70s	Assume 1972. Called solar cell cost in text, but factory module price in graph.
20	Carlson (1990)	\$13/W _p (1987)						14.93	-	1980	Factory price for module
21	Real Goods (1991)	\$6.85-7.27/W _p (1991)	6.97	6.57					48 ea.	1991	Manufacturer (Mfr.): Hoxan (heliopower); H-4810; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
22	Real Goods (1991)	\$4.47-4.99/W _p (1991)	4.79	4.29					96 ea.	1991	Mfr.: Siemens; recycled Arco modules (6-7 yrs old); single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.

*Item = item from Annex 8. W_p = peak Watts.

(continued on next page)

(Table A10.1 continued)

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]				W _p	Year	Notes	
			Size of order							
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity	Size not specified		
23	Real Goods (1991)	\$8.73-9.35/W _p (1991)	8.97	8.37				48 ea.	1991	Mfr.: Siemens; M-75; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
24	Real Goods (1991)	\$9.04-9.42/W _p (1991)	9.03	8.67				53 ea.	1991	Mfr.: Siemens; M-55; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
25	Real Goods (1991)	\$8.98-9.73/W _p (1991)	8.61- 9.33					40 ea.	1991	Mfr.: Siemens; M-40; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
26	Real Goods (1991)	\$9.51-10.21/W _p (1991)	9.12- 9.79					43 ea.	1991	Mfr.: Siemens; M-65; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
27	Real Goods (1991)	\$11.32/W _p (1991)	10.86					22	1991	Mfr.: Siemens; M-20; single crystal; self-regulating module; actual sale price of module.
28	Real Goods (1991)	\$9.16-9.97/W _p (1991)	8.78- 9.56					37 ea.	1991	Mfr.: Siemens; M-35; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
29	Real Goods (1991)	\$8.94-9.56/W _p (1991)	9.17	8.57				48 ea.	1991	Mfr.: Siemens; M-50; single crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
30	Real Goods (1991)	\$17.80/W _p (1991)	17.07					5	1991	Mfr.: Siemens; T-5; single crystal; useful for small applications; actual sale price of module.
31	Real Goods (1991)	\$23.60/W _p (1991)	22.63					2.5	1991	Mfr.: Siemens; G-50; single crystal; useful for very small applications; actual sale price of module.

*Item = item from Annex 8. W_p = peak Watts.

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes	
			Size of order								
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity	Size not specified			
32	Real Goods (1991)	\$7.82-8.22/W _p (1991)	7.88	7.5					51 ea.	1991	Mfr.: Kyocera; K-51; multicrystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
33	Real Goods (1991)	\$7.92-8.59/W _p (1991)	7.59- 8.24						45.3 ea.	1991	Mfr.: Kyocera; K-45; multi-crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
34	Real Goods (1991)	\$8.60-8.92/W _p (1991)	8.55	8.25					62.7 ea.	1991	Mfr.: Kyocera; K-63; multi-crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
35	Real Goods (1991)	\$13.30/W _p (1991)	12.75						30	1991	Mfr.: Solarex; MSX30 Unbreakable Module; multi-crystal; Thin, lightweight, portable; actual sale price of module.
36	Real Goods (1991)	\$12.85/W _p (1991)	12.32						18.6	1991	Mfr.: Solarex; MSX18; Unbreakable Module; multicrystal; Thin, lightweight, portable; actual sale price of module.
37	Real Goods (1991)	\$13.90/W _p (1991)	13.33						10	1991	Mfr.: Solarex; MSX10; Unbreakable Module; multicrystal; Thin, lightweight, portable; actual sale price of module.
38	Real Goods (1991)	\$6.98-7.32/W _p (1991)	7.02	6.69					60 ea.	1991	Mfr.: Solarex; MSX60; multi-crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
39	Real Goods (1991)	\$7.13-7.48/W _p (1991)	7.17	6.84					56 ea.	1991	Mfr.: Solarex; MSX56; multi-crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.

*Item = item from Annex 8. W_p = peak Watts.

(continued on next page)

(Table A10.1 continued)

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes	
			Size of order								
			<100: W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity	Size not specified			
40	Real Goods (1991)	\$6.77-7.34/W _p (1991)	7.04	6.49					53 ea.	1991	Mfr.: Solarex; MSX53; multi-crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
41	Real Goods (1991)	\$7.98-8.48/W _p (1991)	7.65- 8.13						40	1991	Mfr.: Solarex; MSX40; multi-crystal; actual sale price of module. Higher price is for 1-3 modules; lower for >20.
42	Real Goods (1991)	\$6.90/W _p (1991)	6.62						10	1991	Mfr.: Chronar; amorphous; originally rated 12W, but seller rating them as 10W to allow for 20% degradation in first year; actual sale price of module.
51	U.S. Congress (1992)	\$4,000- 6,000/kW _p (assume 1992 \$)				3.74	5.61		-	1992	Assume 1992. IJN Committee on Development & Utilization of New & Renewable Sources of Energy: \$4000/kW _p price for crystalline silicon large orders (excl. taxes and delivery); US retailer: \$6000 for small orders; Dominican Republic: \$6000/kW _p for 38W panel.
52	U.S. Congress (1992)	\$1,000/kW _p (assume 1990 \$)						1	-	1995	PV industry reps. forecast according to SERI.
53	U.S. Congress (1992)	\$1,500/kW _p (assume 1989 \$)				1.58			-	1994	EPRI estimate for large flat-plate system.
61	National Research Council (1976)	\$20-30/W _p						45.87- 68.81	-	1976	
63	National Research Council (1981)	\$22/W _p (assume 1976 \$)						50.46	-	1976	In the U.S.
64	National Research Council (1981)	\$7-10/W _p (assume 1980 \$)						11.09- 15.85	-	1980	In the US with 2 MW production.

*Item = item from Annex 8. W_p = peak Watts.

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes	
			Size of order								
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity	Size not specified			
65	Hislop (1992)	\$5/W _p (MW _p orders), \$10/W _p (>1 kW _p orders), \$25/W _p (<100 W _p orders).	23.98	9.59	4.79				-	1991	
66	Palz (1978)	\$20/W _p (assume 1975 \$)						48.53	-	1975	Terrestrial PV yearly production volume 100 kW in 1975.
69	SERI (1989)	\$20/W (assume 1977 \$)						43.06	-	1977	
70	SERI (1989)	\$4-5/W (assume 1988 \$)						4.42-5.52	-	1988	
71	NREL (1992c)	\$500/W (assume 1972 \$)						1,561.39	-	1972	
72	NREL (1992c)	\$4.00-4.50/W						4-4.5	-	1990	
109	Thornton and Brown (1992)	\$4.00-8.00/W (assume 1991 \$)						3.84-7.67	-	1991	
113	International Energy Agency (1987)	\$550/sq. m (\$4.40/W _p using quoted 12.5% efficiency) (1982 \$)						5.95	-	1987	Assume 1987. Flat plate systems. All costs in 1982 \$. For area with solar insolation of 6 kWh/sq. m/day.
114	International Energy Agency (1987)	\$40-75/sq. m (\$0.24-0.58/W _p using quoted 13-17% efficiency) (1982 \$)						0.32-0.78	-	Late 90s	Assume 1998. Flat plate systems. All costs in 1982 \$. For area with solar insolation of 6 kWh/sq. m/day.
115	International Energy Agency (1987)	\$750/sq. m (\$4.41/W _p using quoted 17% efficiency) (1982 \$)						5.97	-	1987	Assume 1987. Concentrator systems. All costs in 1982 \$. For area with solar insolation of 6 kWh/sq. m/day.

*Item = item from Annex 8. W_p = peak Watts.

(continued on next page)

(Table A10.1 continued)

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes	
			Size of order								
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity	Size not specified			
116	International Energy Agency (1987)	\$90-100/sq. m (\$0.31-0.43/W _p using quoted 23-29% efficiency) (1982 \$)						0.42-0.66	-	Late 90s	Assume 1998. Concentrator systems. All costs in 1982 \$. For area with solar insolation of 6 kWh/sq. m/day.
129	Tsuchiya (1992)	7,000 yen/W _p						63.84	-	1979	Assume cost is in 1979 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).
130	Tsuchiya (1992)	4,000 yen/W _p						33.78	-	1980	Assume cost is in 1980 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).
131	Tsuchiya (1992)	3,500 yen/W _p						28.18	-	1981	Assume cost is in 1981 currency. Adjusted to 1990 yen, then to 1990 \$ (see Annex 1).
132	Tsuchiya (1992)	2,200 yen/W _p						17.25	-	1982	Assume cost is in 1982 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).
133	Tsuchiya (1992)	1,800 yen/W _p						13.87	-	1983	Assume cost is in 1983 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).
134	Tsuchiya (1992)	1,500 yen/W _p						11.3	-	1984	Assume cost is in 1984 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).
135	Tsuchiya (1992)	1,200 yen/W _p						8.86	-	1985	Assume cost is in 1985 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).
136	Tsuchiya (1992)	1,100 yen/W _p						8.07	-	1986	Assume cost is in 1986 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).
137	Tsuchiya (1992)	1,000 yen/W _p						7.33	-	1987	Assume cost is in 1987 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).

*Item = item from Annex 8. W_p = peak Watts.

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes	
			Size of order								
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity	Size not specified			
138	Tsuchiya (1992)	900 yen/W _p						6.55	-	1988	Assume cost is in 1988 currency. Adjusted to 1990 yen and then to 1990 \$ (see Annex 1).
139	ESMAP (1989)	Rs. 104/W _p (assume 1989)	5.22	5.22					103 / 3,423	1989	Decentralized DC system; no land costs; assumptions incl. insolation = 3.5 kWh/sq. m/day (worst case), 2 day storage requirement, and certain battery and controller lifetimes (2 and 8 resp.). Adj. to 1990 Pak. Rs., then to 1990 \$ (see Annex 1).
150	Perlack, Jones, and Waddle (1990)	\$4-5/W _p						4 to 5	-	1990	Costs of larger systems are lower.
152	UNDP (1992)	\$4/W (module cost for large consignments, 50 MW)			3.74				50 MW	1992	Assume 1992. International price for modules per container load.
154	UNDP (1992)	\$12.17/W (1991)	11.67						-	1991	Solematic module price.
155	UNDP (1992)	\$9.22/W (1991)	8.84						-	1991	Battery World module price.
156	UNDP (1992)	\$9.27/W (1991)	8.89						-	1991	Solarcomm module price.
157	ESMAP back-to-office report, 1992	\$260.69 (\$5.21/W _p)	4.87						50	1992	Assume 1992
158	ESMAP (1991b)	\$495 (\$5.5/W _p)	5.5						90	1990	Assumptions incl. 1 kWh storage requirement; 10% discount rate; 4 kWh/sq. m/day insolation (worst case); 80% battery energy efficiency; 70% max. depth of discharge; 2 yr battery lifetime; 8 yr controller lifetime; 0.25 kWh/day system load; etc.
160	Meridian Corporation (1992)	\$30/W (currency year not specified) (assume 1975)						72.8	-	1975	From Maycock (1991).

*Item = item from Annex 8. W_p = peak Watts.

(continued on next page)

(Table A10.1 continued)

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes	
			Size of order								
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity	Size not specified			
161	Meridian Corporation (1992)	\$13/W (currency year not specified) (assume 1980)						20.6	-	1980	From Maycock (1991).
162	Meridian Corporation (1992)	\$7/W (currency year not specified) (assume 1985)						8.5	-	1985	From Maycock (1991).
163	Meridian Corporation (1992)	\$4/W (currency year not specified) (assume 1990)						4	-	1990	From Maycock (1991).
164	Meridian Corporation (1992)	\$3/W (currency year not specified) (assume 1992)						2.8	-	1995	Projected values from Maycock (1991).
165	Meridian Corporation (1992)	\$2/W (currency year not specified) (assume 1992)						1.87	-	2000	Projected values from Maycock (1991).
166	Meridian Corporation (1992)	\$1.4/W (currency year not specified) (assume 1992)						1.31	-	2005	Projected values from Maycock (1991).
167	Meridian Corporation (1992)	\$1/W (currency year not specified) (assume 1992)						0.93	-	2010	Projected values from Maycock (1991).
168	Meridian Corporation (1992)	Rs. 90 (1988)/W _p						5.95	-	1988	Assume 1988. In India. Adjusted to 1990 Indian rupees and then to 1990 \$ as described in Annex 1.
174	Meridian Corporation (1992)	\$5.30-10.50/W						4.95-9.81	-	1992	Assume 1992. Estimate for stand-alone systems.

*Item = item from Annex 8. W_p = peak Watts.

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes
			Size of order							
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity			
175	Meridian Corporation (1992)	\$5,854/kW (1992 \$)					5.47	-	1990	Levelized cost of grid independent system; 10% discount rate; assumptions incl. 5 yr battery life and 10 yr controls life. Assume "small" quantity of modules required.
176	Meridian Corporation (1992)	\$3,512/kW (1992 \$)					3.28	-	1995	Levelized cost of grid independent system; 10% discount rate; assumptions incl. 5 yr battery life and 10 yr controls life. Assume "small" quantity of modules required.
177	Meridian Corporation (1992)	\$2,342/kW (1992 \$)					2.19	-	2000	Levelized cost of grid independent system; 10% discount rate; assumptions incl. 8 yr battery life and 15 yr controls life. Assume "small" quantity of modules required.
178	Meridian Corporation (1992)	\$1,756/kW (1992 \$)					1.64	-	2010	Levelized cost of grid independent system; 10% discount rate; assumptions incl. 8 yr battery life and 15 yr controls life. Assume "small" quantity of modules required.
179	Meridian Corporation (1992)	\$4,683/kW (1992 \$)					4.38	-	1990	Levelized cost of grid connected system; 10% discount rate; assumptions incl. 5 yr battery life and 10 yr controls life. Assume "large" quantity of modules required.
180	Meridian Corporation (1992)	\$2,342/kW (1992 \$)					2.19	-	1995	Levelized cost of grid connected system; 10% discount rate; assumptions incl. 5 yr battery life and 10 yr controls life. Assume "large" quantity of modules required.

*Item = item from Annex 8. W_p = peak Watts.

(continued on next page)

Item*	Reference	Module cost	Module cost [\$(1990)/W _p]					W _p	Year	Notes	
			Size of order								
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity				Size not specified
181	Meridian Corporation (1992)	\$1,756/kW (1992 \$)				1.64		-	2000	Levelized cost of grid connected system; 10% discount rate; assumptions incl. 8 yr battery life and 15 yr controls life. Assume "large" quantity of modules required.	
182	Meridian Corporation (1992)	\$1,405/kW (1992 \$)				1.31		-	2010	Levelized cost of grid connected system; 10% discount rate; assumptions incl. 8 yr battery life and 15 yr controls life. Assume "large" quantity of modules required.	
189	Carlson (1992)	\$5/W _p (for large quantities)				5		-	1990		
190	Carlson (1992)	About \$20/W _p (assume 1980 \$)						31.69	-	1980	
191	Remy and Durand (1992)	\$5.3/W _p (selling price)						5.3	-	1990	1990 (current) prices.
192	Remy and Durand (1992)	\$2.6/W _p (selling price) (assume 1990 \$)						2.6	-	1995	Projected price assuming absence of large (utility-based) markets but expecting "natural" doubling of sales every 5 years.
193	Kimura (1992)	Yen 600-700/W _p (\$4.60-5.40/W _p)						4.6-5.4	-	1990	Production level of 3-5 MW/yr.
205	Hankins (1993)	US\$13-15/W _p	12.15-14.02						-	1992	Assume 1992. PV module price to customer in Zimbabwe.
210	Hankins (1993)	\$9.38/W _p (assume 1992 \$)	8.77						-	1992	Assume 1992. Typical price for standard module in Dominican Republic.
211	Hankins (1993)	\$7.80/W _p (assume 1992 \$)	7.29						-	1992	Assume 1992. Typical price for standard module in Kenya.
212	Hankins (1993)	\$10.40/W _p (assume 1992 \$)	9.72						-	1992	Assume 1992. Typical price for standard module in Sri Lanka.

*Item = item from Annex 8. W_p = peak Watts.

Item*	Reference	Module cost	Module cost [\$(1990)/W _p] Size of order					W _p	Year	Notes
			<1000 W _p	1 kW _p - 1 MW _p	>1 MW _p	"Large" quantity	"Small" quantity			
213	Hankins (1993)	\$14.34/W _p (assume 1992 \$)	13.4					-	1992	Assume 1992. Typical price for standard module in Zimbabwe.
218	Kelly (1993)	\$20/W _p (1989 \$)						-	1976	The average selling price of flat-plate photovoltaic modules.
219	Kelly (1993)	\$7.1/W _p (1989 \$)						-	1984	The average selling price of flat-plate photovoltaic modules.
220	Kelly (1993)	\$6.2/W _p (1989 \$)						-	1990	The average selling price of flat-plate photovoltaic modules.
245	Green (1993)	\$5/W _p (1989 \$)						-	1989	1989. Average module price.
264	Zweibel and Barnett (1993)	\$200/sq. m (\$2.06/W _p using quoted efficiency of 9.7%) (assume 1992\$)						-	1992	Assume 1992. Copper indium diselenide
265	Zweibel and Barnett (1993)	\$150/sq. m (\$2.31/W _p using quoted efficiency of 6.5%) (assume 1992\$)						-	1992	Assume 1992. Cadmium telluride
266	Zweibel and Barnett (1993)	\$400/sq. m (\$3.08/W _p using quoted efficiency of 13%) (assume 1992\$)						-	1992	Assume 1992. Location assumes average US sunlight of 1800 kWh/sq. m/yr for a fixed flat plate.

*Item = item from Annex 8. W_p = peak Watts.

Distributors of World Bank Publications

ARGENTINA
Carlos Hirsch, SRL
Galeria Guemes
Florida 165, 4th Floor-Ofc. 453/465
1333 Buenos Aires

**AUSTRALIA, PAPUA NEW GUINEA,
FIJI, SOLOMON ISLANDS,
VANUATU, AND WESTERN SAMOA**
D.A. Information Services
648 Whitehorse Road
Mitcham 3132
Victoria

AUSTRIA
Gerold and Co.
Graben 31
A-1011 Wien

BANGLADESH
Micro Industries Development
Assistance Society (MIDAS)
House 5, Road 16
Dhanmondi R/Area
Dhaka 1209

Branch offices:
Pine View, 1st Floor
100 Agrabad Commercial Area
Chittagong 4100

BELGIUM
Jean De Lannoy
Av. du Roi 202
1060 Brussels

CANADA
Le Diffuseur
151A Boul. de Mortagne
Boucherville, Québec
J4B 5E6

Renouf Publishing Co.
1294 Algoma Road
Ottawa, Ontario
K1B 3W8

CHILE
Invertec IGT S.A.
Av. Santa Maria 6400
Edificio INTEC, Of. 201
Santiago

CHINA
China Financial & Economic
Publishing House
8, La Fo Si Dong Jie
Beijing

COLOMBIA
Infoenlace Ltda.
Apartado Aereo 34270
Bogota D.E.

COTE D'IVOIRE
Centre d'Édition et de Diffusion
Africaines (CEDA)
04 B.P. 541
Abidjan 04 Plateau

CYPRUS
Center of Applied Research
Cyprus College
6, Diogenes Street, Engomi
P.O. Box 2006
Nicosia

DENMARK
Samfundslitteratur
Rosenværns Allé 11
DK-1970 Frederiksberg C

DOMINICAN REPUBLIC
Editora Taller, C. por A.
Restauración e Isabel la Católica 309
Apartado de Correos 2190 Z-1
Santo Domingo

EGYPT, ARAB REPUBLIC OF
Al Abram
Al Galaa Street
Cairo

The Middle East Observer
41, Sherif Street
Cairo

FINLAND
Akateeminen Kirjakauppa
P.O. Box 128
SF-00101 Helsinki 10

FRANCE
World Bank Publications
66, avenue d'Iéna
75116 Paris

GERMANY
UNO-Verlag
Poppelsdorfer Allee 55
D-5300 Bonn 1

HONG KONG, MACAO
Asia 2000 Ltd.
46-48 Wyndham Street
Winning Centre
2nd Floor
Central Hong Kong

HUNGARY
Foundation for Market Economy
Dombóvári Ut 17-19
H-1117 Budapest

INDIA
Allied Publishers Private Ltd.
751 Mount Road
Madras - 600 002

Branch offices:
15 J.N. Heredia Marg
Ballard Estate
Bombay - 400 038

13/14 Anaf Ali Road
New Delhi - 110 002

17 Chittaranjan Avenue
Calcutta - 700 072

Jayadeva Hostel Building
5th Main Road, Gandhinagar
Bangalore - 560 009

3-5-1129 Kachiguda
Cross Road
Hyderabad - 500 027

Prarthana Flats, 2nd Floor
Near Thakore Baug, Navrangpura
Ahmedabad - 380 009

Patiala House
16-A Ashok Marg
Lucknow - 226 001

Central Bazaar Road
60 Bajaj Nagar
Nagpur 440 010

INDONESIA
Pt. Indira Limited
Jalan Borobudur 29
P.O. Box 181
Jakarta 10320

IRAN
Kowkab Publishers
P.O. Box 19575-511
Tehran

IRELAND
Government Supplies Agency
4-5 Harcourt Road
Dublin 2

ISRAEL
Yozmot Literature Ltd.
P.O. Box 56055
Tel Aviv 61560

ITALY
Licosa Commissionaria Sansoni SPA
Via Duca Di Calabria, 1/1
Casella Postale 552
50125 Firenze

JAPAN
Eastern Book Service
Hongo 3-Chome, Bunkyo-ku 113
Tokyo

KENYA
Africa Book Service (E.A.) Ltd.
Quaran House, Mfangano Street
P.O. Box 45245
Nairobi

KOREA, REPUBLIC OF
Pan Korea Book Corporation
P.O. Box 101, Kwangwhamun
Seoul

Korean Stock Book Centre
P.O. Box 34
Yeoido
Seoul

MALAYSIA
University of Malaya Cooperative
Bookshop, Limited
P.O. Box 1127, Jalan Pantai Baru
59700 Kuala Lumpur

MEXICO
INFOTEC
Apartado Postal 22-860
14060 Tlalpan, Mexico D.F.

NETHERLANDS
De Lindboom/In-Or-Publikaties
P.O. Box 202
7480 AE Haaksbergen

NEW ZEALAND
EBSCO NZ Ltd.
Private Mail Bag 99914
New Market
Auckland

NIGERIA
University Press Limited
Three Crowns Building Jericho
Private Mail Bag 5095
Ibadan

NORWAY
Narvesen Information Center
Book Department
P.O. Box 6125 Etterstad
N-0602 Oslo 6

PAKISTAN
Mirza Book Agency
65, Shahrah-e-Quaid-e-Azam
P.O. Box No. 729
Lahore 54000

PERU
Editorial Desarrollo SA
Apartado 3824
Lima 1

PHILIPPINES
International Book Center
Suite 1703, Cityland 10
Condominium Tower 1
Ayala Avenue, H.V. dela
Costa Extension
Makati, Metro Manila

POLAND
International Publishing Service
Ul. Plekna 31/37
00-677 Warszawa

For subscription orders:
IPS Journals
Ul. Okrezna 3
02-916 Warszawa

PORTUGAL
Livraria Portugal
Rua Do Carmo 70-74
1200 Lisbon

SAUDI ARABIA, QATAR
Jatir Book Store
P.O. Box 3196
Riyadh 11471

**SINGAPORE, TAIWAN,
MYANMAR, BRUNEI**
Cover Asia Pacific Pte Ltd.
Colden Wheel Building
41, Kallang Pudding, #04-03
Singapore 1334

SOUTH AFRICA, BOTSWANA
For single titles:
Oxford University Press
Southern Africa
P.O. Box 1141
Cape Town 8000

For subscription orders:
International Subscription Service
P.O. Box 41095
Craighall
Johannesburg 2024

SPAIN
Mundi-Prensa Libros, S.A.
Castello 37
28001 Madrid

Libreria Internacional AEDOS
Consell de Cent, 391
08009 Barcelona

SRI LANKA AND THE MALDIVES
Lake House Bookshop
P.O. Box 244
100, Sir Chittampalam A.
Cardinal Mawatha
Colombo 2

SWEDEN
For single titles:
Fritzes Fackboksforstaget
Regeringsgatan 12, Box 16356
S-103 27 Stockholm

For subscription orders:
Wernnergren-Williams AB
P.O. Box 1305
S-171 25 Solna

SWITZERLAND
For single titles:
Librairie Payot
Case postale 3212
CH 1002 Lausanne

For subscription orders:
Librairie Payot
Service des Abonnements
Case postale 3312
CH 1002 Lausanne

THAILAND
Central Department Store
306 Silom Road
Bangkok

**TRINIDAD & TOBAGO, ANTIGUA,
BARBUDA, BARBADOS,
DOMINICA, GRENADA, GUYANA,
JAMAICA, MONTSERRAT, ST.
KITTS & NEVIS, ST. LUCIA,
ST. VINCENT & GRENADINES**
Systematics Studies Unit
#9 Watts Street
Curepe
Trinidad, West Indies

UNITED KINGDOM
MicroInfo Ltd.
P.O. Box 3
Alton, Hampshire GU34 2PG
England

RECENT WORLD BANK TECHNICAL PAPERS (continued)

- No. 205 Xie, Küffner, and Le Moigne, *Using Water Efficiently: Technological Options*
- No. 206 The World Bank/FAO/UNIDO/Industry Fertilizer Working Group, *World and Regional Supply and Demand Balances for Nitrogen, Phosphate, and Potash, 1991/92–1997/98*
- No. 207 Narayan, *Participatory Evaluation: Tools for Managing Change in Water and Sanitation*
- No. 208 Bindlish and Evenson, *Evaluation of the Performance of T&V Extension in Kenya*
- No. 209 Keith, *Property Tax: A Practical Manual for Anglophone Africa*
- No. 210 Bradley and McNamara, editors, *Living with Trees: Policies for Forestry Management in Zimbabwe*
- No. 211 Wiebers, *Integrated Pest Management and Pesticide Regulation in Developing Asia*
- No. 212 Frederiksen, Berkoff, and Barber, *Water Resources Management in Asia, Volume I: Main Report*
- No. 213 Srivastava and Jaffee, *Best Practices for Moving Seed Technology: New Approaches to Doing Business*
- No. 214 Bonfiglioli, *Agro-pastoralism in Chad as a Strategy for Survival: An Essay on the Relationship between Anthropology and Statistics*
- No. 215 Umali, *Irrigation-Induced Salinity: A Growing Problem for Development and the Environment*
- No. 216 Carr, *Improving Cash Crops in Africa: Factors Influencing the Productivity of Cotton, Coffee, and Tea Grown by Smallholders*
- No. 217 Antholt, *Getting Ready for the Twenty-First Century: Technical Change and Institutional Modernization in Agriculture*
- No. 218 Mohan, editor, *Bibliography of Publications: Technical Department, Africa Region, July 1987 to December 1992*
- No. 219 Cercone, *Alcohol-Related Problems as an Obstacle to the Development of Human Capital: Issues and Policy Options*
- No. 220 Kingsley, *Managing Urban Environmental Quality in Asia*
- No. 221 Srivastava, Tamboli, English, Lal, and Stewart, *Conserving Soil Moisture and Fertility in the Warm Seasonally Dry Tropics*
- No. 222 Selvaratnam, *Innovations in Higher Education: Singapore at the Competitive Edge*
- No. 223 Piotrow, Treiman, Rimon, Yun, and Lozare, *Strategies for Family Planning Promotion*
- No. 224 Midgley, *Urban Transport in Asia: An Operational Agenda for the 1990s*
- No. 225 Dia, *A Governance Approach to Civil Service Reform in Sub-Saharan Africa*
- No. 226 Bindlish, Evenson, and Gbetibouo, *Evaluation of T&V-Based Extension in Burkina Faso*
- No. 227 Cook, editor, *Involuntary Resettlement in Africa: Selected Papers from a Conference on Environment and Settlement Issues in Africa*
- No. 228 Webster and Charap, *The Emergence of Private Sector Manufacturing in St. Petersburg: A Survey of Firms*
- No. 229 Webster, *The Emergence of Private Sector Manufacturing in Hungary: A Survey of Firms*
- No. 230 Webster and Swanson, *The Emergence of Private Sector Manufacturing in the Former Czech and Slovak Federal Republic: A Survey of Firms*
- No. 231 Eisa, Barghouti, Gillham, and Al-Saffy, *Cotton Production Prospects for the Decade to 2005: A Global Overview*
- No. 232 Creightney, *Transport and Economic Performance: A Survey of Developing Countries*
- No. 233 Frederiksen, Berkoff, and Barber, *Principles and Practices for Dealing with Water Resources Issues*
- No. 234 Archondo-Callao and Faiz, *Estimating Vehicle Operating Costs*
- No. 235 Ciaessens, *Risk Management in Developing Countries*
- No. 236 Bennett and Goldberg, *Providing Enterprise Development and Financial Services to Women: A Decade of Bank Experience in Asia*
- No. 237 Webster, *The Emergence of Private Sector Manufacturing in Poland: A Survey of Firms*
- No. 238 Heath, *Land Rights in Côte d'Ivoire: Survey and Prospects for Project Intervention*

The World Bank

Headquarters

1818 H Street, N.W.
Washington, D.C. 20433, U.S.A.

Telephone: (202) 477-1234

Facsimile: (202) 477-6391

Telex: WUI 64145 WORLD BANK

RCA 248423 WORLD BK

Cable Address: INTBAFRAD
WASHINGTON DC

European Office

66, avenue d'Iéna
75116 Paris, France

Telephone: (1) 40.69.30.00

Facsimile: (1) 40.69.30.66

Telex: 640651

Tokyo Office

Kokusai Building
1-1 Marunouchi 3-chome
Chiyoda-ku, Tokyo 100, Japan

Telephone: (3) 3214-5001

Facsimile: (3) 3214-3657

Telex: 26838



